PERFORMANCE MADE SMARTER



2-wire transmitter with HART protocol

5337A

– RTD, TC, Ohm, and bipolar mV input
– 2 analog inputs and 5 device variables with status available
– HART protocol revision selectable from HART 5 or HART 7
– Hardware assessed for use in SIL applications
– Mounting in Safe area or Zone 2/22

Application

- Linearized temperature measurement with TC and RTD sensors e.g. Pt100 and Ni100.
- HART communication and 4...20 mA analog PV output for individual, difference or average temperature measurement of up to two RTD or TC input sensors.
- Conversion of linear resistance to a standard analog current signal, e.g from valves or Ohmic level sensors.
- Amplification of bipolar mV signals to standard 4...20 mA current signals.
- Up to 63 transmitters (HART 7) can be connected in a multidrop communication setup.

Technical characteristics

- HART protocol revision can be changed by user configuration to either HART 5 or HART 7 protocol.
- The HART 7 protocol offers: · Long Tag numbers of up to 32 characters.· Enhanced Burst Mode and Event notification with time stamping.· Device variable and status mapping to any dynamic variable PV, SV, TV or QV.· Process signal trend measurement with logs and summary data.· Automatic event notification with time stamps.· Command aggregation for higher communication efficiency.
- 5337A is designed according to strict safety requirements and is therefore suitable for applications in SIL installations.
- Continuous check of vital stored data.
- Meeting the NAMUR NE21 recommendations, the 5337 HART transmitter ensures top measurement performance in harsh EMC environments. Additionally, the 5337 meets NAMUR NE43 and NE89 recommendations.

Mounting / installation

- For DIN form B sensor head or DIN rail mounting via the PR fitting type 8421.
- Configuration via standard HART communication interfaces or by PR 5909 Loop Link.

Connections

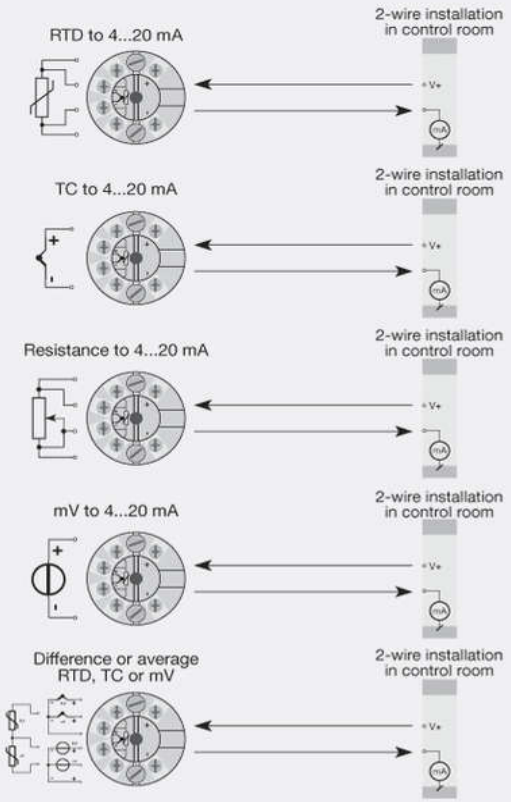

This page is automatically generated on the basis of information provided on www.prelectronics.com and affiliated websites. It is provided to you as a service and for information purpose only. While we have attempted to maintain the information as accurately as possible, the page may contain errors or omissions for which we disclaim any and all liability

Order:

Type
5337A

Environmental Conditions

Specifications range	-40°C to +85°C
Calibration temperature	20...28°C
Relative humidity	< 95% RH (non-cond.)
Protection degree (encl./terminal)	IP68 / IP00

Mechanical specifications

Dimensions	Ø 44 x 20.2 mm
Weight approx.	50 g
Wire size	1 x 1.5 mm^2 stranded wire
Screw terminal torque	0.4 Nm
Vibration	IEC 60068-2-6 : 2007
Vibration: 2...25 Hz	±1.6 mm
Vibration: 25...100 Hz	±4 g

Common specifications

Supply

Supply voltage	8.0...35 VDC

Isolation voltage

Isolation voltage, test / working	1.5 kVAC / 50 VAC

Response time

Response time (programmable)	1...60 s
Voltage drop	8.0 VDC
Signal / noise ratio	> 60 dB
Programming	Loop Link & HART®
Accuracy	Better than 0.05% of selected range
Signal dynamics, input	22 bit
Signal dynamics, output	16 bit
EMC immunity influence	< ±0.1% of span
Extended EMC immunity: NAMUR NE 21, A criterion, burst	< ±1% of span

Input specifications

Common input specifications

Max. offset	50% of selected max. value

RTD input

RTD type	Pt50, Pt100, Pt200, Pt500, Pt1000, Ni50, Ni100, Ni120, Ni1000
Cable resistance per wire (max.)	5 Ω (up to 50 Ω per wire is possible with reduced measurement accuracy)
Sensor current	Nom. 0.2 mA

TC input

Thermocouple type	B, E, J, K, L, N, R, S, T, U, W3, W5, LR
Cold junction compensation (CJC)	Constant, internal or external via a Pt100 or Ni100 sensor

Voltage input

Measurement range	-800...+800 mV
Min. measurement range (span)	2.5 mV
Input resistance	10 MΩ

Output specifications

Current output

Signal range	4…20 mA
Min. signal range	16 mA
Load (@ current output)	≤ (Vsupply - 8) / 0.023 [Ω]
Sensor error indication	Programmable 3.5…23 mA
NAMUR NE 43 Upscale/Downscale	23 mA / 3.5 mA

Common output specifications

Updating time	440 ms
HART protocol revisions	HART 5 and HART 7

Observed authority requirements

EMC	2014/30/EU

Approvals

ATEX 2014/34/EU	KEMA 03ATEX1508 X
IECEx	KEM 10.0083X
INMETRO	NCC 12.0844 X
EAC	TR-CU 020/2011
DNV-GL Marine	Stand. f. Certific. No. 2.4
SIL	Hardware assessed for use in SIL applications