Max. 58 m³/h

DC axial fans

☐ 60 x 25 mm




- **Material:** Housing: GRP[1] (PBT)
  Impeller: GRP[1] (PA)
- **Direction of air flow:** Exhaust over struts
- **Direction of rotation:** Clockwise, looking towards rotor
- **Connection:** Via single wires AWG 22, TR 64
- **Highlights:** Developed for applications with demanding environmental requirements
- **Weight:** 70 g

- **Possible special versions:**
  (See chapter DC fans - specials)
  - Speed signal
  - Go / NoGo alarm
  - Alarm with speed limit
  - External temperature sensor
  - PWM control input
  - Analog control input
  - Moisture protection
  - Salt spray protection
  - Degree of protection: IP 54 / IP 68


1) Fiberglass-reinforced plastic

Series 630 **Nominal data**	Air flow	Air flow	**Nominal voltage**	Voltage range	Sound pressure level	Sound power level	Sintec sleeve bearings Ball bearings	Power consumption	Nominal speed	Temperature range	Service life L_{10} (40 °C) ebm-papst standard Service life L_{10} (T_{max}) ebm-papst standard	Life expectancy L_{10IPC} (40 °C) see page 17	Curve
Type	**m³/h**	**cfm**	**VDC**	**VDC**	**dB(A)**	**Bel(A)**	**□/■**	**Watts**	**rpm⁻¹**	**°C**	**Hours**	**Hours**	
632 NU	40	23.5	**12**	6...15	33	5.2	■	1.8	5 900	-20...+70	85 000 / 42 500	142 500	①
632/2 HPU	44	25.9	**12**	10.8...13.2	35	5.4	■	1.5	6 300	-20...+70	85 000 / 42 500	142 500	②
634 NU	40	23.5	**24**	12...30	34	5.1	■	1.6	5 900	-20...+70	85 000 / 42 500	142 500	①
634 HHU	58	34.1	**24**	18...28	44	6.1	■	3.2	8 500	-20...+70	75 000 / 37 500	127 500	③
634/2 HHPU	58	34.1	**24**	18...28	44	6.1	■	3.2	8 500	-20...+70	75 000 / 37 500	127 500	③
638/2 HPU	44	25.9	**48**	40...60	35	5.4	■	1.8	6 300	-20...+70	85 000 / 42 500	142 500	②

Subject to change

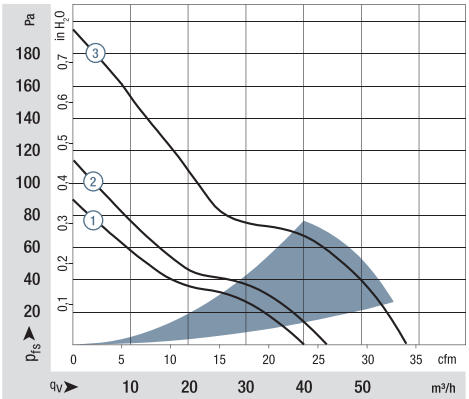

Air performance measured according to: ISO 5801.
Installation category A, without contact protection.
Noise: Total sound power level L_{WA} ISO 103002 measured on a hemisphere with a radius of 2 m.
Sound pressure level L_{pA} measured at 1 m distance from fan axis.
The values given are applicable only under the specified measuring conditions and may differ depending on the installation conditions.
In the event of deviation from the standard configuration, the parameters must be checked after installation!
For detailed information see
http://www.ebmpapst.com/general conditions

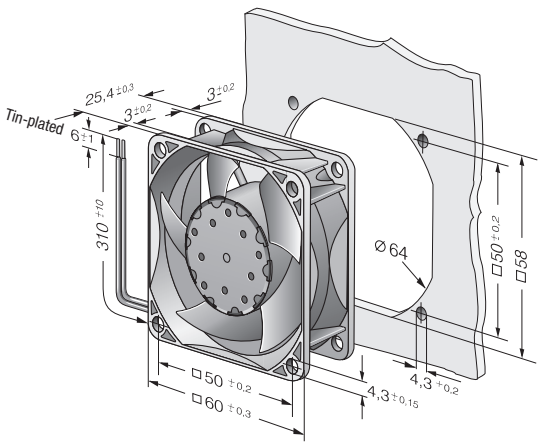

ebmpapst