# INSULATED AUXILIARY ROD

**SAFETY**
Protective visor with lift-up visor.

**STANDARD**
NF EN50508 CEI 61235-S

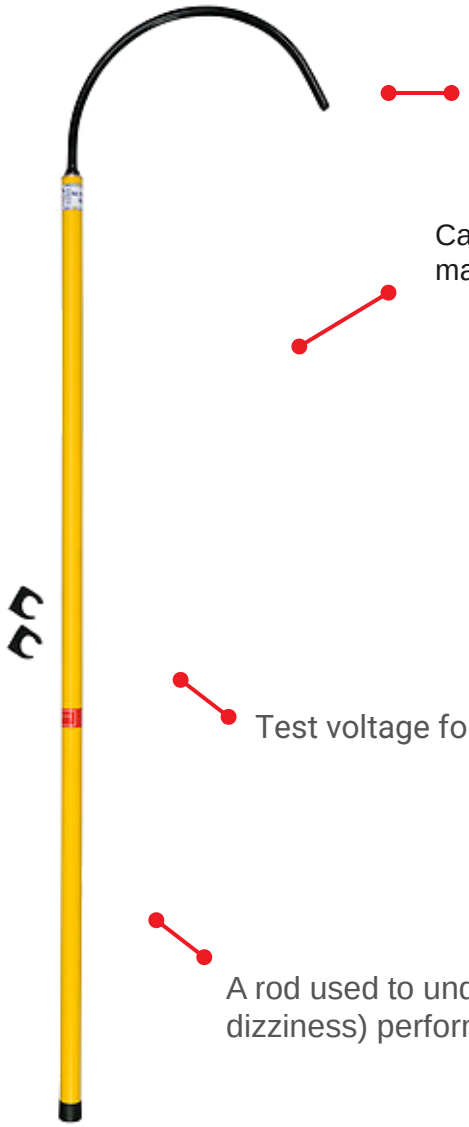

Can be used for devices with a maximum voltage rating: 45KV.

Equipped with brackets for hanging on the wall.

Test voltage for each 300 mm length: 100kV.

Length of the insulating part: 600 mm
Overall length without hook: 147 cm

A rod used to undertake the rescue of an injured worker (in the event of electrocution or dizziness) performing activities at electrical substations of categories I, II and III.

| SKU | DESCRIPTION |
|---|---|
| **BC.PSVE** | INSULATED AUXILIARY ROD |