Clifford & Snell

INSTALLATION & TECHNICAL INFORMATION

PLEASE READ PRIOR TO INSTALLATION



For FD40 Translations and Documentation scan above.

For SD40 Translations and Documentation scan above.

FD/SD40 Yodac Series

(Flashing or Static LED Indicators)

VISUAL SIGNALLING DEVICE

S00630 Issue 5

APPROVALS AND CONFORMITIES

2797-CPR-713892

KM 713890

0086-CPR-774029

RoHS

www.moflash.com technical@moflash.co.uk

Installation

- Installation must be carried out in accordance with the latest codes of practice by a qualified electrician.
- Check that the power supply is correct for the voltage rating of the Beacon to be installed.
- Ensure that the power supply is disconnected prior to installation or maintenance to avoid electrical shock.
- The back box must be mounted with the two cable entry holes at the top or bottom.
- Cable entries points (M20) are provided on all sides and in the base.
- The back box should be mounted to a wall, bulkhead or conduit box formed of suitable material using the back box and gasket supplied. See Figure 1 for mounting holes.
- Avoid mounting the Beacon where it could subjected to excessive vibration levels.
- It is not necessary to earth the alarm circuitry, but earth tags should be used if earth continuity of conduit or cable sheathing is to be maintained

Ingress Protection

To maintain the IP rating of the product, the below points must be observed.

- A suitable rated (Minimum IP65) cable gland (not supplied) must be used.
- When replacing the front cover, each of the two retaining screws must be torqued to 0.6Nm ±0.1Nm

Electrical Connections

- These devices are purchased as modular assembly kits & by combining various coloured Beacon heads, (either Flashing (FD) or Static Type (SD)). They offer great Visual Status flexibility.
- The modular assembly allows for the addition of a YA40 Acoustic Signal if required.
- For independant operation each Beacon/Sounder unit will need its own power supply, this can be done with either a common 0v line and seperate +24v power lines, or each unit having its own 0v and +24v lines.
- Figure 3 below shows the optional sounder PCB with the 0v and +Ve connections, along with the DIP switch for tone selection.
  See Tone Table (page 4).
- On page 3, Figure 2 shows PCB for 24vDC beacons and Figure 4 shows PCB for high voltage (48v, 115v & 230v AC/DC) beacons.

Line Integrity on DC Systems

- Monitor via threshold, (applied voltage<1v) an end-of-line (E.O.L) resistor is required for line monitoring and should have a minimum resistance of 3k3 Ohms and 0.5 Watts, wire-wound or metal film type.

Dimensional Drawing

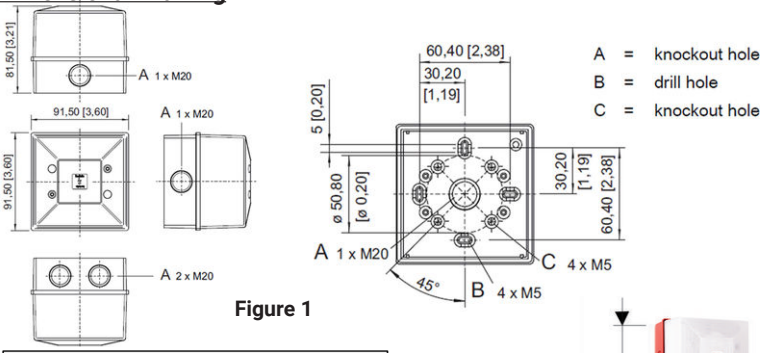


Figure 1

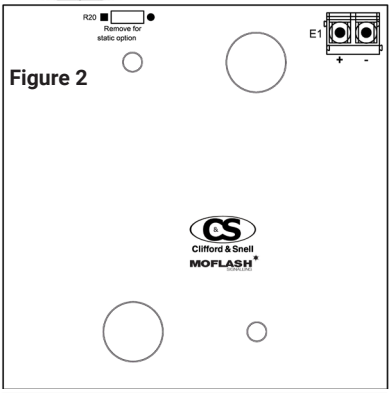


Figure 2

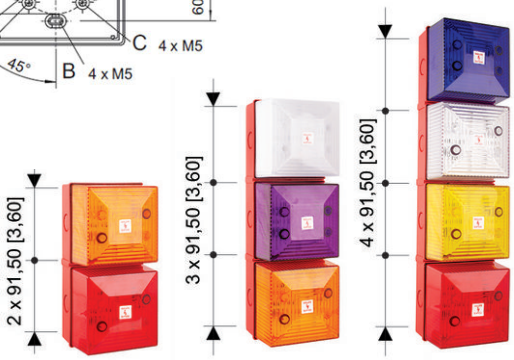
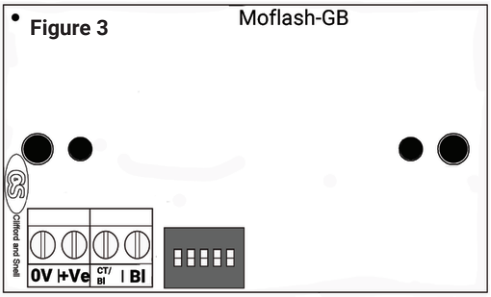


Figure 3



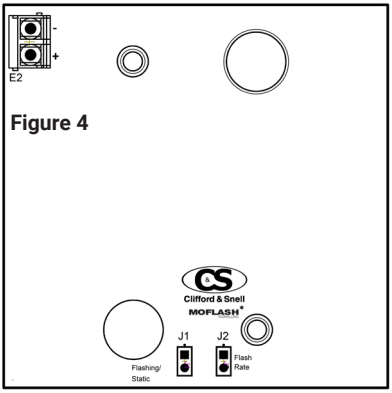


Figure 4

Figure 4 functionality
Options for additional flash rate & static light option, see table for jumper positions. J2 flash rates only apply when J1 is fitted.

AC LED beacon will be factory set to 60 FPM as standard.

Link	Link in	Link out
J1	Flashing mode	Static Mode
J2	120 FPM	60 FPM

Features include:

- Termination: Upto 2.5mm² cable
- Flash Rate: 60 FPM (24vDC FD40) or 60/120 FPM (48v, 115v & 230v)
- Operating Temperature: -25°C to +70°C
- Enclosure Material: Fire Resistant UL94-5VB rated ABS
- Lens Material: Fire Resistant Polycarbonate
- Ingress Protection: Weatherproof to IP65
- Sound Pressure Level: 108dB(A) Max. (Sounder only)
- Volume Control Adjustment: -18dB (Sounder only)

Tone Table

Tone	Description	Frequency (Hz)	Rept. rate	Second Stage	Switches 1	2	3	4	5	Special Application	dB(A) @ 1m (± 3dB)
1*	Alternating	800-1000	0.5	3	I	I	I	I	I	Fire Alarms	108
2	Alternating	2500-3100	0.5	4	O	I	I	I	I	Security Alarms	108
3	Alternating (fast)	800-1000	0.25	7	I	O	I	I	I	Increased urgency	108
4	Alternating (fast)	2500-3100	0.25	8	O	O	I	I	I	Security deterrent	108
5*	Alternating	440-554	0.4/0.1	14	I	I	O	I	I	AFNOR, France (NFS 32001)	108
6	Alternating	430-470	1	14	O	I	O	I	I		105
7	Alternating (v.fast)	800-1000	0.13	12	I	O	O	I	I		108
8	Alternating (v.fast)	2500-3200	0.07	13	O	O	O	I	I		107
9	Alternating	440-554	2	10	I	I	I	O	I	Turn-out, Sweden	105
10	Continuous note	700	-	1	O	I	I	O	I	All-clear, Sweden	107
11*	Continuous note	1000	-	31	I	O	I	O	I		108
12	Continuous note	1000	-	7	O	O	I	O	I		108
13	Continuous note	2300	-	2	I	I	O	O	I		108
14	Continuous note	440	-	9	O	I	O	O	I		104
15*	Interrupted tone	1000	2	31	I	O	O	O	I		108
16*	Interrupted tone	420	1.25	30	O	O	O	O	I	AS2220, Australia	105
17	Interrupted tone	1000	0.5	1	I	I	I	I	O		108
18	Interrupted tone	2500	0.25	4	O	I	I	I	O		106
19	Interrupted tone	2500	0.5	2	I	O	I	I	O		106
20	Interrupted tone	700	6/12	10	O	O	I	I	O	Pre-vital mess, Sweden	105
21	Interrupted tone	1000	1	32	I	I	O	I	O		108
22	Interrupted tone	700	4	10	O	I	O	I	O	Air-raid, Sweden	104
23	Interrupted tone	700	0.25	10	I	O	O	I	O	Local warning, Sweden	103
24	Interrupted tone	720	0.7/0.3	10	O	O	O	I	O	Industrial alarm, Germany	104
25	Int,fast,rising volume	1400	0.25	26	I	I	I	O	O		108
26	Fast siren	250-1200	0.085	11	O	I	I	O	O		106
27	Rising constant, fall	1000	10/40/10	17	I	O	I	O	O	Industrial alarm, Germany	108
28*	ISO 8201 Evacuation	800-1000	as std	11	O	O	I	O	O	Int'l evacuation alarm	107
29	Fast whoop	500-1000	0.15	32	I	I	O	O	O		106
30*	Slow whoop	500-1200	4.5	12	O	I	O	O	O	Evacuation, The Netherlands	108
31*	Reverse sweep	1200-500	1	11	I	O	O	O	O	Evacuation, Germany	107
32	Siren	500-1200	3	26	O	O	O	O	O		107

Note: EN54-3 Compatible Tones are marked above with *.

Moflash Signalling Limited accepts no liability for any consequences following use of this document. Any technical specifications and products referred to within this document are subject to change without notice due to continual improvement and product development policies. All dB(A) figures are subject to environmental conditions. The units are sold under Moflash standard conditions of sale, available on request.

Addtional resources, including installation sheet translations, certificates and DoCs are available from the www.moflash.co.uk website.