


# Star-delta contactor combination, 11kW/400V/AC3


| | |
|---|---|
| **Part no.** | **SDAINLM22(230V50HZ,240V60HZ)** |
| **Catalog No.** | **278336** |
| **Eaton Catalog No.** | **XTSD022B10F** |
| **EL-Nummer (Norway)** | **4130486** |

## Delivery program


| | | | |
|---|---|---|---|
| Product range | | | Contactor combinations |
| Application | | | Star-delta motor starting for contactor combinations |
| Accessories | | | Star-delta combinations SDAINL |
| Utilization category | | | NAC-3: Normal AC induction motors: starting, switch off during running |
| | | | IE3 |
| Notes | | | Also suitable for motors with efficiency class IE3.<br>IE3-ready devices are identified by the logo on their packaging. |
| Description | | | Operating frequency: maximum 30 starts per hour |
| **Rated operational current** | | | |
| AC-3 | | | |
| 380 V 400 V | $I_e$ | A | 22 |
| **Max. rating for three-phase motors, 50 - 60 Hz** | | | |
| AC-3 | | | |
| 220 V 230 V | P | kW | 5.5 |
| 380 V 400 V | P | kW | 11 |
| 500 V | P | kW | 11 |
| 660 V 690 V | P | kW | 11 |
| Max. changeover time | | s | 20 |
| Actuating voltage | | | 230 V 50 Hz, 240 V 60 Hz |
| Voltage AC/DC | | | AC operation |
| **Individual components of the combination** | | | |
| Mains contactor Q11 | | Part no. | DILM12-10<br>+ DILA-XHI20 |
| Delta contactor Q15 | | Part no. | DILM12-01<br>+ DILA-XHI20 |
| Star contactor Q13 | | Part no. | DILM7-01<br>+ DILA-XHI20 |
| Timing relay K1 | | Part no. | ETR4-51 |
| Spare auxiliary contacts | | | |



Q11



Q13



Q15

## Design verification as per IEC/EN 61439


| | | | |
|---|---|---|---|
| Technical data for design verification | | | |
| Rated operational current for specified heat dissipation | $I_n$ | A | 12.76 |
| Heat dissipation per pole, current-dependent | $P_{vid}$ | W | 1.37 |
| Equipment heat dissipation, current-dependent | $P_{vid}$ | W | 4.1 |
| Static heat dissipation, non-current-dependent | $P_{vs}$ | W | 4.8 |
| Heat dissipation capacity | $P_{diss}$ | W | 0 |
| Operating ambient temperature max. | | °C | -25 |
| Operating ambient temperature max. | | °C | 60 |
| IEC/EN 61439 design verification | | | |
| 10.2 Strength of materials and parts | | | |
| 10.2.2 Corrosion resistance | | | Meets the product standard's requirements. |
| 10.2.3.1 Verification of thermal stability of enclosures | | | Meets the product standard's requirements. |
| 10.2.3.2 Verification of resistance of insulating materials to normal heat | | | Meets the product standard's requirements. |
| 10.2.3.3 Verification of resistance of insulating materials to abnormal heat and fire due to internal electric effects | | | Meets the product standard's requirements. |
| 10.2.4 Resistance to ultra-violet (UV) radiation | | | Meets the product standard's requirements. |
| 10.2.5 Lifting | | | Does not apply, since the entire switchgear needs to be evaluated. |
| 10.2.6 Mechanical impact | | | Does not apply, since the entire switchgear needs to be evaluated. |
| 10.2.7 Inscriptions | | | Meets the product standard's requirements. |
| 10.3 Degree of protection of ASSEMBLIES | | | Does not apply, since the entire switchgear needs to be evaluated. |
| 10.4 Clearances and creepage distances | | | Meets the product standard's requirements. |
| 10.5 Protection against electric shock | | | Does not apply, since the entire switchgear needs to be evaluated. |
| 10.6 Incorporation of switching devices and components | | | Does not apply, since the entire switchgear needs to be evaluated. |
| 10.7 Internal electrical circuits and connections | | | Is the panel builder's responsibility. |
| 10.8 Connections for external conductors | | | Is the panel builder's responsibility. |
| 10.9 Insulation properties | | | |
| 10.9.2 Power-frequency electric strength | | | Is the panel builder's responsibility. |
| 10.9.3 Impulse withstand voltage | | | Is the panel builder's responsibility. |
| 10.9.4 Testing of enclosures made of insulating material | | | Is the panel builder's responsibility. |
| 10.10 Temperature rise | | | The panel builder is responsible for the temperature rise calculation. Eaton will provide heat dissipation data for the devices. |
| 10.11 Short-circuit rating | | | Is the panel builder's responsibility. The specifications for the switchgear must be observed. |
| 10.12 Electromagnetic compatibility | | | Is the panel builder's responsibility. The specifications for the switchgear must be observed. |
| 10.13 Mechanical function | | | The device meets the requirements, provided the information in the instruction leaflet (IL) is observed. |

## Technical data ETIM 6.0

| | | | |
|---|---|---|---|
| Low-voltage industrial components (EG000017) / Combination of contactors (EC000010) | | | |
| Electric engineering, automation, process control engineering / Low-voltage switch technology / Contactor (LV) / Combination of contactor (ecl@ss8.1-27-37-10-09 [AGZ572011]) | | | |
| Function | | | Star-delta contactor |
| Rated control supply voltage Us at AC 50HZ | | V | 230 - 230 |
| Rated control supply voltage Us at AC 60HZ | | V | 240 - 240 |
| Rated control supply voltage Us at DC | | V | 0 - 0 |
| Voltage type for actuating | | | AC |
| Rated operation current Ie at AC-3, 400 V | | A | 22 |


| | | | |
|---|---|---|---|
| Rated operation power at AC-3, 400 V | | kW | 11 |
| Type of electrical connection of main circuit | | | Screw connection |
| Degree of protection (IP) | | | IP20 |

## Characteristics

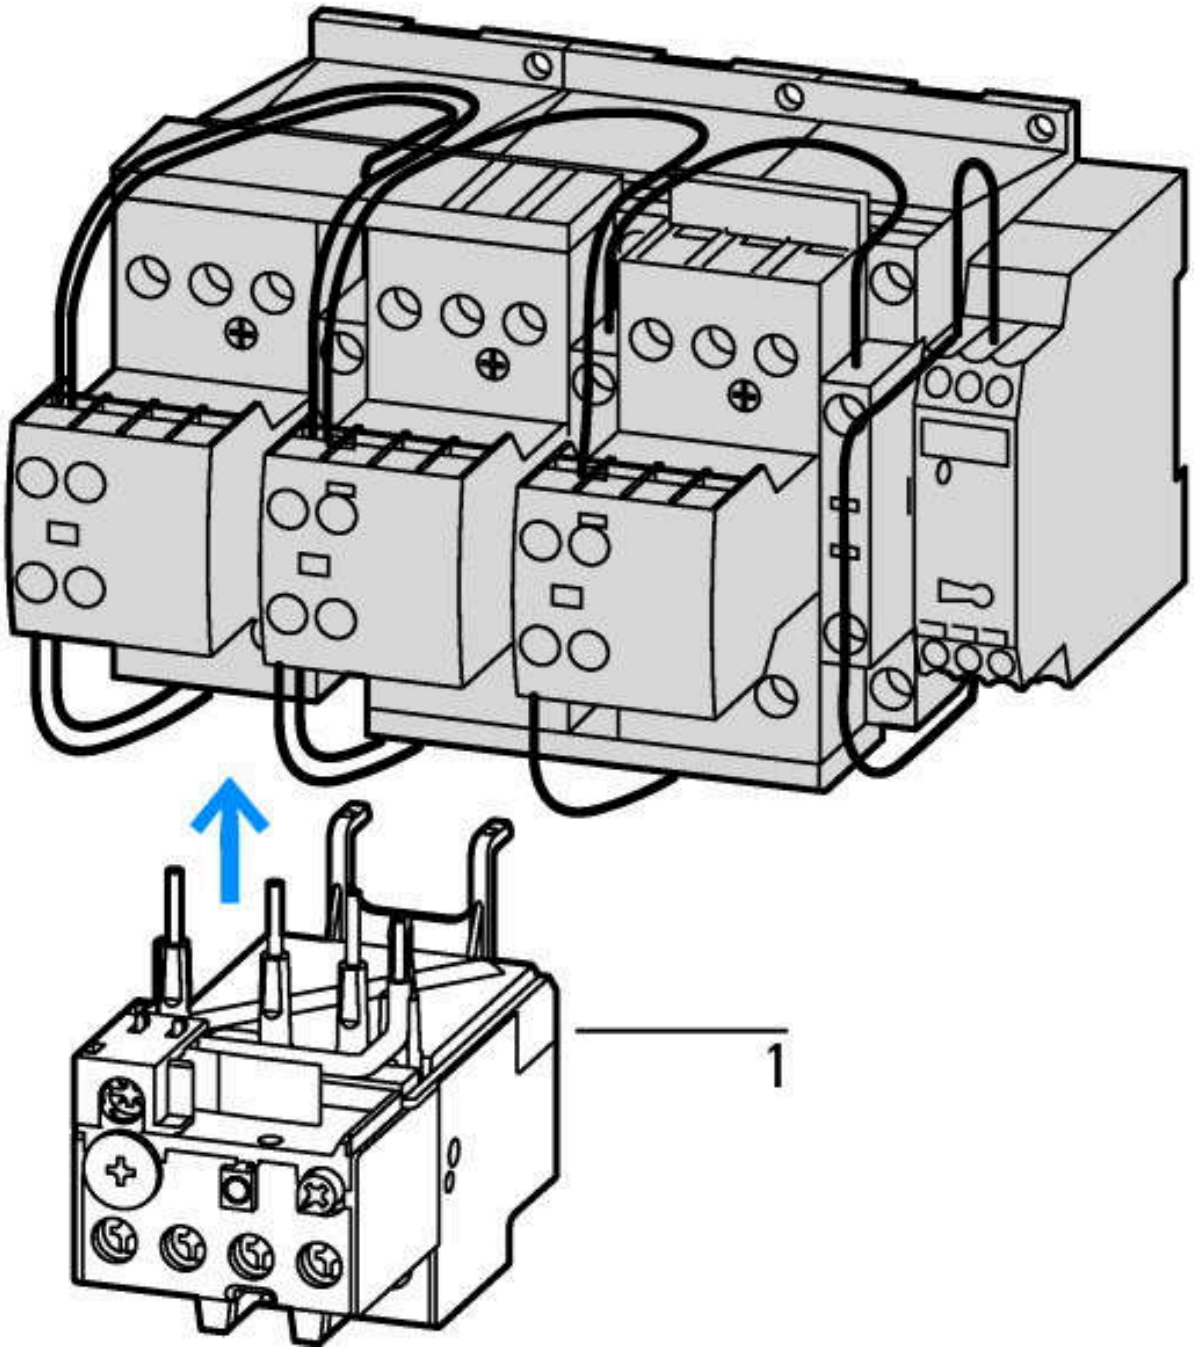


1: Overload relay

## Dimensions

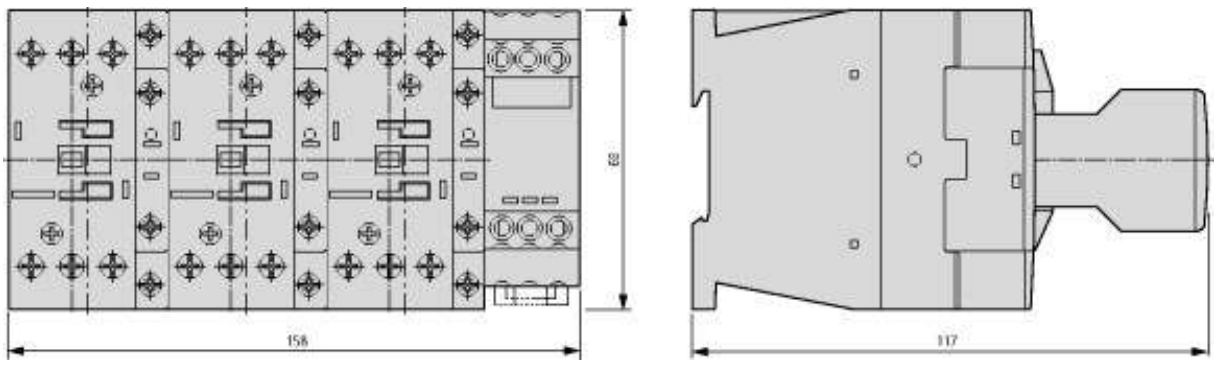


Basic unit with auxiliary contact module

## Assets (Links)

### Declaration of Conformity

00002560

### Instruction Leaflets

IL03407030Z2011_07

## Additional product information (links)

| **IL03407030Z (AWA2100-2139) Wiring for contactor combinations** | |
|---|---|
| IL03407030Z (AWA2100-2139) Wiring for contactor combinations | ftp://ftp.moeller.net/DOCUMENTATION/AWA_INSTRUCTIONS/IL03407030Z2011_07.pdf |


© 01/2018 by Eaton Industries GmbH