P30H TRANSDUCER OF D.C. CIRCUITS PARAMETERS WITH DATA RECORD AND ETHERNET

LUMEL EVERYTHING COUNTS

FEATURES:

MOD BUS Slave | MOD BUS Master | MOD BUS Monitor | eCon Program | SD/ SDHC | Firmware upgrade | RTC | Password protection | Ethernet | www ftp | CAN | CAN open

INPUT:

DC | MOD BUS | RS 485

OUTPUTS:

U | RS 485 | CAN


GALVANIC ISOLATION:

Supply | RS 485 | Ethernet



- Measurement of voltage, current, power, energy and other parameters in d.c. circuits.
- Conversion of measured value in an output signal on the base of the inddivudal characteristic.
- 1 or 2 alarm relays with NO contact working in 6 modes.
- Additional supplying output 24 V d.c 30 mA switched-on/switched-off (option).
- Recording of input signals in internal memory, on SD/SDHC card (option) or internal file system memory (option).
- Interface RS-485 Modbus RTU.
- RS-485 Master/Monitor mode – possibility to poll 1 device.
- SD/SDHC support (option).
- Interface Ethernet 10/100 BASE-T (option).
  - Protocol: Modbus TCP/IP, HTTP, FTP.
  - Services: www server, ftp server, client DHCP.
- **Interface CAN with CANopen protocol.**

EXAMPLE OF APPLICATION

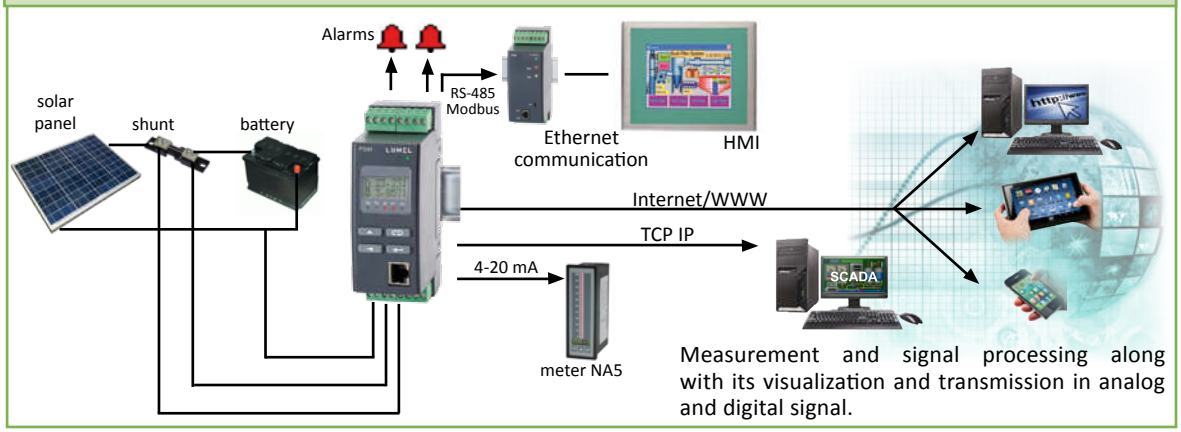

Measurement and signal processing along with its visualization and transmission in analog and digital signal.

MEASURED AND CALCULATED VALUES BY THE TRANSDUCER

- d.c. voltage **U** (direct or through additional resistor D5)
- d.c. current **I** (direct through shunt)
- power of d.c. current **P**
- voltage difference in time **dU** (5 s, 30 s, 1 min, 5 min or 15 min)
- current difference in time **dI** (5 s, 30 s, 1 min, 5 min or 15 min)
- voltage averaged over time U_{AV} (15, 30 or 60 min.)
- current averaged over time I_{AV} (15, 30 or 60 min.)
- power averaged over time P_{AV} (15, 30 or 60 min.)
- operating/ measurement time **t [s]**
- operating/ measurement time **t [H.M]**
- load capacity **C**
- input energy $E_{P\leftarrow}$
- output energy $E_{P\rightarrow}$
- total energy E_P (input+output)
- maximum and minimum values

INPUTS AND MEASURING RANGES

Measured value		Nominal range K_U=1, K_I=100 000	Measuring range (maximum)	Class
Voltages U, dU, UAV	12V	-4 . . . 12 V	-5...15 V	0.2
	48V	-4 . . . 48 V	-10...57.6 V	
	100V	-5 . . . 100 V	-10...120 V	
	250V	-5 . . . 250 V	-10 ... 300V	
	600V*	-10 . . . 500 V	-10...600 V	0.2 + class of additional resistor
	1000V*	-10 . . . 1000 V	-10...1000 V	
Currents (shunt voltage) I, dI, IAV		-15000 . . . 15000 A (-150 . . . 150 mV)	-18000 ... 18000 A (-180 ... 180 mV)	0.2+ shunt class (voltage measurement 0.2)
Time counter t [s] t [H.M]		0...999999999 s 0...277777.5 h.m		1s/ 24h, resolution 1 s
Capacity C		-49 999 999 ... 49 999 999 kAh		±0.5 %
Power P, PAV	12V	-60...180 kW	-75...225 kW	0.4 + shunt class
	48V	-60...720 kW	-150...864 kW	
	100V	-0,075...1,5 MW	-0,15...1,8 MW	
	250V	-0,075...3,75 MW	-0,15...4,5 MW	
	600V*	-0,15...7,5 MW	-0,3...9 MW	0.4 + shunt class + + class of additional resistor
	1000V*	-0,3...15 MW	-0,6...18 MW	
Input energy $E_{P\leftarrow}$ Output energy $E_{P\rightarrow}$		0 ... 99 999 999.9 kWh		±0.5 % + shunt class
Energy sum E_T (input and output)		0 ... 199 999 999.9 kWh		±1 % + shunt class

* – version in set with additional resistor D5 ($K_U \neq 1$),
K_U – voltage ratio (Primar. U / Second. U),
K_I – current ratio (Shunt I / Shunt mV, K_I = 100 000 e.g. for shunt 15 000 A/ 150 mV)
The maximum range display of measured values on the LCD display are -99999G ... 99999G. These ranges depend upon the size parameters of the primary and secondary voltage divider and the shunt ratio (parameters Primar. U, Second. U, Shunt I, Shunt mV).

Technical support:
tel.: (+48 68) 45 75 143, 45 75 141, 45 75 144, 45 75 140
e-mail: export@lumel.com.pl

Export department:
tel.: (+48 68) 45 75 130, 45 75 132
e-mail: export@lumel.com.pl

Calibration & Attestation:
e-mail: laboratorium@lumel.com.pl

LUMEL S.A.
ul. Słubicka 4,
65-127 Zielona Góra, Poland
tel.: +48 68 45 75 100,
WWW.LUMEL.COM.PL

P30H TRANSDUCER OF D.C. CIRCUITS PARAMETERS WITH DATA RECORD AND ETHERNET

OUTPUTS

Output type	Properties	Remarks
Analog OUT1, OUT2 (1 or 2 outputs - depends on transducer version)	OUT1 current: 0/4...20 mA, load resistance ≤ 500 Ω voltage: 0...10 V, load resistance ≥ 500 Ω	accuracy class 0.1
	OUT2 current: 0/4...20 mA, load resistance ≤ 250 Ω voltage: 0...10 V, load resistance ≥ 500 Ω	accuracy class 0.5
Relay OUT2,OUT3 (1 or 2 outputs - depends on transducer version)	1 or 2 relays; voltageless contacts – NO –maximun load 5A 30V d.c., 250V a.c.	
Additional supplying output OUT3	24 V d.c. / 30 mA (option)	
Interface CAN OUT2	only for transducer version P30H X00XXXXXX	

DIGITAL INTERFACE

Interface type	Properties	Remarks
Ethernet 10/100 Baste-T (option)	Modbus TCP/ IP HTTP, FTP	www, ftp server, client DHCP
RS-485	Modbus RTU: 8N2, 8E1, 8O1, 8N1 Address 1...247	baud rate: 4.8, 9.6, 19.2, 38.4, 57.6, 115.2, 230.4, 256 kbit/s
CAN	Protocol: CANopen	baud rate: 20, 50, 100, 125, 250, 500, 1000 kBit/s

EXTERNAL FEATURES

Overall dimensions	45 × 120 × 100 mm	
Weight	< 0.25 kg	
Protection grade	for housing: IP40/ IP30	for terminals: IP20
Readout field	LCD 2 x 8 characters with LED backlight	


RATED OPERATION CONDITIONS

Supply voltage	• 85..253 V a.c., 85...300 V d.c. • 20..40 V a.c., 20...60 V d.c.	power consumption < 5 VA
Temperature	ambient: -25...23...+55°C	storage: -30...+70°C
Humidity	25...95 %	inadmissible condensation
Working position	any	

SAFETY AND COMPATIBILITY REQUIREMENTS


Electromagnetic compatibility	noise immunity	acc. to EN 61000-6-2
	noise emissions	acc. to EN 61000-6-4
Isolation between circuits	basic / reinforced (see user's manual)	acc. to EN 61010-1
Pollution level	2	acc. to EN 61010-1
Installation category	III for input voltage up to 300 V d.c., III for input voltage 300...600 V d.c. with additional resistance D5, II for input voltage 600...1000 V d.c. with additional resistance D5	
Maximal phase-to-earth voltage	• for supply and input circuits 300 V • for other circuits 50 V	
Altitude above see level	< 2000 m	

CONNECTION DIAGRAM

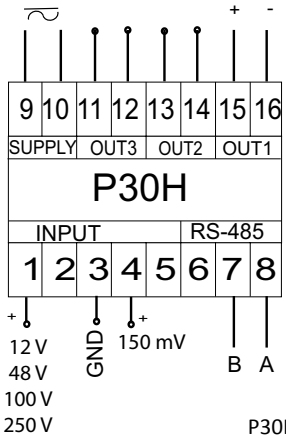


SUPPLY - supply
OUT2 - output no.2 (alarm. wyj analogowe lub interfejsowe CAN)
OUT3 - output no.3 (alarm or supplying output 24V)
OUT1 - main analog output no.1
INPUT - measuring input
RS-485 - interface RS-485

P30H-XX11XXXXX



OUT2 - alarm 1
OUT3- alarm 2

P30H-XX21XXXXX



OUT2 - analog output 2
0/4...20 mA
OUT3- Alarm 2

For more information about LUMEL products please visit our website:
www.lumel.com.pl

Technical support:
tel.: (+48 68) 45 75 143, 45 75 141, 45 75 144, 45 75 140
e-mail: export@lumel.com.pl

Export department:
tel.: (+48 68) 45 75 130, 45 75 132
e-mail: export@lumel.com.pl


Calibration & Attestation:
e-mail: laboratorium@lumel.com.pl

LUMEL S.A.
ul. Słubicka 4,
65-127 Zielona Góra, Poland
tel.: +48 68 45 75 100,
WWW.LUMEL.COM.PL

P30H TRANSDUCER OF D.C. CIRCUITS PARAMETERS WITH DATA RECORD AND ETHERNET


CONNECTION DIAGRAM

P30H-XX12XXXXX




OUT2 - alarm 1
OUT3- supplying output
24 V d.c., 30 mA

P30H-XX22XXXXX




OUT2 - analog output 2
0/4...20 mA
OUT3- supplying output
24 V d.c., 30 mA

P30H-XX31XXXXX




OUT2 - analog output 2
0...10 V
OUT3- alarm 2

P30H-XX32XXXXX




OUT2 - analog output 2
0...10 V
OUT3- supplying output
24 V d.c., 30 mA

P30H-X001XXXXX




OUT2 - interface CAN
OUT3- Alarm no 2

P30H-X002XXXXX



OUT2 - interface CAN
OUT3- supplying output
24 V d.c., 30mA

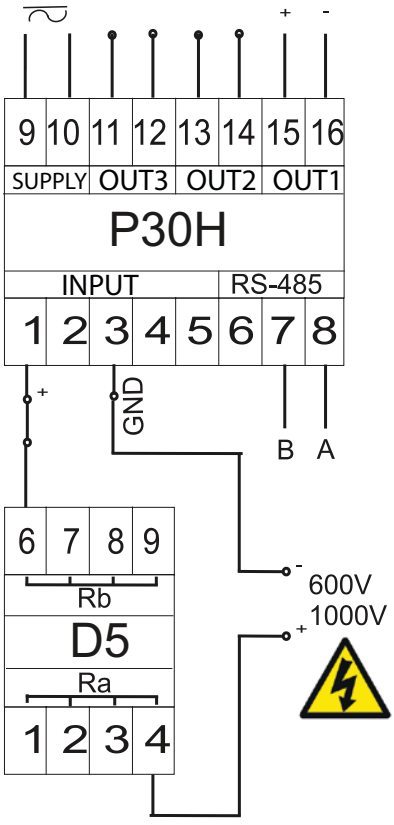

indirect voltage measurement 600 V, 1000 V

SEE ALSO:

For more information about LUMEL products please visit our website: www.lumel.com.pl

Technical support:
tel.: (+48 68) 45 75 143, 45 75 141, 45 75 144, 45 75 140
e-mail: export@lumel.com.pl
Export department:
tel.: (+48 68) 45 75 130, 45 75 132
e-mail: export@lumel.com.pl
Calibration & Attestation:
e-mail: laboratorium@lumel.com.pl

LUMEL S.A.
ul. Słubicka 4,
65-127 Zielona Góra, Poland
tel.: +48 68 45 75 100,
WWW.LUMEL.COM.PL

ORDERING

Code	Description
P30H 1011100M0	Transducer of d.c. circuit parameters P30H analog output 0/4...20mA; 2 relays, supply 85-253Vac / 85-300Vdc; documentation and descriptions in Polish and English test certificate
P30H 1211100M0	Transducer of d.c. circuit parameters P30H analog output 0/4...20mA; 2 relays, Ethernet and archive file system memory; supply 85-253Vac / 85-300Vdc; documentation and descriptions in Polish and English test certificate

Additional resistance D5	X	X	X
Measuring range in set with P30H:			
600 V	1		
1000 V	2		
Language:			
Polish		P	
English		E	
other*		X	
Acceptance tests:			
without extra requirements			0
with an extra quality inspection certificate			1
acc. to customer's request*			X

* after agreeing with the manufacturer

Order example:

The code **D5 2E1** means additional resistance D5 with measuring range 1000 V, in English, with an extra quality inspection certificate.

For more information about LUMEL products please visit our website: www.lumel.com.pl

Technical support:
tel.: (+48 68) 45 75 143, 45 75 141, 45 75 144, 45 75 140
e-mail: export@lumel.com.pl
Export department:
tel.: (+48 68) 45 75 130, 45 75 132
e-mail: export@lumel.com.pl
Calibration & Attestation:
e-mail: laboratorium@lumel.com.pl

LUMEL S.A.
ul. Słubicka 4,
65-127 Zielona Góra, Poland
tel.: +48 68 45 75 100,
WWW.LUMEL.COM.PL