OPTIONS FOR ABB DRIVES, CONVERTERS AND INVERTERS

# FENA-01/-11/-21 Ethernet adapter module

User's manual



# List of related manuals

See section *Related manuals* on page *27*.

You can find manuals and other product documents in PDF format on the Internet. See section Document library on the Internet on the inside of the back cover. For manuals not available in the Document library, contact your local ABB representative.

The code below opens an online listing of the manuals applicable to the product:

FENA-01/-11/-21 manual

Fieldbus connectivity webpage

# User's manual

## FENA-01/-11/-21 Ethernet adapter module


Table of contents 

1. Safety instructions 

4. Mechanical installation 

5. Electrical installation 

Modbus/TCP protocol M

EtherNet/IP protocol E

PROFINET IO protocol P

NONE protocol selection N



3AUA0000093568 Rev E
EN
EFFECTIVE: 2018-03-14



© 2018 ABB Oy
All Rights Reserved.

# Table of contents


### *1. Safety instructions*

Contents of this chapter . . . . . 19
Use of warnings . . . . . 20
Safety in installation . . . . . 21

### *2. Introduction to the manual*

Contents of this chapter . . . . . 23
Purpose of the manual . . . . . 23
Applicability . . . . . 23
Compatibility . . . . . 23
- Drives . . . . . 24
- Protocols . . . . . 24
- Tools . . . . . 25

Target audience . . . . . 26
Related manuals . . . . . 27
Contents . . . . . 28
Cybersecurity disclaimer . . . . . 30
Terms and abbreviations . . . . . 31
- General terms . . . . . 31
- Abbreviations . . . . . 32
- Modbus/TCP terms and abbreviations . . . . . 32
- EtherNet/IP terms and abbreviations . . . . . 33
- PROFINET IO terms and abbreviations . . . . . 34

### *3. Overview of the Ethernet network and the FENA-01/-11/-21 module*

Contents of this chapter . . . . . 37
Ethernet network . . . . . 37
- Example topology of the Ethernet link . . . . . 38

FENA-01/-11/-21 Ethernet adapter module . . . . . 40
- Layout of the adapter module . . . . . 41

### 4. Mechanical installation

Contents of this chapter . . . . . 43
Necessary tools and instructions . . . . . 43
Unpacking and examining the delivery . . . . . 43
Installing the adapter module . . . . . 44

### 5. Electrical installation

Contents of this chapter . . . . . 47
Warnings . . . . . 47
Necessary tools and instructions . . . . . 47
General cabling instructions . . . . . 48
Connecting the adapter module to the Ethernet network . . . . . 48
    Connection procedure . . . . . 49

## Modbus/TCP protocol

### 6. Modbus/TCP – Start-up

Contents of this chapter . . . . . 53
Warnings . . . . . 53
Drive configuration . . . . . 54
    Modbus/TCP connection configuration . . . . . 54
        FENA-01/-11-/21 configuration parameters – group A (group 1) . . . . . 55
        FENA-01/-11/-21 configuration parameters – group B (group 2) . . . . . 64
        FENA-01/-11/-21 configuration parameters – group C (group 3) . . . . . 65
    Control locations . . . . . 66
Starting up fieldbus communication for ACS355 drives . . . . . 67
    Parameter setting examples – ACS355 . . . . . 68
        Speed and torque control using the ABB Drives – Enhanced communication profile . . . . . 68
Starting up fieldbus communication for ACSM1 drives . . . . . 71
    Parameter setting examples – ACSM1 . . . . . 72
        Speed and torque control using the ABB Drives – Enhanced communication profile . . . . . 72

Starting up fieldbus communication for ACS850 and ACQ810 drives . . . . . 76
Parameter setting examples – ACS850 and ACQ810 . . . . . 77
Speed control using the ABB Drives – Enhanced communication profile . . . . . 77
Starting up fieldbus communication for ACS480, ACS580 and ACS880 drives . . . . . 80
Parameter setting examples – ACS480 and ACS580 drives 82
Frequency control using the ABB Drives – Enhanced communication profile . . . . . 82
Parameter setting examples – ACS880 . . . . . 85
Speed control using the ABB Drives – Enhanced communication profile . . . . . 85
Client configuration . . . . . 88
Modbus register maps . . . . . 88

### *7. Modbus/TCP – Communication profiles*

Contents of this chapter . . . . . 89
Communication profiles . . . . . 89
ABB Drives communication profile . . . . . 91
Control word and Status word . . . . . 91
Control word contents . . . . . 91
Status word contents . . . . . 93
State machine . . . . . 95
References . . . . . 96
Scaling . . . . . 96
Actual values . . . . . 97
Scaling . . . . . 97

### *8. Modbus/TCP – Communication protocol*

Contents of this chapter . . . . . 99
Modbus/TCP . . . . . 99
Register addressing . . . . . 100
Function codes . . . . . 100
Encapsulated Interface Transport / Read Device Identification 101
Exception codes . . . . . 102

Communication profiles . . . . . 102
ABB Drives profile - Classic . . . . . 103
ABB Drives profile - Enhanced . . . . . 104
Transparent 16-bit . . . . . 106
Transparent 32-bit . . . . . 108

### *9. Modbus/TCP – Diagnostics*

Contents of this chapter . . . . . 111
Fault and warning messages . . . . . 111
LEDs . . . . . 112
Internal error code registers . . . . . 114

## *EtherNet/IP protocol*

### *10. EtherNet/IP – Start-up*

Contents of this chapter . . . . . 119
Warnings . . . . . 119
Drive configuration . . . . . 120
EtherNet/IP connection configuration . . . . . 120
FENA-01/-11/-21 configuration parameters – group A (group 1) . . . . . 121
FENA-01/-11/-21 configuration parameters – group B (group 2) . . . . . 131
FENA-01/-11/-21 configuration parameters – group C (group 3) . . . . . 132
Control locations . . . . . 133
Starting up fieldbus communication for ACS355 drives . . . . . 134
Parameter setting examples – ACS355 . . . . . 135
Speed control using the ODVA AC/DC drive profile, Extended speed control assembly . . . . . 135
Starting up fieldbus communication for ACSM1 drives . . . . . 138
Parameter setting examples – ACSM1 . . . . . 139
Speed control using the ODVA AC/DC drive profile, Extended speed control assembly . . . . . 139
Starting up fieldbus communication for ACS850 and ACQ810 drives . . . . . 142
Parameter setting examples – ACS850 and ACQ810 . . . . 143

Speed control using the ODVA AC/DC drive profile, Extended speed control assembly . . . . . 143
Starting up fieldbus communication for ACS480, ACS580 and ACS880 drives . . . . . 146
Parameter setting examples – ACS480, ACS580 and ACS880 147
Speed control using the ODVA AC/DC drive profile, Extended speed control assembly . . . . . 147
Configuring the client . . . . . 150
Before you start . . . . . 150
Select protocol/profile. . . . . 150
Select output and input assembly instances . . . . . 150
Select connection method . . . . . 152
EDS files . . . . . 153
Configuring an Allen-Bradley® PLC . . . . . 154
Example 1: RSLogix 5000 . . . . . 154
Example 2: Studio 5000 . . . . . 160
Configuring DLR topology for FENA-21 . . . . . 167
Setup using Logix Designer . . . . . 167
Setup using RSLinx® Classic . . . . . 169

## *11. EtherNet/IP – Communication profiles*

Contents of this chapter . . . . . 171
Communication profiles . . . . . 171
ODVA AC/DC drive profile . . . . . 173
ODVA output attributes . . . . . 174
Run Forward & Run Reverse (Control supervisor object) . 174
Fault Reset (Control supervisor object) . . . . . 174
Net Ctrl (Control supervisor object) . . . . . 174
Net Ref (AC/DC drive object) . . . . . 174
Speed Reference (AC/DC drive object) . . . . . 175
Torque Reference (AC/DC drive object) . . . . . 177
ODVA input attributes . . . . . 178
Faulted (Control supervisor object) . . . . . 178
Warning (Control supervisor object). . . . . 178

Running Forward (Control supervisor object). . . . . 178
Running Reverse (Control supervisor object). . . . . 178
Ready (Control supervisor object) . . . . . 178
Ctrl From Net (Control supervisor object). . . . . 178
Ref From Net (AC/DC drive object) . . . . . 178
At Reference (AC/DC drive object). . . . . 179
State (Control supervisor object) . . . . . 179
Speed Actual (AC/DC drive object) . . . . . 181
Torque Actual (AC/DC drive object). . . . . 183
ABB Drives communication profile . . . . . 184
Control word and Status word . . . . . 184
Control word contents. . . . . 184
Status word contents . . . . . 187
State machine. . . . . 189
References . . . . . 190
Scaling . . . . . 190
Actual values . . . . . 191
Scaling . . . . . 191

## *12. EtherNet/IP – Communication protocol*

Contents of this chapter . . . . . 193
EtherNet/IP . . . . . 193
Object modeling and functional profiles . . . . . 194
Assembly objects . . . . . 194
Basic speed control assembly . . . . . 194
Basic speed control plus drive parameters assembly . . . . 195
Extended speed control assembly . . . . . 197
Extended speed control plus drive parameters assembly . 198
Basic speed and torque control assembly . . . . . 201
Basic speed and torque control plus drive parameters assembly . . . . . 202
Extended speed and torque control assembly . . . . . 204
Extended speed and torque control plus drive parameters assembly . . . . . 205
ABB Drives profile with set speed assembly . . . . . 208
ABB Drives profile with set speed plus drive

parameters assembly . . . . . 209
ABB Drives profile with set speed and set torque assembly . . . . . 211
ABB Drives profile with set speed and set torque plus drive parameters assembly . . . . . 212
Transparent 16 with one assembly . . . . . 215
Transparent 16 with one assembly plus drive parameters 216
Transparent 16 with two assembly . . . . . 218
Transparent 16 with two assembly plus drive parameters 219
Transparent 32 with one assembly . . . . . 221
Transparent 32 with one assembly plus drive parameters 222
Transparent 32 with two assembly . . . . . 225
Transparent 32 with two assembly plus drive parameters 226
Class objects . . . . . 229
Identity object, class 01h . . . . . 230
Class attributes (Instance #0) . . . . . 230
Instance attributes (Instance #1) . . . . . 230
Reset service (Service code 05h) . . . . . 231
Attribute explanations. . . . . 231
Motor data object, class 28h . . . . . 234
Class attributes (Instance #0) . . . . . 234
Instance attributes (Instance #1) . . . . . 234
Control supervisor object, class 29h . . . . . 235
Class attributes (Instance #0) . . . . . 235
Instance attributes (Instance #1) . . . . . 236
AC/DC-drive object, class 2Ah . . . . . 237
Class attributes (Instance #0) . . . . . 237
Instance attributes (Instance #1) . . . . . 238
Drive parameter object, class 90h . . . . . 239
Fieldbus configuration object, class 91h . . . . . 240
Class attributes . . . . . 240
Instance #1: FENA-01/-11/-21 configuration parameters group A (group 1). . . . . 240
Instance #2: FENA-01/-11/-21 configuration parameters group B (group 2). . . . . 244
Instance #3: FENA-01/-11/-21 configuration parameters

group C (group 3) . . . . . 246
Instance #10: SNTP configuration . . . . . 247
TCP/IP interface object, class F5h . . . . . 248
Class attributes (Instance #0) . . . . . 248
Attribute explanations . . . . . 250
Ethernet link object, class F6h . . . . . 252
Class attributes (Instance #0) . . . . . 252
Instance attributes (Instance #1) . . . . . 252
Connection object, class 05h . . . . . 253
Class attributes . . . . . 253
Instance attributes . . . . . 253
Acknowledge handler object, class 2Bh . . . . . 256
Class attributes (Instance #0) . . . . . 256
Instance attributes (Instance #1) . . . . . 256

### 13. EtherNet/IP – Diagnostics

Contents of this chapter . . . . . 257
Fault and warning messages . . . . . 257
LEDs . . . . . 258

## PROFINET IO protocol

### 14. PROFINET IO – Start-up

Contents of this chapter . . . . . 263
Warnings . . . . . 263
Drive configuration . . . . . 264
PROFINET IO connection configuration . . . . . 264
FENA-01/-11/-21 configuration parameters – group A (group 1) . . . . . 265
FENA-01/-11/-21 configuration parameters – group B (group 2) . . . . . 273
FENA-01/-11/-21 configuration parameters – group C (group 3) . . . . . 275
Virtual address area allocation with ACSM1 . . . . . 276
Control locations . . . . . 277
Starting up fieldbus communication for ACS355 drives . . . . . 278
Parameter setting examples – ACS355 . . . . . 279

Speed control using the PROFIdrive communication profile with PPO Type 4 . . . . . 279
Speed and torque control using the ABB Drives communication profile with PPO Type 4 . . . . . 281
Starting up fieldbus communication for ACSM1 drives . . . . . 284
Parameter setting examples – ACSM1 . . . . . 285
Speed control using the PROFIdrive communication profile with PPO Type 4 . . . . . 285
Position control using the PROFIdrive communication profile with PPO Type 4 . . . . . 287
Speed and torque control using the ABB Drives communication profile with PPO Type 4 . . . . . 291
Starting up fieldbus communication for ACS850 and ACQ810 drives . . . . . 294
Parameter setting examples – ACS850 and ACQ810 . . . . 295
Speed control using the PROFIdrive communication profile with PPO Type 4 . . . . . 295
Starting up fieldbus communication for ACS480, ACS580 and ACS880 drives . . . . . 298
Parameter setting examples – ACS480 and ACS580 . . . . 299
Frequency control using PROFIdrive communication profile with PPO Type 4 . . . . . 299
Parameter setting examples – ACS880 . . . . . 301
Speed control using PROFIdrive communication profile with PPO Type 4 . . . . . 301
Configuring the master station . . . . . 304
Downloading the GSD file . . . . . 304
Configuring an ABB AC500 PLC . . . . . 304
Configuring a Siemens SIMATIC S7 PLC . . . . . 310
Configuring a Siemens PLC with TIA14 . . . . . 319
Resetting PROFINET IO device to factory default via S7 . 327
Media Redundancy Protocol (MRP) . . . . . 329
Configuring Media Redundancy Protocol (MRP) with Siemens PLC . . . . . 330
Configuring a PLC with TIA Portal . . . . . 335
Shared device . . . . . 338

Example of shared device configuration for AC500 with Automation Builder . . . . . 338
Configuring drive control PLC. . . . . 338
Configuring safety PLC. . . . . 339
Example of shared device configuration for TIA . . . . . 340
Configuring drive control PLC. . . . . 340
Configuring safety PLC. . . . . 340

## *15. PROFINET IO – Communication profiles*

Contents of this chapter . . . . . 341
Communication profiles . . . . . 341
PROFIdrive communication profile . . . . . 343
Control word and Status word . . . . . 343
Control word contents. . . . . 343
Status word contents . . . . . 346
State machine for all operating modes. . . . . 349
State machine for the positioning mode . . . . . 350
References . . . . . 351
References in speed control mode. . . . . 351
References in positioning mode (ACSM1 only) . . . . . 351
Actual values . . . . . 352
Actual values in speed control mode . . . . . 352
Actual values in positioning mode (ACSM1 only). . . . . 352
ABB Drives communication profile . . . . . 353
Control word and Status word . . . . . 353
Control word contents. . . . . 353
Status word contents . . . . . 355
State machine. . . . . 357
References . . . . . 358
Scaling . . . . . 358
Actual values . . . . . 359
Scaling . . . . . 359

## *16. PROFINET IO – Communication protocol*

Contents of this chapter . . . . . 361
PROFINET IO . . . . . 361

PROFINET network settings . . . . . 363
PROFINET IO in FENA . . . . . 364
Cyclic message types . . . . . 366
PPO types . . . . . 366
Standard telegram (ST) types (DP-V1) . . . . . 367
Parameter handling using acyclic parameter access mechanism (DP-V1) . . . . . 367
Header and frame structures . . . . . 368
ErrorCode1 . . . . . 369
DP-V1 read/write request sequence . . . . . 370
Read and write blocks . . . . . 371
Data block . . . . . 372
Function blocks for sending DP-V1 messages (Siemens S7) . . . . . 378
Parameter data transfer examples . . . . . 379
Example 1a: Reading a drive parameter (array element) . . . . . 379
Example 1b: Reading 3 drive parameters (multi-parameter) . . . . . 381
Example 2a: Writing a drive parameter (one array element) . . . . . 383
Example 2b: Writing 2 drive parameters (multi-parameter) . . . . . 385
Example 3: Reading a PROFIdrive parameter . . . . . 387
Example 4: Configuring the process data written to the drive . . . . . 388
Example 5: Determining the source of the process data read from the drive . . . . . 390
Diagnostic and alarm mechanism . . . . . 391
Alarm mechanism . . . . . 392
Fault code mapping . . . . . 392
Fault buffer mechanism . . . . . 394

## *17. PROFINET IO – Diagnostics*

Contents of this chapter . . . . . 397
Fault and warning messages . . . . . 397

LEDs . . . . . 398

## NONE protocol selection

### 18. NONE – Start-up

Contents of this chapter . . . . . 403
Warnings . . . . . 403
Drive configuration . . . . . 404
Connection configuration using NONE protocol . . . . . 404
FENA-01/-11-/21 configuration parameters – group A (group 1). . . . . 405
Starting up fieldbus communication . . . . . 410

### 19. NONE - Diagnostics

Contents of this chapter . . . . . 411
Fault and warning messages . . . . . 411
LEDs . . . . . 412

### 20. Technical data

Contents of this chapter . . . . . 415
FENA-01/-11/-21 . . . . . 415
Ethernet link . . . . . 416
TCP and UDP service ports . . . . . 417

### 21. Appendix A – PROFIdrive parameters and I&M records of PROFINET IO

Contents of this chapter . . . . . 419
PROFIdrive parameters . . . . . 420
I&M records . . . . . 428
Call-REQ-PDU telegram for read/write access to I&M records . . . . . 428
Response structure for I&M0 (Read-only) . . . . . 429
Response structure for I&M1 (Read/Write) . . . . . 429
Response structure for I&M2 (Read/Write) . . . . . 430
Response structure for I&M3 (Read/Write) . . . . . 430
Response structure for I&M4 (Read/Write) . . . . . 430

## 22. Appendix B – ABB IP configuration tool for FENA

Contents of this chapter . . . . . 431
Installation . . . . . 431
Finding adapter modules in the network . . . . . 432
Rewriting the IP configuration of adapter modules . . . . . 433

## 23. Appendix C – FENA configuration web pages

Contents of this chapter . . . . . 435
Browser requirements . . . . . 435
Compatibility . . . . . 435
Logging in . . . . . 436
Menu overview . . . . . 438
Status page . . . . . 439
Configuration page . . . . . 440
Changing the PROFINET IO station name via web page . 442
Service configuration page . . . . . 444
Configuring SNTP . . . . . 446
Support page . . . . . 447
Password page . . . . . 448
Reset FENA web page password to default . . . . . 449
Enable web page access after it was disabled . . . . . 450

## 24. Appendix D – FENA configuration backup

Contents of this chapter . . . . . 451
Settings for backup . . . . . 452
Configuration backup for all protocols in FENA-11/-21 . . . 452
Configuration backup for PROFINET IO . . . . . 453
Using the restored backup . . . . . 454
. . . . . 456

## Further information

1

# Safety instructions

## Contents of this chapter

The chapter contains the warning symbols used in this manual and the safety instructions which you must obey when you install or connect an optional module to a drive, converter or inverter. If you ignore the safety instructions, injury, death or damage can occur. Read this chapter before you start the installation.



## Use of warnings

Warnings tell you about conditions which can cause injury or death, or damage to the equipment. They also tell you how to prevent the danger. The manual uses these warning symbols:



**Electricity warning** tells you about hazards from electricity which can cause injury or death, or damage to the equipment.



**General warning** tells you about conditions, other than those caused by electricity, which can cause injury or death, or damage to the equipment.



## Safety in installation

These instructions are for all who install or connect an optional module to a drive, converter or inverter and need to open its front cover or door to do the work.



**WARNING!** Obey these instructions. If you ignore them, injury or death, or damage to the equipment can occur.

- If you are not a qualified electrician, do not do installation or maintenance work.
- Disconnect the drive, converter or inverter from all possible power sources. After you have disconnected the drive, converter or inverter, always wait for 5 minutes to let the intermediate circuit capacitors discharge before you continue.
- Disconnect all dangerous voltages connected to other control signal connectors in reach. For example, it is possible that 230 V AC is connected from outside to a relay output of the drive, converter or inverter.
- Always use a multimeter to make sure that there are no parts under voltage in reach. The impedance of the multimeter must be at least 1 Mohm.



2

# Introduction to the manual

## Contents of this chapter

This chapter introduces this manual.

## Purpose of the manual

The manual provides information on installing, commissioning and using the FENA-01/-11/-21 Ethernet adapter module.

## Applicability

This manual applies to the FENA-01/-11/-21 Ethernet adapter module, software version 3.20 and later.

## Compatibility

The FENA-01/-11/-21 Ethernet adapter module is compatible with different ABB drives and solar inverters.

**Note**: Later in this manual, the term drive is used to refer converters and inverters as well.

## Drives

The table below shows the compatibility of FENA adapter module with different ABB drives.

| Drives | FENA-01 | FENA-11 | FENA-21 |
|---|---|---|---|
| ACS355 | x | x | x |
| ACS380 | | x | x |
| ACSM1 | | x | x |
| ACS480 | | x | x |
| ACH580 | | x | x |
| ACQ580 | | x | x |
| ACS530*) | | x | x |
| ACS560*) | | x | x |
| ACS580 | | x | x |
| ACS850 | | x | x |
| ACS860*) | | x | x |
| ACQ810 | | x | x |
| ACS880 | | x | x |
| ACS880-M04 | | x | x |

*) check the compatibility in drive's release note

## Protocols

The FENA adapter module is compatible with Ethernet standards IEEE 802.3 and IEEE 802.3u.

This table shows the protocols supported by the FENA adapter module from SW version 3.11 onwards.

| | Modbus/TCP[1)] | EtherNet/IP™ | PROFINET IO |
|---|---|---|---|
| FENA-01 | x | x | x |
| FENA-11 | x | x | x |
| FENA-21 | x | x | x |

[1] In addition to Modbus/TCP, FENA-01/-11/-21 supports Modbus over UDP.

[2] In addition to these protocol, it is possible to have the no communication protocol running on FENA adapter module. This configuration is called NONE protocol. In this setup, FENA adapter module is used only for running Ethernet services which can be enabled/disabled via Web pages. See *Appendix C – FENA configuration web pages* on page *435*. Also SNTP is available with NONE protocol).

The below table specifies the clients/masters that are compatible with the supported protocols.

| Protocol | Compatible client/master |
|---|---|
| Modbus/TCP[1] | All Modbus/TCP clients that support:<br>• Modbus Application Protocol Specification v1.1b<br>• Modbus Messaging on TCP/IP Implementation Guide v1.0b |
| EtherNet/IP | All EtherNet/IP clients that support:<br>• The CIP Networks Library, Volume 1, Common Industrial Protocol (CIP), Edition 3.0 May, 2006<br>• The CIP Networks Library, Volume 2, EtherNet/IP Adaptation of CIP, Edition 1.2 May, 2006<br>• Recommended Functionality for EtherNet/IP Devices Version 1.2, Feb., 2006 |
| PROFINET IO | All PROFINET IO masters that support:<br>• GSDML file version 2.31<br>• PROFINET IO protocol according IEC standards 61158 and 61784<br>• PROFINET-IO conformance class B |

## Tools

The FENA-11/-21 adapter module can be used in the Ethernet tool network for ACS880. The Ethernet tool network enables commissioning and monitoring several single drives, or inverter and supply units of a multi-drive from a single location by using the Drive composer pro PC tool.

**Note:** When the FENA-11/-21 adapter module is used only in the Ethernet tool network, the recommended setting for parameters

**50.21 FBA A timelevel sel** and **50.51 FBA B timelevel sel** is *Slow* or *Monitoring*.

For more information on the Ethernet tool network, see:

- *Ethernet tool network for ACS880 drives application guide* (3AUA0000125635) [English])
- *Drive composer user's manual* (3AUA0000094606 [English]).

## Target audience

This manual is intended for people who plan the installation, install, start up, use and service the adapter module. Before you do work on the module, read this manual and the applicable drive manual that contains the hardware and safety instructions for the product in question.

You are expected to know the fundamentals of electricity, wiring, electrical components and electrical schematic symbols.

The manual is written for readers worldwide. Both SI and imperial units are shown.

## Related manuals

| Drive manuals and guides | Code (EN/Multilingual) |
|---|---|
| *ACS355 drives (0.37…22 kW, 0.5…30 hp) user's manual* | *3AUA0000066143* |
| *ACSM1 manuals* | *00578051* |
| *ACS380-04 manuals* | *9AAK10103A6193* |
| *ACS480 manuals* | *9AKK106930A8739* |
| *ACH580-01 manuals* | *9AKK10103A0587* |
| *ACH580-04 manuals* | *9AKK106930A9059* |
| *ACH580-07 manuals* | *9AKK106930A5241* |
| *ACH580-31 manuals* | |
| *ACQ580-01 manuals* | *9AKK106713A2709* |
| *ACQ580-04 manuals* | *9AKK106930A9053* |
| *ACQ580-07 manuals* | *9AKK106930A3150* |
| *ACQ580-31 manuals* | |
| *ACS580-01 manuals* | *9AKK105713A8085* |
| *ACS580-04 manuals* | *9AKK106930A9060* |
| *ACS580-07 (75 to 250 kW) manuals* | *9AKK106930A5239* |
| *ACS580-07 (250 to 500 kW)* | *9AKK106713A0278* |
| *ACS850-04 manuals* | *00592009* |
| *ACS880-01 manuals* | *9AKK105408A7004* |
| *ACS880-04 manuals* | *9AKK105713A4819* |
| *ACS880-07 manuals* | *9AKK105408A8149* |
| *ACS880-07 (560 to 2800 kW)* | *9AKK105713A6663* |
| *ACS880-17 (132 to 355 kW)* | *9AKK106930A3466* |
| *ACS880-17 (160 to 3200 kW)* | *9AKK106354A1499* |
| *ACS880-11 manuals* | |
| *ACS880-31 manuals* | |
| *ACS880-37 (132 to 355 kW)* | *9AKK106930A3467* |
| *ACS880-37 (160 to 3200 kW)* | *9AKK106354A1500* |
| *ACS880-M04 manuals* | *9AKK106930A7550* |
| *ACQ810 manuals* | *00598718* |
| **Option manuals and guides** | |
| *FENA-01/-11/-21 Ethernet adapter module user's manual* | *3AUA0000093568* |

## Contents

The manual consists of the following chapters:

- *Safety instructions* gives the safety instructions which you must obey when you install a fieldbus adapter module.
- *Overview of the Ethernet network and the FENA-01/-11/-21 module* contains a short description of the Ethernet network and the adapter module.
- *Mechanical installation* contains a delivery checklist and instructions on installing the adapter module.
- *Electrical installation* contains instructions on cabling and connecting the adapter module to the Ethernet network.
- *Technical data* contains the technical data of the adapter module and the Ethernet link.
- *Appendix A – PROFIdrive parameters and I&M records of PROFINET IO* contains the PROFIdrive profile parameters and telegram and response structures for the I&M records of the PROFINET IO protocol.
- *Appendix B – ABB IP configuration tool for FENA* shows how to use the APP IP configuration tool for FENA.
- *Appendix C – FENA configuration web pages* presents the FENA configuration web pages.
- *Appendix D – FENA configuration backup* presents the FENA configuration backup.

**Modbus/TCP protocol**

- *Modbus/TCP – Start-up* presents the steps to take during the start-up of the drive with the adapter module and gives information on configuring the Modbus/TCP client.
- *Modbus/TCP – Communication profiles* describes the communication profiles used in the communication between the client, the adapter module and the drive.
- *Modbus/TCP – Communication protocol* describes the Modbus/TCP communication protocol for the adapter module.
- *Modbus/TCP – Diagnostics* explains how to trace faults with the status LEDs on the adapter module.

**EtherNet/IP protocol**

- *EtherNet/IP – Start-up* presents the steps to take during the start-up of the drive with the adapter module and gives examples of configuring the EtherNet/IP client.
- *EtherNet/IP – Communication profiles* describes the communication profiles used in the communication between the client, the adapter module and the drive.
- *EtherNet/IP – Communication protocol* describes the EtherNet/IP communication protocol for the adapter module.
- *EtherNet/IP – Diagnostics* explains how to trace faults with the status LEDs on the adapter module.

**PROFINET IO protocol**

- *PROFINET IO – Start-up* presents the steps to take during the start-up of the drive with the adapter module and gives examples of configuring the PROFINET master.
- *PROFINET IO – Communication profiles* describes the communication profiles used in the communication between the master, the adapter module and the drive.
- *PROFINET IO – Communication protocol* describes the PROFINET IO communication protocol for the adapter module.
- *PROFINET IO – Diagnostics* explains how to trace faults with the status LEDs on the adapter module.

**NONE protocol selection**

- *NONE – Start-up* presents the steps to take during the start-up of the drive with the adapter module and gives examples of configuring the NONE protocol.
- *NONE - Diagnostics* explains how to trace faults with the status LEDs on the adapter module.

## Cybersecurity disclaimer

This product is designed to be connected to and to communicate information and data via a network interface. It is Customer's sole responsibility to provide and continuously ensure a secure connection between the product and Customer network or any other network (as the case may be). Customer shall establish and maintain any appropriate measures (such as but not limited to the installation of firewalls, application of authentication measures, encryption of data, installation of anti-virus programs, etc.) to protect the product, the network, its system and the interface against any kind of security breaches, unauthorized access, interference, intrusion, leakage and/or theft of data or information. ABB and its affiliates are not liable for damages and/or losses related to such security breaches, any unauthorized access, interference, intrusion, leakage and/or theft of data or information.

**Note**: The web pages are meant only for configuring the device during commissioning. For security reasons, it is recommended to disable the web pages after commissioning.

# Terms and abbreviations

## General terms

| Term | Definition |
|---|---|
| Command word | See Control word. |
| Control word | 16-bit or 32-bit word from master to slave with bit-coded control signals (sometimes called the Command word). |
| Drive | Frequency converter for controlling AC motors. The drive consists of a rectifier and an inverter connected together by the DC link. In drives up to approximately 500 kW, these are integrated into a single module (drive module). Larger drives typically consist of separate supply and inverter units.<br>This manual uses the term drive to refer converters and inverter as well. |
| FENA-01/-11/-21 Ethernet adapter module | One of the optional fieldbus adapter modules available for ABB drives. FENA-01/-11/-21 is a device through which an ABB drive is connected to an Ethernet network. |
| Fieldbus adapter module | Device through which the drive is connected to an external communication network, that is, a fieldbus. The communication with the module is activated with a drive parameter. |
| MAC address | Media Access Control address.<br>A unique factory-programmed identifier used to address a node in an Ethernet network. |
| Profile | Adaptation of the protocol for certain application field, for example, drives.<br>In this manual, drive-internal profiles (eg, DCU or FBA) are called native profiles. |
| Status word | 16-bit or 32-bit word from slave to master with bit-coded status messages. |

## Abbreviations

| Abbreviation | Explanation |
|---|---|
| DHCP | Dynamic Host Control Protocol. A protocol for automating the configuration of IP devices. DHCP can be used to automatically assign IP addresses and related network information. |
| EMC | Electromagnetic compatibility |
| FBA | Fieldbus adapter |
| LSB | Least significant bit |
| MSB | Most significant bit |
| PLC | Programmable logic controller |
| SNTP | Simple Network Time Protocol. A protocol to synchronize drive time with the network time server. |
| SNMP | Simple Network Management Protocol. |

## Modbus/TCP terms and abbreviations

| Term | Explanation |
|---|---|
| Exception code | If an error related to the requested Modbus function occurs, the data field contains an exception code that the server application can use to determine the next action to be taken. |
| Function code | The second byte sent by the client. The function tells the server what kind of action to perform. |
| Holding register | Holds data that will be later executed by an application program. |

## EtherNet/IP terms and abbreviations

| Term | Explanation |
|---|---|
| DLR | Device Level Ring.<br>DLR network is a single-fault tolerant ring network topology intended for interconnection of automation devices. FENA-21 supports DLR. |
| EDS file | The Electronic Data Sheet (EDS) file identifies the properties of the device to the EtherNet/IP client. Each type of drive and application program requires its own EDS file. |
| Input | In the ODVA EtherNet/IP specification the word 'input' is used to describe data flow from a device (such as the adapter module) to the network. |
| I/O Assembly selection | Smart networked devices (like FENA) can produce and/or consume more than one I/O value. Typically, they will produce and/or consume one or more I/O value, as well as status and diagnostic information. Each piece of data communicated by a device is represented by an attribute of one of the device's internal objects.<br>Communicating multiple pieces of data (attributes) across a single I/O connection requires that the attributes be grouped or assembled together into a single block. |
| ODVA™ | ODVA stands for Open DeviceNet Vendor Association. ODVA is an independent organization that promotes interoperability between different manufacturers' EtherNet/IP products. ABB is an Associate Member at ODVA. |
| Output | In the ODVA EtherNet/IP specification the word 'output' is used to describe data flow from the network into a device (such as the adapter module). |

## PROFINET IO terms and abbreviations

| Term | Explanation |
|---|---|
| Acyclic communication | Communication in which messages are sent only once on request |
| Array | Parameter consisting of data fields of equal data type |
| Cyclic communication | Communication in which parameter/process data objects are sent cyclically at pre-defined intervals |
| DCP | Discovery Control Protocol. A protocol that allows the master controller to find every PROFINET IO device on a subnet. |
| Fault | Event that leads to tripping of the device |
| GSD file | ASCII-format device description file in a specified form. Each different slave type on the PROFINET IO network needs to have its own GSD file. GSD files in PROFINET IO are written in GSDML. |
| Index | Access reference for objects in PROFINET IO |
| I/O controller | Control system with bus initiative. In PROFINET IO terminology, I/O controllers are also called master stations. |
| Master | Control system with bus initiative. In PROFINET IO terminology, master stations are also called active stations. |
| Name | Symbolic name of a parameter |
| Parameter | Value that can be accessed as an object, eg, variable, constant, signal |
| Parameter number | Parameter address |
| Parameter/Process | Special object that contains parameter and process |
| Data object | Special object that contains parameter and process data |
| Process data | Data that contains Control word and reference value or Status word and actual value. May also contain other (user-definable) control information. |

| Term | Explanation |
|---|---|
| Slave | Passive bus participant. In PROFINET IO terminology, slave stations (or slaves) are also called passive stations. Also referred to as node. |
| Warning | Signal caused by an existing alarm which does not lead to tripping of the device |

The text in *italics* is the original German term.

| Abbreviation | Explanation |
|---|---|
| ACT | Actual value<br>*Istwert* |
| DAP | Device access point |
| DP | Decentralised Periphery<br>*Dezentrale Peripherie* |
| DP-V0 | PROFINET IO extension to the EN 50170 standard, providing the basic functionality of DP, including cyclic data exchange |
| DP-V1 | PROFINET IO extension to the EN 50170 standard, including, eg, acyclic data exchange |
| GSDML | General Station Description Markup Language |
| ISW | See ACT. |
| MAP | Module access point |
| MRC | Media Redundancy Client |
| MRM | Media Redundancy Manager |
| MRP | Media Redundancy Protocol |
| PAP | Parameter access point |
| PD | Process data<br>*Prozessdaten* |
| PKE | Parameter identification<br>*Parameter-Kennung* |
| PKW | Parameter identification value<br>*Parameter-Kennung-Wert* |

| Abbreviation | Explanation |
|---|---|
| PNU | Parameter number<br>*Parameternummer* |
| PPO | Parameter/Process data object<br>*Parameter-/Prozessdaten-Objekt* |
| PWE | Parameter value<br>*Parameter-Wert* |
| PZD | See PD. |
| PZDO | Process data object<br>*Prozessdatenobjekt* |
| SAP | Service access point |
| SOW | Reference<br>*Sollwert* |
| STW | Control word<br>*Steuerwort* |
| ZSW | Status word<br>*Zustandswort* |

3

# Overview of the Ethernet network and the FENA-01/-11/-21 module

## Contents of this chapter

This chapter contains a short description of the Ethernet network and the FENA adapter module.

## Ethernet network

Ethernet standards support a variety of physical media (coaxial cable, twisted pair, fiber optics) and topologies (bus and star). The FENA-01/-11/-21 adapter module supports twisted pair as the physical media in a star topology. In addition, FENA-21 supports a daisy chain topology with all protocols and DLR with EtherNet/IP and Media Redundancy Protocol (MRP) with PROFINET IO protocol.

The maximum length for an Ethernet segment on twisted pair media is 100 meters. All twisted pair media between the Ethernet node and the switch or router must be shorter than 100 meters, including media within patch panels. For more information, see chapter *Technical data*.

## Example topology of the Ethernet link

This figure shows an example of an allowable topology for an Ethernet network with FENA-01/-11/-21.

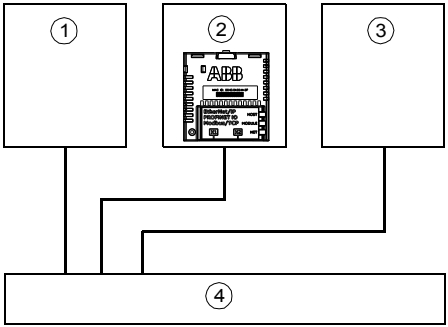


| No. | Description |
|---|---|
| 1 | Other slave device |
| 2 | ABB drive |
| 3 | Other slave device |
| 4 | Switch or router |

This figure shows an example of an allowable topology for an Ethernet network with FENA-21.

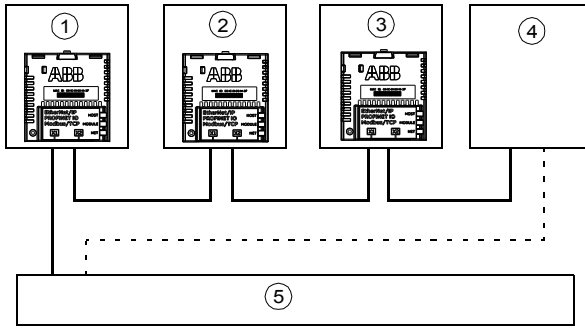


| No. | Description |
|---|---|
| 1...3 | ABB drive |
| 4 | Other slave device |
| 5 | Network master device |

## FENA-01/-11/-21 Ethernet adapter module

The FENA-01/-11/-21 Ethernet adapter module is an optional device for ABB drives which enables the connection of the drive to an Ethernet network.

Through the adapter module you can:

- give control commands to the drive (for example, Start, Stop, Run enable)
- feed a motor speed or torque reference to the drive
- give a process actual value or a process reference to the PID controller of the drive
- read status information and actual values from the drive
- reset a drive fault.

The protocols used to access these functionalities over Ethernet are described in chapters:

- *Modbus/TCP – Communication protocol*
- *EtherNet/IP – Communication protocol*
- *PROFINET IO – Communication protocol*.

The adapter module supports 10 Mbit/s and 100 Mbit/s data transfer rates and automatically detects the data transfer rate used in the network.

**Note:** PROFINET IO uses only 100 Mbit/s in the Full duplex mode.

The adapter module is installed into an option slot on the drive control unit. See the drive manuals for module placement options.

## Layout of the adapter module

This figure shows the layout of FENA-01/-11.

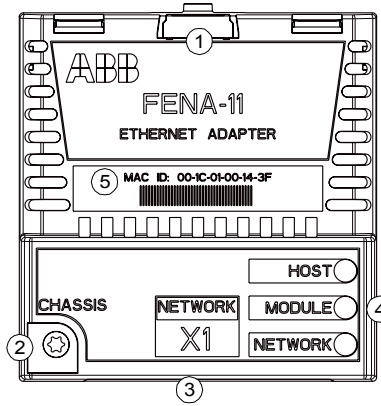


| No. | Description | See chapter |
|---|---|---|
| 1 | Lock | *Mechanical installation* |
| 2 | Mounting and grounding screw | *Mechanical installation* |
| 3 | Connector X1 to Ethernet | *Electrical installation* |
| 4 | Diagnostic LEDs | *Modbus/TCP – Diagnostics*<br>*EtherNet/IP – Diagnostics*<br>*PROFINET IO – Diagnostics*<br>*NONE - Diagnostics* |
| 5 | MAC address | - |

This figure shows the layout of FENA-21.

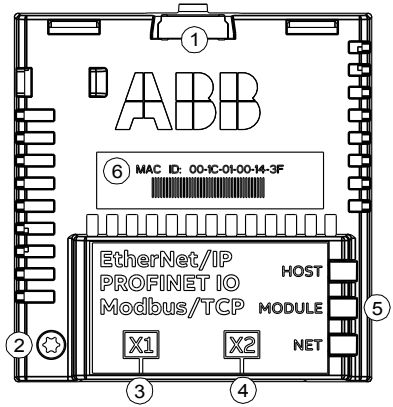


| No. | Description | See chapter |
|---|---|---|
| 1 | Lock | *Mechanical installation* |
| 2 | Mounting screw | *Mechanical installation* |
| 3 | RJ-45 connector [X1] to Ethernet | *Electrical installation* |
| 4 | RJ-45 connector [X2] for chaining another module | *Electrical installation* |
| 5 | Diagnostic LEDs | *Modbus/TCP – Diagnostics*<br>*EtherNet/IP – Diagnostics*<br>*PROFINET IO – Diagnostics*<br>*NONE - Diagnostics* |
| 6 | MAC address | - |

# 4

# Mechanical installation

## Contents of this chapter

This chapter contains a delivery checklist and instructions to install the adapter module.

## Necessary tools and instructions

You will need a Torx TX10 screwdriver to secure the FENA adapter module to the drive. See also, the applicable drive hardware manual.



## Unpacking and examining the delivery

1. Open the option package.
2. Make sure that the package contains:
   - Ethernet adapter module, type FENA-01/-11/-21
   - this manual.
3. Make sure that there are no signs of damage.

## Installing the adapter module

**WARNING!** Obey the safety instructions. See chapter *Safety instructions* on page *19*. If you ignore the safety instructions, injury or death can occur.

The adapter module has a specific position in the drive. Plastic pins, a lock and one screw to hold the adapter module in place. The screw also makes an electrical connection between the module and drive frame for cable shield termination.

When the adapter module is installed, it makes the signal and power connection to the drive through a 20-pin connector.

When you install or remove the adapter module from the control unit:

1. Pull out the lock.

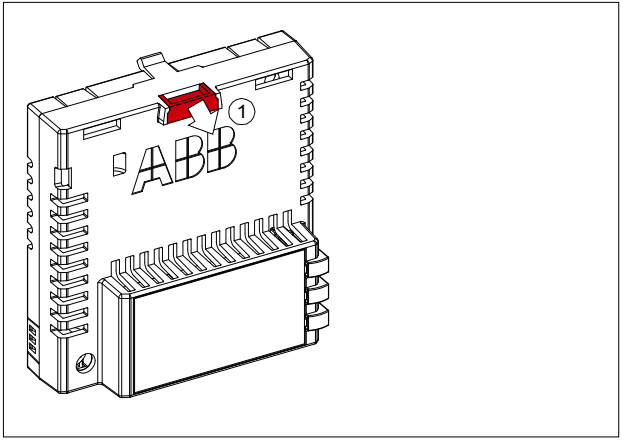

2. Put the adapter module carefully into its position on the drive.
3. Push in the lock.

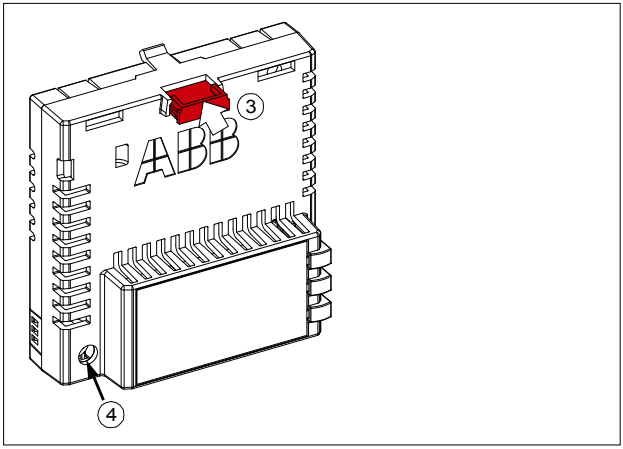


4. Tighten the screw to torque 0.8 N·m using a Torx TX10 screwdriver.

---

**WARNING!** Do not use excessive force, or leave the screw too loose. Over-tightening can damage the screw or module. A loose screw decreases the EMC performance, and can even cause an operation failure.

---

See the applicable drive manual for further instructions on how to install the adapter module to the drive.



5

# Electrical installation

## Contents of this chapter

This chapter contains:
- general cabling instructions
- instructions on connecting the adapter module to the Ethernet network.

## Warnings



**WARNING!** Obey the safety instructions. See chapter *Safety instructions* on page *19*. If you ignore the safety instructions, injury or death can occur. If you are not a qualified electrician, do not do electrical work.

## Necessary tools and instructions

See the applicable drive hardware manual.

## General cabling instructions

- Arrange the bus cables as far away from the motor cables as possible.
- Avoid parallel runs.
- Use bushings at cable entries.

## Connecting the adapter module to the Ethernet network

The network cable can be CAT5 or higher, and type UTP, FTP or STP.

When CAT5 FTP or STP is used, the cable shield is connected to the drive frame through an RC network. In FENA-01, it is possible to change this connection by using jumper J1 located next to the X1 connector.

- Position 1-2 connects the cable shield directly to the drive frame.
- Position 2-3 connects the cable shield to the drive frame through an RC network. This is the default setting of the jumper.

The figure below shows the location of jumper pin 1 on the FENA-01 adapter module.

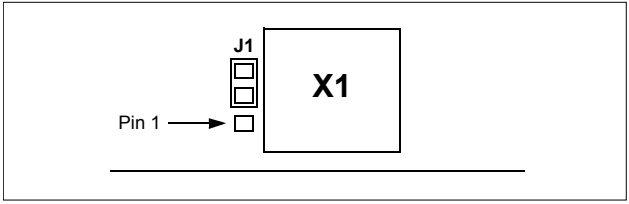

## Connection procedure

1. Connect the network cable to the RJ-45 connector (X1) on the adapter module.
2. If you want to create a daisy chain with FENA-21 adapter modules, connect the X2 connector of the first adapter module to X1 on the next adapter module, and so on.

**Note**: If a device in the daisy chain is powered off or fails, the rest of the chain is disconnected from the network. In applications where this is not acceptable, consider using the ring topology instead.



# Modbus/TCP protocol

*Modbus/TCP – Start-up* . . . . . *53*
*Modbus/TCP – Communication profiles* . . . . . *89*
*Modbus/TCP – Communication protocol* . . . . . *99*
*Modbus/TCP – Diagnostics* . . . . . *111*

M

6

# Modbus/TCP – Start-up

## Contents of this chapter

This chapter contains:

- information on configuring the drive for operation with the adapter module
- drive-specific instructions on starting up the drive with the adapter module
- information on configuring the client for communication with the adapter module.

## Warnings

**WARNING!** Obey the safety instructions given in this manual and the drive documentation.

# Drive configuration

The information in this section applies to all drive types compatible with the adapter module, unless otherwise stated.

## Modbus/TCP connection configuration

After the adapter module has been mechanically and electrically installed according to the instructions in chapters *Mechanical installation* and *Electrical installation*, you must prepare the drive for communication with the module.

The detailed procedure of activating the module for Modbus/TCP communication with the drive depends on the drive type. Normally, you must adjust a parameter to activate the communication. See the drive-specific start-up sections starting on page *67*.

Once communication between the drive and the adapter module is established, several configuration parameters are copied to the drive. These parameters are shown in the tables below and must be checked first and adjusted where necessary. You can adjust the parameters via a drive control panel, a PC tool or a web user interface. For more information on the web user interface, see *Appendix C – FENA configuration web pages*.

**Note:**

- Not all drives display descriptive names for the configuration parameters.
- The new parameter settings take effect only when you power up the module the next time or when you activate the fieldbus adapter refresh parameter.

## FENA-01/-11-/21 configuration parameters – group A (group 1)

**Note:** The actual parameter group number depends on the drive type. Group A (group 1) corresponds to:

- parameter group 51 in ACS355, ACS380, ACSM1, ACS480, ACS580, ACS850 and ACQ810.
- parameter group is typically 51/54 (group 151/154 in some variants) in ACS880 and ACS880-M04 if the adapter is installed as fieldbus adapter A/B.

| No. | Name/Value | Description | Default |
|---|---|---|---|
| 01 | FBA type | **Read-only.** Shows the fieldbus adapter type as detected by the drive. The value cannot be adjusted by the user.<br>If the value is **0** = None, the communication between the drive and the module has not been established. | **128** = ETHER-NET |
| 02 | Protocol/Profile | Selects the application protocol and communication profile for the network connection.<br>The selections available for Modbus communication are listed below. | **0** = MB/TCP ABB C |
| | **0** = MB/TCP ABB C | Modbus/TCP: ABB Drives profile - Classic | |
| | **1** = MB/TCP ABB E | Modbus/TCP: ABB Drives profile - Enhanced | |
| | **2** = MB/TCP T16 | Modbus/TCP: Transparent 16-bit profile | |
| | **3** = MB/TCP T32 | Modbus/TCP: Transparent 32-bit profile | |
| | **4** = MB/UDP ABB C | Modbus over UDP: ABB Drives profile - Classic | |
| | **5** = MB/UDP ABB E | Modbus over UDP: ABB Drives profile - Enhanced | |
| | **6** = MB/UDP T16 | Modbus over UDP: Transparent 16-bit profile | |
| | **7** = MB/UDP T32 | Modbus over UDP: Transparent 32-bit profile | |
| 03 | Commrate | Sets the bit rate for the Ethernet interface. | **0** = Auto |
| | **0** = Auto | Auto-negotiate | |
| | **1** = 100 Mbps FD | 100 Mbps, full duplex | |
| | **2** = 100 Mbps HD | 100 Mbps, half duplex | |
| | **3** = 10 Mbps FD | 10 Mbps, full duplex | |
| | **4** = 10 Mbps HD | 10 Mbps, half duplex | |

| No. | Name/Value | Description | Default |
|---|---|---|---|
| 04 | IP configuration | Sets the method for configuring the IP address, subnet mask and gateway address for the module. | **1** = Dyn IP DHCP |
| | **0** = Static IP | Configuration will be obtained from parameters *05*…*13*. | |
| | **1** = Dyn IP DHCP | Configuration will be obtained via DHCP. | |
| 05 | IP address 1 | An IP address is assigned to each IP node on a network. An IP address is a 32-bit number that is typically represented in “dotted decimal” notation consisting of four decimal integers, on the range 0…255, separated by periods. Each integer represents the value of one octet (8-bits) in the IP address. Parameters *05...08* define the four octets of the IP address. | 0 |
| | 0…255 | IP address | |
| … | … | … | … |
| 08 | IP address 4 | See parameter *05 IP address 1*. | 0 |
| | 0…255 | IP address | |

| No. | Name/Value | Description | Default |
|---|---|---|---|
| 09 | Subnet CIDR | Subnet masks are used for splitting networks into smaller networks called subnets. A subnet mask is a 32-bit binary number that splits the IP address into a network address and host address.<br>Subnet masks are typically represented in either dotted decimal notation or the more compact CIDR notation, as shown in the table below. | 0 |

| Dotted decimal | CIDR | Dotted decimal | CIDR |
|---|---|---|---|
| 255.255.255.254 | 31 | 255.254.0.0 | 15 |
| 255.255.255.252 | 30 | 255.252.0.0 | 14 |
| 255.255.255.248 | 29 | 255.248.0.0 | 13 |
| 255.255.255.240 | 28 | 255.240.0.0 | 12 |
| 255.255.255.224 | 27 | 255.224.0.0 | 11 |
| 255.255.255.192 | 26 | 255.224.0.0 | 10 |
| 255.255.255.128 | 25 | 255.128.0.0 | 9 |
| 255.255.255.0 | 24 | 255.0.0.0 | 8 |
| 255.255.254.0 | 23 | 254.0.0.0 | 7 |
| 255.255.252.0 | 22 | 252.0.0.0 | 6 |
| 255.255.248.0 | 21 | 248.0.0.0 | 5 |
| 255.255.240.0 | 20 | 240.0.0.0 | 4 |
| 255.255.224.0 | 19 | 224.0.0.0 | 3 |
| 255.255.192.0 | 18 | 192.0.0.0 | 2 |
| 255.255.128.0 | 17 | 128.0.0.0 | 1 |
| 255.255.0.0 | 16 | | |

| | | | |
|---|---|---|---|
| | 1…31 | Subnet mask in CIDR notation | |
| 10 | GW address 1 | IP gateways connect individual physical IP subnets into a unified IP network. When an IP node needs to communicate with an IP node on another subnet, the IP node sends the data to the IP gateway for forwarding. Parameters *10*…*13* define the four octets of the gateway address. | 0 |
| | 0…255 | GW address | |
| … | … | … | … |
| 13 | GW address 4 | See parameter *10 GW address 1*. | 0 |
| | 0…255 | GW address | |

| No. | Name/Value | Description | Default |
|---|---|---|---|
| 14 | Commrate port 2 | Sets the bit rate for the Ethernet port 2. This parameter is used only with FENA-21. | **0** = Auto |
| | **0** = Auto | Auto-negotiate | |
| | **1** = 100 Mbps FD | 100 Mbps, full duplex | |
| | **2** = 100 Mbps HD | 100 Mbps, half duplex | |
| | **3** = 10 Mbps FD | 10 Mbps, full duplex | |
| | **4** = 10 Mbps HD | 10 Mbps, half duplex | |
| 15 … 18 | Reserved | These parameters are not used by the adapter module when the module is configured for Modbus/TCP. | N/A |
| 19 | T16 scale | Defines the reference multiplier/actual value divisor for the adapter module.<br>**Note**: The parameter is effective only when the following conditions are satisfied:<br>• transparent 16 profile is selected<br>• drive is using the native communication profile (e.g, DCU or FBA)<br>• drive is using a 16-bit transparent reference 1/actual value 1.<br>Reference 1 is multiplied by the value of this plus one and the actual value 1 is divided by the value of this plus one. With value 0, the reference 1/actual value 1 scale in the adapter module is 1 = 1.<br><br>With an ACS355 drive: For example, if the parameter has a value 99 and the reference of 1000 is given by the master, the reference is multiplied by 100 (i.e. 99 + 1) and forwarded to the drive as 100000.<br>According to the DCU profile, speed scale is 1000 = 1 rpm. This value is interpreted as a reference of 100 rpm in the drive.<br>With ACSM1, ACS850 and ACQ810, the DCU profile speed scale is approximately 65535 = 1 rpm.<br>With ACS380, ACS580 and ACS880: Generic reference type:<br>*1 = (T16 scale + 1)/100 -> T16 scale = 99, 1 = 1.* | 99 |
| | 0…65535 | Reference multiplier/actual value divisor | |

| No. | Name/Value | Description | Default |
|---|---|---|---|
| 20 | Timeout time | Defines the Modbus/TCP timeout value. The Modbus protocol does not specify a timeout mechanism for the application layer. A timeout mechanism may be desired when controlling a drive, so the adapter module provides a method for this purpose.<br>• If the parameter value is zero, this feature is disabled.<br>• If the parameter value is non-zero, the timeout is:<br>(Modbus/TCP timeout value) * 100 milliseconds<br>For example, a value of 22 results in a timeout of:<br>22 * 100 milliseconds = 2.2 seconds<br>If a timeout occurs, the adapter module signals the drive that communication with the client has been lost. The drive configuration then determines how to respond.<br>**Example:** If the Modbus/TCP timeout is 300 ms and the drive is configured to fault on a communication failure with a delay of 500 ms, the drive will fault 800 ms after communications is lost. | 20 |
| | 0…65535 | Modbus/TCP timeout value | |
| 21 | Timeout mode | Selects which Modbus/TCP register accesses reset the timeout counter. | **2** = Control WR |
| | **0** = None | The Modbus/TCP timeout feature is disabled. | |
| | **1** = Any message | The timeout counter is reset when any Modbus register of the drive is accessed. | |
| | **2** = Control RW | The timeout counter is reset when the drive receives either a new Control word or new reference value (REF1 or REF2) from the Modbus/TCP client. | |
| 22 | Word order | Selects in which order the 16-bit registers of 32-bit parameters are transferred. For each register (16-bit), the first byte contains the high order byte and the second byte contains the low order byte. | **1** = HILO |
| | **0** = LoHi | The first register contains the low order word and the second register contains the high order word. | |

| No. | Name/Value | Description | Default |
|---|---|---|---|
| | **1** = HiLo | The first register contains the high order word and the second register contains the low order word. | |
| 23 | Address mode | Defines the mapping between parameters and holding registers in the 0...65535 Modbus register range. | **0** = Mode 0 |
| | **0** = Mode 0 | Used when access to parameter indexes greater than 99 is not needed.<br>Allows 5-digit addressing[1] used by legacy Modbus masters.<br>Mode is backward compatibility with old firmware versions of FENA-xx and with, for example, ACx550.<br>16-bit access:[1]<br>Register address[2] = 100 * parameter group + parameter index (16-bit values, groups 1...199, indexes 1...99)<br>32-bit access:<br>Register address = 20000 + 200 * parameter group + 2 * parameter index (32-bit values, groups 1...199, indexes 1...99) | |
| | **1** = Mode 1 | 16-bit access:<br>Register address = 256 * parameter group + parameter index<br>(16-bit values, groups 1...255, indexes 1...255)<br>Example: 13057 (0x3301) is group 51 index 1<br>No access to 32-bit parameter values. | |
| | **2** = Mode 2 | 32-bit access:<br>Register address = 512 * parameter group + 2 * parameter index<br>(32-bit values, groups 1...127, indexes 1...255).<br>Example: 26114 (0x6602) is group 51 index 1<br>Used when 32-bit parameter values are needed and there is no need to access groups 128 or higher. | |
| | **3** = Mode 3 | 32-bit access:<br>Register address = 256 * parameter group + 2 * parameter index<br>(32-bit values, groups 1...255, indexes 1...127).<br>Example: 13058 (0x3302) is group 51 index 1<br>Used when 32-bit parameter values are needed and there is no need to access parameter index 128 or higher. | |

| No. | Name/Value | Description | Default |
|---|---|---|---|
| 24<br>…<br>26 | Reserved for web page functionality. For more information, see *Appendix C – FENA configuration web pages*. | These parameters are not used by the adapter module when the module is configured for Modbus/TCP. | N/A |
| 27 | FBA A/B par refresh | Validates any changed adapter module configuration parameter settings. After refreshing, the value reverts automatically to **0** = Done.<br>**Note:** This parameter cannot be changed while the drive is running. | **0** = Done |
| | **0** = Done | Refreshing done | |
| | **1** = Refresh | Refreshing | |
| 28 | FBA A/B par table ver | **Read-only.** Displays the parameter table revision of the fieldbus adapter module mapping file stored in the memory of the drive. In format **xyz**, where<br>**x** = major revision number<br>**y** = minor revision number<br>**z** = correction number<br>OR<br>in format **axyz**, where<br>**a** = major revision number<br>**xy** = minor revision numbers<br>**z** = correction number or letter. | N/A |
| | | Parameter table revision | |
| 29 | FBA A/B drive type code | **Read-only.** Displays the drive type code of the fieldbus adapter module mapping file stored in the memory of the drive. | N/A |
| | | Drive type code of the fieldbus adapter module mapping file | |
| 30 | FBA A/B mapping file ver | **Read-only.** Displays the fieldbus adapter module mapping file revision stored in the memory of the drive in decimal format. | N/A |
| | | Mapping file revision | |

| No. | Name/Value | Description | Default |
|---|---|---|---|
| 31 | D2FBA A/B comm status | **Read-only.** Displays the status of the fieldbus adapter module communication.<br>**Note:** The value names may vary by drive. | **0** = Idle<br>OR<br>**4** = Off-line<br>OR<br>**2** = Time out |
| | **0** = Idle | Adapter is not configured. | |
| | **1** = Exec.init | Adapter is initializing. | |
| | **2** = Time out | A timeout has occurred in the communication between the adapter and the drive. | |
| | **3** = Conf.err | Adapter configuration error: The major or minor revision code of the common program revision in the fieldbus adapter module is not the revision required by the module or mapping file upload has failed more than three times. | |
| | **4** = Off-line | Adapter is off-line. | |
| | **5** = On-line | Adapter is on-line. | |
| | **6** = Reset | Adapter is performing a hardware reset. | |
| 32 | FBA A/B comm SW ver | **Read-only.** Displays firmware patch and build number of the adapter module in the **xxyy** format, where:<br>**xx** = patch number<br>**yy** = build number<br>Example: C80D ≥ 200.13<br>or 0 ≥ 0.0 | N/A |
| | | Common program version of the adapter module | |

| No. | Name/Value | Description | Default |
|---|---|---|---|
| 33 | FBA A/B appl SW ver | **Read-only.** Displays firmware version of the adapter module in xxyy format, where:<br>**xx = major revision number**<br>**yy = minor revision number**<br>Example: 310 = 3.10<br>Version number is the form:<br><major>.<minor>.<patch>.<build><br>Example: 3.10.200.13<br>or 3.10.0.0 | N/A |
| | | Application program revision of the adapter module | |

[1] 6-digit register addressing (400001) is used instead of 5-digit register addressing (40001) to describe register map.

[2] Register address = Register address + 40000 (0) if holding register area indication should be used.

For more information, see *Register addressing* on page *100*.

## FENA-01/-11/-21 configuration parameters – group B (group 2)

**Note:** The actual parameter group number depends on the drive type. Group B (group 2) corresponds to:

- parameter group 55 in ACS355
- parameter group 53 in ACSM1, ACS380, ACS480, ACS580, ACS850 and ACQ810.
- parameter group is typically 53/56 (group 153/156 in some variants) in ACS880 and ACS880-M04 if the adapter is installed as fieldbus adapter A/B.

<table>
<tr><th>No.[1)]</th><th>Name/Value</th><th>Description</th><th>Default</th></tr>
<tr><td>01</td><td>FBA A/B data out1 (client to drive)</td><td>Selects the drive parameter address into which the value of the Data out 1 register is written (from the client to the server). The Modbus register address maps are explained in chapter Modbus/TCP – Communication protocol.<br>The content is defined by a decimal number in the range of 0 to 9999 as follows:<table><tr><td>0</td><td>Not used</td></tr><tr><td>1…99</td><td>Virtual address area of drive control. Not used when the Modbus/TCP protocol is used.</td></tr><tr><td>101…9999</td><td>Parameter area of the drive</td></tr></table></td><td>0 = None</td></tr>
<tr><td></td><td>0 = None</td><td>Not used</td><td></td></tr>
<tr><td></td><td>101…9999</td><td>Parameter index with format xxyy, where<br>• xx is the parameter group number (1…99)<br>• yy is the parameter number index within that group (01…99).<br>Note: In ACS480, ACS580 and ACS880, choose Other to display a list of mappable drive parameters.</td><td></td></tr>
<tr><td>02…12</td><td>Data out 2 … Data out 12</td><td>See parameter 01 FBA A/B data out1.</td><td>0 = None</td></tr>
</table>

[1)] The number of parameters in this group may vary by drive type and drive firmware.

## FENA-01/-11/-21 configuration parameters – group C (group 3)

**Note:** The actual parameter group number depends on the drive type. Group C (group 3) corresponds to:

- parameter group 54 in ACS355
- parameter group 52 in ACSM1, ACS480, ACS580, ACS850 and ACQ810
- parameter group is typically 52/55 (group 152/155 in some variants) in ACS880 and ACS880-M04 if the adapter is installed as fieldbus adapter A/B.

<table>
<tr><th>No.[1)]</th><th>Name/Value</th><th>Description</th><th>Default</th></tr>
<tr><td>01</td><td>FBA A/B data in1 (drive to client)</td><td>Selects the drive parameter address from which the data is read to the Data in 1 register (from the server to the client). The Modbus register address maps are explained in chapter Modbus/TCP – Communication protocol.<br>The content is defined by a decimal number in the range of 0 to 9999 as follows:<table><tr><td>0</td><td>Not used</td></tr><tr><td>1…99</td><td>Virtual address area of drive control. Not used when the Modbus/TCP protocol is used.</td></tr><tr><td>101…9999</td><td>Parameter area of the drive</td></tr></table></td><td>0 = None</td></tr>
<tr><td></td><td>0 = None</td><td>Not used</td><td></td></tr>
<tr><td></td><td>101…9999</td><td>Parameter index with format xxyy, where<br>• xx is the parameter group number (1…99)<br>• yy is the parameter number index within that group (01…99).<br>Note: In ACS480, ACS580 and ACS880, choose Other to display a list of mappable drive parameters.</td><td></td></tr>
<tr><td>02…12</td><td>Data in 2 … Data in 12</td><td>See parameter 01 FBA A/B data in1.</td><td>0 = None</td></tr>
</table>

[1)] The number of parameters in this group may vary by drive type and drive firmware.

## Control locations

ABB drives can receive control information from multiple sources including digital inputs, analog inputs, the drive control panel and a fieldbus adapter module. ABB drives allow the user to separately determine the source for each type of control information (Start, Stop, Direction, Reference, Fault reset, etc.).

To give the fieldbus client the most complete control over the drive, you must select the adapter module as the source of this information. The drive-specific parameter setting examples below contain the drive control parameters relevant in the examples. For a complete parameter list, see the drive documentation.

## Starting up fieldbus communication for ACS355 drives

1. Power up the drive.
2. Enable the communication between the adapter module and the drive with parameter **9802 COMM PROT SEL**.
3. Set the module configuration parameters in group 51.
   - Select the communication protocol and profile with parameter **5102** and configure the network settings with parameters **5103**…**5113**.
   - With parameters **5120** and **5121**, select how the adapter module detects fieldbus communication breaks.
4. With parameter **3018 COMM FAULT FUNC**, select how the drive reacts to a fieldbus communication break.
5. With parameter **3019 COMM FAULT TIME**, define the time between communication break detection and the selected action.
6. Define the process data transferred to and from the drive in parameter groups 54 and 55.

   **Note:** The adapter module assigns the Control word, Status word, references 1…2 and actual values 1…2 automatically to Modbus registers. Process data groups are not available for the ABB Drives - Classic communication profile.
7. Validate the settings made in parameter groups 51, 54 and 55 with parameter **5127 FBA PAR REFRESH**.
8. Set the relevant drive control parameters to control the drive according to the application.

   Examples of appropriate values are shown in the tables below.

## Parameter setting examples – ACS355

### Speed and torque control using the ABB Drives – Enhanced communication profile

This example shows how to configure a speed and torque control application that uses the ABB Drives - Enhanced profile. In addition, some application-specific data is added to the communication.

The start/stop commands and reference are according to the ABB Drives profile. For more information, see section *ABB Drives communication profile* on page *91*.

When Reference 1 (REF1) is used, a reference value of ±20000 (decimal) corresponds to the reference set with parameter **1105 REF1 MAX** in the forward and reverse directions.

When Reference 2 (REF2) is used, a reference value of ±10000 (decimal) corresponds to the reference set with parameter **1108 REF2 MAX** in the forward and reverse directions.

The minimum and maximum 16-bit integer values that can be given through the fieldbus are -32768 and 32767 respectively.

| Output data | Modbus register | Input data | Modbus register |
|---|---|---|---|
| Control word | (4)00001 | Status word | (4)00051 |
| Speed reference | (4)00002 | Speed actual value | (4)00052 |
| Torque reference | (4)00003 | Torque actual value | (4)00053 |
| Constant speed 1[1)] | (4)00004 | Power[1)] | (4)00054 |
| Constant speed 2[1)] | (4)00005 | DC bus voltage[1)] | (4)00055 |

[1)] Example

The table below gives the recommended drive parameter settings.

| Drive parameter | Setting for ACS355 drives | Description |
|---|---|---|
| 9802 COMM PROT SEL | **4** = EXT FBA | Enables communication between the drive and the fieldbus adapter module. |
| 5101 FBA TYPE | ETHERNET[1)] | Displays the type of the fieldbus adapter module. |

| Drive parameter | Setting for ACS355 drives | Description |
|---|---|---|
| 5102 FB PAR 2 (PROTOCOL/PROFILE) | **1** (= MB/TCP ABB E) | Selects the Modbus/TCP protocol and the ABB Drives - Enhanced profile. |
| 5103 FB PAR 3 (COMMRATE) | **0** (= Auto)[2)] | Ethernet communication rate is negotiated automatically by the device. |
| 5104 FB PAR 4 (IP CONFIGURATION) | **0** (= Static IP) | Configuration will be obtained from parameters *05…13*. |
| 5105 FB PAR 5 (IP ADDRESS 1) | 192[2)] | First part of the IP address |
| 5106 FB PAR 6 (IP ADDRESS 2) | 168[2)] | Second part of the IP address |
| 5107 FB PAR 7 (IP ADDRESS 3) | 0[2)] | Third part of the IP address |
| 5108 FB PAR 8 (IP ADDRESS 4) | 16[2)] | Last part of the IP address |
| 5109 FBA PAR 9 (SUBNET CIDR) | 24[2)] | Sets the network mask as 255.255.255.0, allowing access only to the last subnet. |
| 5120 FB PAR 20 (MODBUS/TCP TIMEOUT) | 10[2)] | Sets the communication timeout as 1 second. |
| 5121 FB PAR 21 (TIMEOUT MODE) | **2** (= Control RW)[2)] | The timeout feature monitors the updating of the Control word and Reference 1. |
| 3018 COMM FAULT FUNC | **1** = FAULT[2)] | Enables fieldbus communication fault monitoring. |
| 3019 COMM FAULT TIME | 3.0 s[2)] | Defines the fieldbus communication break supervision time. |
| 5401 FBA DATA IN 1 | 106[2)] | Power |
| 5402 FBA DATA IN 2 | 107[2)] | DC bus voltage |
| 5501 FBA DATA OUT 1 | 1202[2)] | Constant speed 1 |
| 5502 FBA DATA OUT 2 | 1203[2)] | Constant speed 2 |
| 5127 FBA PAR REFRESH | **1** = REFRESH | Validates the FENA-01/-11/-21 configuration parameter settings. |

| Drive parameter | Setting for ACS355 drives | Description |
|---|---|---|
| 9904 MOTOR CTRL MODE | **2** = VECTOR: TORQ | Selects the vector control mode as the motor control mode. |
| 1001 EXT1 COMMANDS | **10** = COMM | Selects the fieldbus interface as the source of the start and stop commands for external control location 1. |
| 1002 EXT2 COMMANDS | **10** = COMM | Selects the fieldbus interface as the source of the start and stop commands for external control location 2. |
| 1102 EXT1/EXT2 SEL | **8** = COMM | Enables external control location 1/2 selection through the fieldbus. |
| 1103 REF1 SELECT | **8** = COMM | Selects the fieldbus reference 1 as the source for speed reference 1. |
| 1106 REF2 SELECT | **8** = COMM | Selects the fieldbus reference 2 as the source for speed reference 1. |
| 1601 RUN ENABLE | **7** = COMM | Selects the fieldbus interface as the source for the inverted Run enable signal (Run disable). |
| 1604 FAULT RESET SEL | **8** = COMM | Selects the fieldbus interface as the source for the fault reset signal. |

[1] Read-only or automatically detected/set
[2] Example

The start sequence for the parameter example above is given below.

Control word:

- Reset the fieldbus communication fault (if active).
- Enter 47Eh (1150 decimal) → READY TO SWITCH ON.
- Enter 47Fh (1151 decimal) → OPERATING (Speed mode)
  or
  C7Fh (3199 decimal) → OPERATING (Torque mode).

## Starting up fieldbus communication for ACSM1 drives

1. Power up the drive.
2. Enable the communication between the adapter module and the drive with parameter **50.01 FBA ENABLE**.
3. With parameter **50.02 COMM LOSS FUNC**, select how the drive reacts to a fieldbus communication break.

   Note that this function monitors both communication between the fieldbus master and the adapter module and communication between the adapter module and the drive.
4. With parameter **50.03 COMM LOSS T OUT**, define the time between communication break detection and the selected action.
5. Select application-specific values for parameters **50.04**…**50.11**.

   Examples of appropriate values are shown in the tables below.
6. Set the module configuration parameters in group 51.
   - Select the communication protocol and profile with parameter **51.02** and configure the network settings with parameters **51.03**…**51.13**.
   - With parameters **51.20** and **51.21**, select how the adapter module detects fieldbus communication breaks.

7. Define the process data transferred to and from the drive in parameter groups 52 and 53.

   **Note:** The adapter module assigns the Control word, Status word, references 1…2 and actual values 1…2 automatically to Modbus registers. Process data groups are not available in the ABB Drives - Classic communication profile.

8. Validate the settings made in parameter groups 51, 52 and 53 with parameter **51.27 FBA PAR REFRESH**.

9. Set the relevant drive control parameters to control the drive according to the application.

   Examples of appropriate values are shown in the tables below.

## Parameter setting examples – ACSM1

### Speed and torque control using the ABB Drives – Enhanced communication profile

This example shows how to configure a speed and torque control application that uses the ABB Drives - Enhanced profile. In addition, some application-specific data is added to the communication.

The start/stop commands and reference are according to the ABB Drives profile. For more information, see section *ABB Drives communication profile* on page *91*.

When Reference 1 (REF1) is used, a reference value of ±20000 (4E20h) corresponds to the reference set with parameter **25.02 SPEED SCALING** in the forward and reverse directions.

When Reference 2 (REF2) is used, a reference value of ±10000 (2710h) corresponds to the reference set with parameter **32.04 TORQUE REF 1 MAX** in the forward and reverse directions.

The minimum and maximum 16-bit integer values that can be given through the fieldbus are -32768 and 32767 respectively.

| Output data | Modbus register | Input data | Modbus register |
|---|---|---|---|
| Control word | (4)00001 | Status word | (4)00051 |
| Speed reference | (4)00002 | Speed actual value | (4)00052 |
| Torque reference | (4)00003 | Torque actual value | (4)00053 |
| Constant speed[1)] | (4)00004<br>(4)00005 | Power[1)] | (4)00054<br>(4)00055 |
| Speed reference for jogging function 1[1)] | (4)00006<br>(4)00007 | DC bus voltage[1)] | (4)00056<br>(4)00057 |

[1)] Example

The table below gives the recommended drive parameter settings.

| Drive parameter | Setting for ACSM1 drives | Description |
|---|---|---|
| 50.01 FBA ENABLE | Enable | Enables communication between the drive and the fieldbus adapter module. |
| 50.02 COMM LOSS FUNC | Fault[2)] | Enables fieldbus communication fault monitoring. |
| 50.03 COMM LOSS T OUT | 3.0 s[2)] | Defines the fieldbus communication break supervision time. |
| 50.04 FBA REF1 MODESEL | Speed | Selects the fieldbus reference 1 scaling. |
| 50.05 FBA REF2 MODESEL | Torque | Selects the fieldbus reference 2 scaling. |
| 51.01 FBA TYPE | ETHERNET[1)] | Displays the type of the fieldbus adapter module. |
| 51.02 FBA PAR2 (PROTOCOL/PROFILE) | **1** (= MB/TCP ABB E) | Selects the Modbus/TCP protocol and the ABB Drives - Enhanced profile. |
| 51.03 FBA PAR3 (COMMRATE) | **0** (= Auto)[2)] | Ethernet communication rate is negotiated automatically by the device. |
| 51.04 FBA PAR4 (IP CONFIGURATION) | **0** (= Static IP)[2)] | Configuration will be obtained from parameters *05…13*. |

| Drive parameter | Setting for ACSM1 drives | Description |
|---|---|---|
| 51.05 FBA PAR5 (IP ADDRESS 1) | 192[2)] | First part of the IP address |
| 51.06 FBA PAR6 (IP ADDRESS 2) | 168[2)] | Second part of the IP address |
| 51.07 FBA PAR7 (IP ADDRESS 3) | 0[2)] | Third part of the IP address |
| 51.08 FBA PAR8 (IP ADDRESS 4) | 16[2)] | Last part of the IP address |
| 51.09 FBA PAR9 (SUBNET CIDR) | 24[2)] | Sets the network mask as 255.255.255.0, allowing access only to the last subnet. |
| 51.20 FBA PAR20 (MODBUS/TCP TIMEOUT) | 10[2)] | Sets the communication timeout as 1 second. |
| 51.21 FBA PAR21 TIMEOUT MODE) | **2** (= Control RW)[2)] | The timeout feature monitors the updating of the Control word and Reference 1. |

| | | |
|---|---|---|
| 52.01 FBA DATA IN1 | 122[2)] | Power |
| 52.03 FBA DATA IN3 | 107[2)] | DC bus voltage |
| 53.01 FBA DATA OUT1 | 2408[2)] | Constant speed |
| 53.03 FBA DATA OUT3 | 2410[2)] | Speed reference for jogging function 1 |

| | | |
|---|---|---|
| 51.27 FBA PAR REFRESH | REFRESH | Validates the FENA-11/-21 configuration parameter settings. |

| | | |
|---|---|---|
| 10.01 EXT1 START FUNC | FBA | Selects the fieldbus interface as the source of the start and stop commands for external control location 1. |
| 10.04 EXT2 START FUNC | FBA | Selects the fieldbus interface as the source of the start and stop commands for external control location 2. |
| 10.08 FAULT RESET SEL | P.FBA MAIN CW.8 | Selects the fieldbus interface as the source for the fault reset signal. |
| 24.01 SPEED REF1 SEL | FBA REF1 | Selects the fieldbus reference 1 as the source for speed reference 1. |

| Drive parameter | Setting for ACSM1 drives | Description |
|---|---|---|
| 32.02 TORQ REF ADD SEL | FBA REF2 | Selects the fieldbus reference 2 as the source for torque reference 1. |
| 34.01 EXT1/EXT2 SEL | P.FBA MAIN CW.15 | Enables external control location 1/2 selection through the fieldbus only (bit 15 in the fieldbus Control word). |
| 34.03 EXT1 CTRL MODE1 | Speed | Selects speed control as the control mode 1 for external control location 1. |
| 34.05 EXT2 CTRL MODE1 | Torque | Selects torque control as the control mode 1 for external control location 2. |

[1] Read-only or automatically detected/set
[2] Example

The start sequence for the parameter example above is given below.

Control word:

- Reset the fieldbus communication fault (if active).
- Enter 47Eh (1150 decimal) → READY TO SWITCH ON.
- Enter 47Fh (1151 decimal) → OPERATING (Speed mode)

  or

  C7Fh (3199 decimal) → OPERATING (Torque mode).

## Starting up fieldbus communication for ACS850 and ACQ810 drives

1. Power up the drive.
2. Enable the communication between the adapter module and the drive with parameter **50.01 FBA enable**.
3. With parameter **50.02 Comm loss func**, select how the drive reacts to a fieldbus communication break.

   **Notes:**
   - This function monitors both communication between the fieldbus master and the adapter module and communication between the adapter module and the drive.
   - In ACQ810, you can select the control locations to be monitored with parameter **50.21 Comm loss enable**. By default, the monitoring is enabled in both control locations (EXT1 and EXT2).
4. With parameter **50.03 Comm loss t out**, define the time between communication break detection and the selected action.
5. Select application-specific values for parameters **50.04**…**50.11**.

   Examples of appropriate values are shown in the tables below.
6. Set the module configuration parameters in group 51.
   - Select the communication protocol and profile with parameter **51.02** and configure the network settings with parameters **51.03**…**51.13**.
   - With parameters **51.20** and **51.21**, select how the adapter module detects fieldbus communication breaks.

7. Define the process data transferred to and from the drive in parameter groups 52 and 53.

   **Note:** The adapter module assigns the Control word, Status word, references 1…2 and actual values 1…2 automatically to Modbus registers. Process data groups are not available in the ABB Drives - Classic communication profile.

8. Validate the settings made in parameter groups 51, 52 and 53 with parameter **51.27 FBA par refresh**.

9. Set the relevant drive control parameters to control the drive according to the application.

   Examples of appropriate values are shown in the tables below.

## Parameter setting examples – ACS850 and ACQ810

### Speed control using the ABB Drives – Enhanced communication profile

This example shows how to configure a speed control application that uses the ABB Drives - Enhanced profile. In addition, some application-specific data is added to the communication.

The start/stop commands and reference are according to the ABB Drives profile. For more information, see section *ABB Drives communication profile* on page *91*.

When Reference 1 (REF1) is used, a reference value of ±20000 (4E20h) corresponds to the reference set with parameter **19.01 Speed scaling** in the forward and reverse directions.

The minimum and maximum 16-bit integer values that can be given through the fieldbus are -32768 and 32767 respectively.

| Output data | Modbus register | Input data | Modbus register |
|---|---|---|---|
| Control word | (4)00001 | Status word | (4)00051 |
| Speed reference | (4)00002 | Speed actual value | (4)00052 |
| Reference 2 (Not used) | (4)00003 | Actual value 2 (Not used) | (4)00053 |
| Constant speed 1[1)] | (4)00004<br>(4)00005 | Power[1)] | (4)00054<br>(4)00055 |
| Constant speed 2[1)] | (4)00006<br>(4)00007 | DC bus voltage[1)] | (4)00056<br>(4)00057 |

1) Example

The table below gives the recommended drive parameter settings.

| Drive parameter | Setting for ACS850/ACQ810 drives | Description |
|---|---|---|
| 50.01 Fba enable | Enable | Enables communication between the drive and the fieldbus adapter module. |
| 50.02 Comm loss func | Fault[2)] | Enables fieldbus communication fault monitoring. |
| 50.03 Comm loss t out | 3.0 s[2)] | Defines the fieldbus communication break supervision time. |
| 50.04 Fb ref1 modesel | Speed | Selects the fieldbus reference 1 scaling. |
| 51.01 FBA type | Ethernet[1)] | Displays the type of the fieldbus adapter module. |
| 51.02 FBA par2 (PROTOCOL/ PROFILE) | **1** (= MB/TCP ABB E) | Selects the Modbus/TCP protocol and the ABB Drives - Enhanced profile. |
| 51.03 FBA par3 (COMMRATE) | **0** (= Auto)[2)] | Ethernet communication rate is negotiated automatically by the device. |
| 51.04 FBA par4 (IP CONFIGURATION) | **0** (= Static IP)[2)] | Configuration will be obtained from parameters *05*…*13*. |

| Drive parameter | Setting for ACS850/ACQ810 drives | Description |
|---|---|---|
| 51.05 FBA par5 (IP ADDRESS 1) | 192[2)] | First part of the IP address |
| 51.06 FBA par6 (IP ADDRESS 2) | 168[2)] | Second part of the IP address |
| 51.07 FBA par7 (IP ADDRESS 3) | 0[2)] | Third part of the IP address |
| 51.08 FBA par8 (IP ADDRESS 4) | 16[2)] | Last part of the IP address |
| 51.09 FBA par9 (SUBNET CIDR) | 24[2)] | Sets the network mask as 255.255.255.0, allowing access only to the last subnet. |
| 51.20 FBA par20 (MODBUS/TCP TIME-OUT) | 10[2)] | Sets the communication timeout as 1 second. |
| 51.21 FBA par21 (TIMEOUT MODE) | **2** (= Control RW)[2)] | The timeout feature monitors the updating of the Control word and Reference 1. |
| 52.01 FBA data in1 | 122[2)] | Power |
| 52.03 FBA data in3 | 107[2)] | DC bus voltage |
| 53.01 FBA data out1 | 2606[2)] | Constant speed 1 |
| 53.03 FBA data out3 | 2607[2)] | Constant speed 2 |
| 51.27 FBA par refresh | Refresh | Validates the FENA-11/-21 configuration parameter settings. |
| 10.01 Ext1 start func | FB | Selects the fieldbus interface as the source of the start and stop commands for external control location 1. |
| 10.10 Fault reset sel | P.FBA main cw.8 | Selects the fieldbus interface as the source for the fault reset signal. |
| 21.01 Speed ref1 sel (ACS850)<br>21.01 Speed ref sel (ACQ810) | FBA ref1<br>FBA ref1 | Selects the fieldbus reference 1 as the source for speed reference 1. |

[1)] Read-only or automatically detected/set

[2)] Example

The start sequence for the parameter example above is given below.

Control word:

- Reset the fieldbus communication fault (if active).
- Enter 47Eh (1150 decimal) → READY TO SWITCH ON.
- Enter 47Fh (1151 decimal) → OPERATING (Speed mode).

## Starting up fieldbus communication for ACS480, ACS580 and ACS880 drives

1. Power up the drive.
2. Enable the communication between the adapter module and the drive by selecting the correct slot number in parameter **50.01 FBA A enable**.

   The selection must correspond to the slot where the adapter module is installed. For example, if the adapter module is installed in slot 1, you must select slot 1.
3. With parameter **50.02 FBA A comm loss func**, select how the drive reacts to a fieldbus communication break.

   Note that this function monitors both communication between the fieldbus master and the adapter module and communication between the adapter module and the drive.
4. With parameter **50.03 FBA A comm loss t out**, define the time between communication break detection and the selected action.
5. Select application-specific values for the rest of the parameters in group 50, starting from **50.04**.

   Examples of appropriate values are shown in the tables below.

6. Set the module configuration parameters in group 51.
   - Select the communication protocol and profile with parameter **51.02** and configure the network settings with parameters **51.03**…**51.13**.
   - With parameters **51.20** and **51.21**, select how the adapter module detects fieldbus communication breaks.
7. Define the process data transferred to and from the drive in parameter groups 52 and 53.

   **Note:** The adapter module assigns the Control word, Status word, references 1…2 and actual values 1…2 automatically to Modbus registers. Process data groups are not available in the ABB Drives - Classic communication profile.
8. Save the valid parameter values to permanent memory with parameter **96.07 Parameter save manually**.
9. Validate the settings made in parameter groups 51, 52 and 53 with parameter **51.27 FBA A par refresh**.
10. Set the relevant drive control parameters to control the drive according to the application.

    Examples of appropriate values are shown in the tables below.

## Parameter setting examples – ACS480 and ACS580 drives

### Frequency control using the ABB Drives – Enhanced communication profile

This example shows how to configure a frequency control application that uses the ABB Drives - Enhanced profile. In addition, some application-specific data is added to the communication.

The start/stop commands and reference are according to the ABB Drives profile. For more information, see section *ABB Drives communication profile* on page *91*.

In the frequency control mode, when Reference 1 (REF1) is used, a reference value of ±20000 (4E20h) corresponds to the reference set with parameter **46.02 Frequency scaling** in the forward and reverse directions.

The minimum and maximum 16-bit integer values that can be given through the fieldbus are -32768 and 32767 respectively.

| Output data | Modbus register | Input data | Modbus register |
|---|---|---|---|
| Control word | (4)00001 | Status word | (4)00051 |
| Frequency reference | (4)00002 | Frequency actual value | (4)00052 |
| Reference 2 (Not used) | (4)00003 | Actual value 2 (Not used) | (4)00053 |
| Constant frequency 1[1)] | (4)00004<br>(4)00005 | Power[1)] | (4)00054<br>(4)00055 |
| Constant frequency 2[1)] | (4)00006<br>(4)00007 | DC bus voltage[1)] | (4)00056<br>(4)00057 |

[1)] Example

The table below gives the recommended drive parameter settings.

| Drive parameter | Setting for ACS480 and ACS580 drives | Description |
|---|---|---|
| 50.01 FBA A enable | **1** = Option slot 1[2)] | Enables communication between the drive and the fieldbus adapter module. |
| 50.02 FBA A comm loss func | **1** = Fault[2)] | Enables fieldbus A communication fault monitoring. |

| Drive parameter | Setting for ACS480 and ACS580 drives | Description |
|---|---|---|
| 50.03 FBA A comm loss t out | 3.0 s[2)] | Defines the fieldbus A communication break supervision time. |
| 50.04 FBA A ref1 type | **0** = Speed or frequency | Selects the fieldbus A reference 1 type and scaling. |

| | | |
|---|---|---|
| 51.01 FBA A type | **128** = ETHERNET[1)] | Displays the type of the fieldbus adapter module. |
| 51.02 Protocol/Profile | **1** = MB/TCP ABB E | Selects the Modbus/TCP protocol and the ABB Drives - Enhanced profile. |
| 51.03 Commrate | **0** = Auto[2)] | Ethernet communication rate is negotiated automatically by the device. |
| 51.04 IP configuration | **0** = Static IP[2)] | Configuration will be obtained from parameters *05*…*13*. |
| 51.05 IP address 1 | 192[2)] | First part of the IP address |
| 51.06 IP address 2 | 168[2)] | Second part of the IP address |
| 51.07 IP address 3 | 0[2)] | Third part of the IP address |
| 51.08 IP address 4 | 16[2)] | Last part of the IP address |
| 51.09 Subnet CIDR | 24[2)] | Sets the network mask as 255.255.255.0, allowing access only to the last subnet. |
| 51.20 Timeout time | 10[2)] | Sets the communication timeout as 1 second. |
| 51.21 Timeout mode | **2** = Control RW[2)] | The timeout feature monitors the updating of the Control word and Reference 1. |

| | | |
|---|---|---|
| 52.01 FBA A data in1 | 01.14[2)] | Output power |
| 52.03 FBA a data in3 | 01.11[2)] | DC voltage |
| 53.01 FBA A data out1 | 28.26[2)] | Constant frequency 1 |
| 53.03 FBA A data out3 | 28.27[2)] | Constant frequency 2 |

| | | |
|---|---|---|
| 51.27 FBA A par refresh | **1** = Refresh | Validates the FENA-11/-21 configuration parameter settings. |

| | | |
|---|---|---|
| 20.01 Ext1 commands | **12** = Fieldbus A | Selects the fieldbus A interface as the source of the start and stop commands for external control location 1. |

| Drive parameter | Setting for ACS480 and ACS580 drives | Description |
|---|---|---|
| 22.11 Speed ref1 source | **4** = FB A ref1 | Selects the fieldbus A reference 1 as the source for speed reference 1. |
| 31.11 Fault reset selection | 06.1.7 | Selects the fieldbus interface as the source for the fault reset signal. |

[1] Read-only or automatically detected/set

[2] Example

The start sequence for the parameter example above is given below.

Control word:

- Reset the fieldbus communication fault (if active).
- Enter 47Eh (1150 decimal) → READY TO SWITCH ON.

  Enter 47Fh (1151 decimal) → OPERATING (Scalar motor control mode).

## Parameter setting examples – ACS880

### Speed control using the ABB Drives – Enhanced communication profile

This example shows how to configure a speed control application that uses the ABB Drives - Enhanced profile. In addition, some application-specific data is added to the communication.

The start/stop commands and reference are according to the ABB Drives profile. For more information, see section *ABB Drives communication profile* on page *91*.

When Reference 1 (REF1) is used, a reference value of ±20000 (4E20h) corresponds to the reference set with parameter **46.01 Speed scaling** in the forward and reverse directions.

The minimum and maximum 16-bit integer values that can be given through the fieldbus are -32768 and 32767 respectively.

| Output data | Modbus register | Input data | Modbus register |
|---|---|---|---|
| Control word | (4)00001 | Status word | (4)00051 |
| Speed reference | (4)00002 | Speed actual value | (4)00052 |
| Reference 2 (Not used) | (4)00003 | Actual value 2 (Not used) | (4)00053 |
| Constant speed 1 [32][1)] | (4)00004<br>(4)00005 | Output power [32][1)] | (4)00054<br>(4)00055 |
| Constant speed 2 [32][1)] | (4)00006<br>(4)00007 | DC voltage [32][1)] | (4)00056<br>(4)00057 |

1) Example

The table below gives the recommended drive parameter settings.

| Drive parameter | Setting for ACS880 drives | Description |
|---|---|---|
| 50.01 FBA A enable | **1** = Option slot 1[2)] | Enables communication between the drive and the fieldbus adapter module. |
| 50.02 FBA A comm loss func | **1** = Fault[2)] | Enables fieldbus A communication fault monitoring. |
| 50.03 FBA A comm loss t out | 3.0 s[2)] | Defines the fieldbus A communication break supervision time. |

| Drive parameter | Setting for ACS880 drives | Description |
|---|---|---|
| 50.04 FBA A ref1 type | **4** = Speed | Selects the fieldbus A reference 1 type and scaling. |
| 51.01 FBA A type | **128** = ETHERNET[1)] | Displays the type of the fieldbus adapter module. |
| 51.02 Protocol/Profile | **1** = MB/TCP ABB E | Selects the Modbus/TCP protocol and the ABB Drives - Enhanced profile. |
| 51.03 Commrate | **0** = Auto[2)] | Ethernet communication rate is negotiated automatically by the device. |
| 51.04 IP configuration | **0** = Static IP[2)] | Configuration will be obtained from parameters *05…13*. |
| 51.05 IP address 1 | 192[2)] | First part of the IP address |
| 51.06 IP address 2 | 168[2)] | Second part of the IP address |
| 51.07 IP address 3 | 0[2)] | Third part of the IP address |
| 51.08 IP address 4 | 16[2)] | Last part of the IP address |
| 51.09 Subnet CIDR | 24[2)] | Sets the network mask as 255.255.255.0, allowing access only to the last subnet. |
| 51.20 Timeout time | 10[2)] | Sets the communication timeout as 1 second. |
| 51.21 Timeout mode | **2** = Control RW[2)] | The timeout feature monitors the updating of the Control word and Reference 1. |
| 52.01 FBA A data in1 | 01.14[2)] | Output power |
| 52.03 FBA a data in3 | 01.11[2)] | DC voltage |
| 53.01 FBA A data out1 | 22.26[2)] | Constant speed 1 |
| 53.03 FBA A data out3 | 22.27[2)] | Constant speed 2 |
| 51.27 FBA A par refresh | **1** = Refresh | Validates the FENA-11/-21 configuration parameter settings. |
| 20.01 Ext1 commands | **12** = Fieldbus A | Selects the fieldbus A interface as the source of the start and stop commands for external control location 1. |

| Drive parameter | Setting for ACS880 drives | Description |
|---|---|---|
| 22.11 Speed ref1 source | **4** = FB A ref1 | Selects the fieldbus A reference 1 as the source for speed reference 1. |
| 31.11 Fault reset selection | **30** = FBA A MCW bit 7 | Selects the fieldbus interface as the source for the fault reset signal. |

[1] Read-only or automatically detected/set
[2] Example

The start sequence for the parameter example above is given below.

Control word:

- Reset the fieldbus communication fault (if active).
- Enter 47Eh (1150 decimal) → READY TO SWITCH ON.
- Enter 47Fh (1151 decimal) → OPERATING (Speed mode).

## Client configuration

After the adapter module has been initialized by the drive, you must prepare the client for communication with the module. Due to the large number of different Modbus clients, specific instructions cannot be provided here. Refer to the documentation of your client for more information.

### Modbus register maps

The Modbus register map which the adapter module presents to the Modbus client is selected with parameter *02 Protocol/Profile* (see page *55*).

For Modbus register map definitions, see chapter *Modbus/TCP – Communication protocol*.

For definitions of the Control word, Status word, references and actual values for a given communication profile, see chapter *Modbus/TCP – Communication profiles*.

7

# Modbus/TCP – Communication profiles

## Contents of this chapter

This chapter describes the communication profiles used in the communication between the Modbus/TCP client, the adapter module and the drive.

## Communication profiles

Communication profiles are ways of conveying control commands (Control word, Status word, references and actual values) between the Modbus client and the drive.

With the FENA adapter module, the Modbus/TCP network may employ either the ABB Drives profile or one of two Transparent modes for 16-bit and 32-bit words respectively. For the ABB Drives profile, data is converted by the adapter module into the native profile (e.g., DCU or FBA). For the Transparent modes, no data conversion takes place.

The figure below illustrates the profile selection:

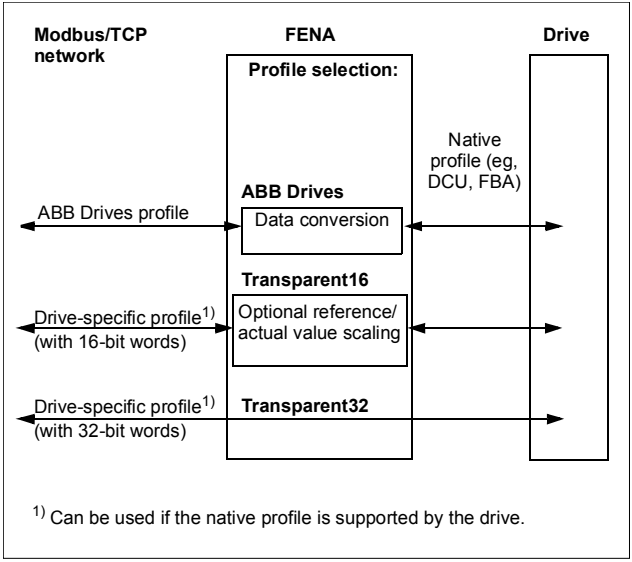


The following sections describe the Control word, the Status word, references and actual values for the ABB Drives communication profile. Refer to the drive manuals for details on the native profiles.

M

# ABB Drives communication profile

## Control word and Status word

The Control word is the principal means for controlling the drive from a fieldbus system. It is sent by the fieldbus client station to the drive through the adapter module. The drive switches between its states according to the bit-coded instructions in the Control word and returns status information to the client in the Status word.

The contents of the Control word and the Status word are detailed below. The drive states are presented on page *95*.

### Control word contents

The table below shows the contents of the Control word for the ABB Drives communication profile. The upper case boldface text refers to the states shown in the state machine on page *95*.

| Bit | Name | Value | STATE/Description |
|---|---|---|---|
| 0 | OFF1_ CONTROL | 1 | Proceed to **READY TO OPERATE**. |
| | | 0 | Stop along currently active deceleration ramp. Proceed to **OFF1 ACTIVE**; proceed to **READY TO SWITCH ON** unless other interlocks (OFF2, OFF3) are active. |
| 1 | OFF2_ CONTROL | 1 | Continue operation (OFF2 inactive). |
| | | 0 | Emergency OFF, coast to stop. Proceed to **OFF2 ACTIVE**, proceed to **SWITCH-ON INHIBITED**. |
| 2 | OFF3_ CONTROL | 1 | Continue operation (OFF3 inactive). |
| | | 0 | Emergency stop, stop within time defined by drive parameter. Proceed to **OFF3 ACTIVE**; proceed to **SWITCH-ON INHIBITED**. **Warning:** Ensure that motor and driven machine can be stopped using this stop mode. |

| Bit | Name | Value | STATE/Description |
|---|---|---|---|
| 3 | INHIBIT_ OPERATION | 1 | Proceed to **OPERATION ENABLED**.<br>**Note:** Run enable signal must be active; see drive documentation. If the drive is set to receive the Run enable signal from the fieldbus, this bit activates the signal. |
| | | 0 | Inhibit operation. Proceed to **OPERATION INHIBITED**. |
| 4 | RAMP_OUT_ ZERO | 1 | Normal operation. Proceed to **RAMP FUNCTION GENERATOR: OUTPUT ENABLED**. |
| | | 0 | Force Ramp Function Generator output to zero. Drive ramps to stop (current and DC voltage limits in force). |
| 5 | RAMP_HOLD | 1 | Enable ramp function.<br>Proceed to **RAMP FUNCTION GENERATOR: ACCELERATOR ENABLED**. |
| | | 0 | Halt ramping (Ramp Function Generator output held). |
| 6 | RAMP_IN_ ZERO | 1 | Normal operation. Proceed to **OPERATION**.<br>**Note:** This bit is effective only if the fieldbus interface is set as the source for this signal by drive parameters. |
| | | 0 | Force Ramp Function Generator input to zero. |
| 7 | RESET | 0 → 1 | Fault reset if an active fault exists. Proceed to **SWITCH-ON INHIBITED**.<br>**Note:** This bit is effective only if the fieldbus interface is set as the source for this signal by drive parameters. |
| | | 0 | Continue normal operation. |
| 8…9 | Reserved. | | |

M

| Bit | Name | Value | STATE/Description |
|---|---|---|---|
| 10 | REMOTE_ CMD | 1 | Fieldbus control enabled. |
| | | 0 | Control word and reference not getting through to the drive, except for CW bits OFF1, OFF2 and OFF3. |
| 11 | EXT_CTRL_ LOC | 1 | Select External Control Location EXT2. Effective if control location parameterized to be selected from fieldbus. |
| | | 0 | Select External Control Location EXT1. Effective if control location parameterized to be selected from fieldbus. |
| 12… 15 | Reserved or freely programmable control bits (Not supported with ACS355) | | |

### Status word contents

The table below shows the contents of the Status word for the ABB Drives communication profile. The upper case boldface text refers to the states shown in the state machine on page *95*.

| Bit | Name | Value | STATE/Description |
|---|---|---|---|
| 0 | RDY_ON | 1 | **READY TO SWITCH ON** |
| | | 0 | **NOT READY TO SWITCH ON** |
| 1 | RDY_RUN | 1 | **READY TO OPERATE** |
| | | 0 | **OFF1 ACTIVE** |
| 2 | RDY_REF | 1 | **OPERATION ENABLED** |
| | | 0 | **OPERATION INHIBITED** |
| 3 | TRIPPED | 1 | **FAULT** |
| | | 0 | No fault |
| 4 | OFF_2_STA | 1 | OFF2 inactive |
| | | 0 | **OFF2 ACTIVE** |
| 5 | OFF_3_STA | 1 | OFF3 inactive |
| | | 0 | **OFF3 ACTIVE** |
| 6 | SWC_ON_ INHIB | 1 | **SWITCH-ON INHIBITED** |
| | | 0 | – |

| Bit | Name | Value | STATE/Description |
|---|---|---|---|
| 7 | ALARM | 1 | Warning/Alarm |
| | | 0 | No warning/alarm |
| 8 | AT_ SETPOINT | 1 | **OPERATION.** Actual value equals reference (= is within tolerance limits, i.e., in speed control, speed error is 10% max. of nominal motor speed). |
| | | 0 | Actual value differs from reference (= is outside tolerance limits.) |
| 9 | REMOTE | 1 | Drive control location: REMOTE (EXT1 or EXT2) |
| | | 0 | Drive control location: LOCAL |
| 10 | ABOVE_ LIMIT | 1 | Actual frequency or speed equals or exceeds supervision limit (set by drive parameter). Valid in both directions of rotation. |
| | | 0 | Actual frequency or speed within supervision limit |
| 11 | EXT_CTRL_ LOC | 1 | External Control Location EXT2 selected. **Note concerning ACS880:** This bit is effective only if the fieldbus interface is set as the target for this signal by drive parameters. User bit 0 selection (06.33) |
| | | 0 | External Control Location EXT1 selected |
| 12 | EXT_RUN_ ENABLE | 1 | External Run Enable signal received. **Note concerning ACS880:** This bit is effective only if the fieldbus interface is set as the target for this signal by drive parameters. User bit 1 selection (06.34) |
| | | 0 | No External Run Enable signal received |
| 13… 14 | Reserved or freely programmable status bits (Not supported with ACS355) | | |
| 15 | FBA_ERROR | 1 | Communication error detected by fieldbus adapter module |
| | | 0 | Fieldbus adapter communication OK |

M

## State machine

The state machine for the ABB Drives communication profile is shown below.

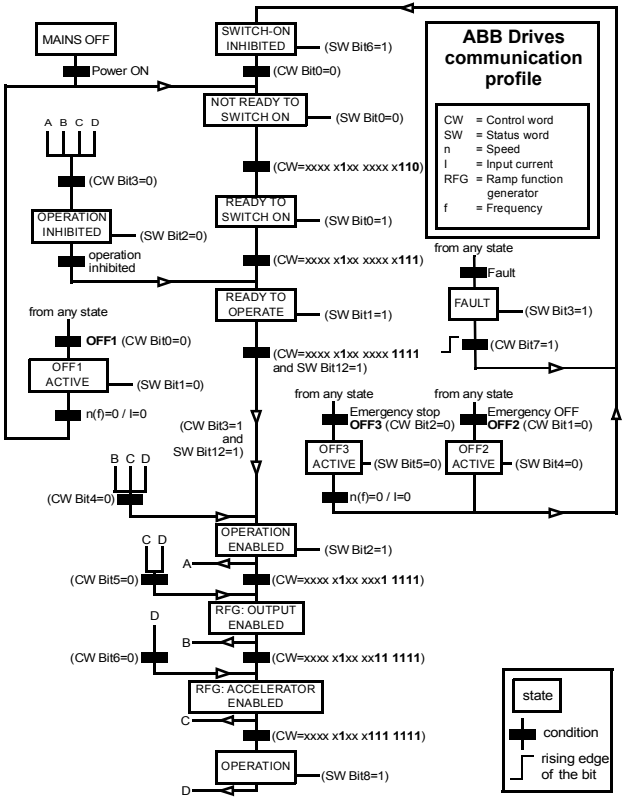

## References

References are 16-bit words containing a sign bit and a 15-bit integer. A negative reference (indicating reversed direction of rotation) is formed by calculating the two's complement from the corresponding positive reference.

ABB drives can receive control information from multiple sources including analog and digital inputs, the drive control panel and a fieldbus adapter module (for example, FENA). To have the drive controlled through the fieldbus, you must select the module as the source for control information, for example, reference.

### Scaling

References are scaled as shown below.

**Note:** The values of REF1 MAX and REF2 MAX are set with drive parameters. See the drive manuals for further information.

In ACSM1, ACS480, ACS580, ACS850, ACQ810 and ACS880 the speed reference (REFx) in decimal (0…20000) corresponds to 0…100% of the speed scaling value (as defined with a drive parameter).

In ACS355, drive parameter REFx MIN may limit the actual minimum reference.

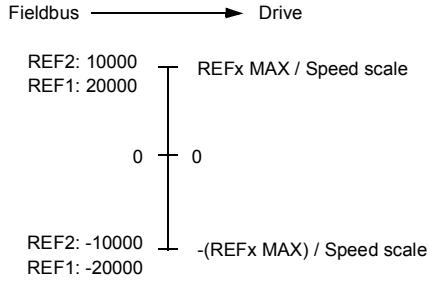

## Actual values

Actual values are 16-bit words containing information on the operation of the drive. The functions to be monitored are selected with a drive parameter.

### Scaling

Actual values are scaled as shown below.

**Note:** The values of REF1 MAX and REF2 MAX are set with drive parameters. See the drive manuals for further information.

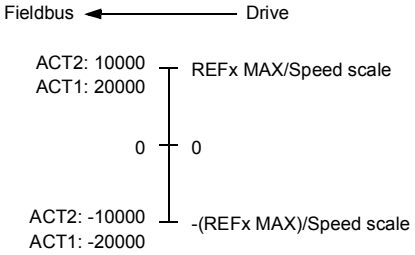

8

# Modbus/TCP – Communication protocol

## Contents of this chapter

This chapter describes the Modbus/TCP communication protocol for the adapter module.

## Modbus/TCP

Modbus/TCP is a variant of the Modbus family of simple, vendor neutral communication protocols intended for supervision and control of automation equipment. Specifically, it covers the use of Modbus messaging over TCP connection on an IP network.

The FENA adapter module acts as a Modbus/TCP server with support for the ABB Drives and Transparent profiles. The adapter module also supports Modbus over UDP. The only difference between Modbus/TCP and Modbus/UDP is that in Modbus/UDP the transport layer protocol is UDP instead of TCP.



The supported Modbus commands are listed in section *Function codes* on page *100*. Two simultaneous Modbus/TCP connections are supported, that is, two clients can be connected to the adapter module at a time.

For information of the port used with Modbus/TCP or Modbus/UDP, see *TCP and UDP service ports* on page *417*.

Further information on the Modbus/TCP protocol is available at www.modbus.org.

## Register addressing

The address field of Modbus Requests for accessing Holding registers is 16 bits. This allows the Modbus protocol to support addressing of 65536 Holding registers.

Historically, Modbus client devices used 5-digit decimal addresses from 40001 to 49999 to represent Holding register addresses. 5-digit decimal addressing limited to 9999 the number of holding registers that could be addressed.

Modern Modbus client devices typically provide a means to access the full range of 65536 Modbus Holding registers. One of these methods is to use 6-digit decimal addresses from 400001 to 465536. This manual uses 6-digit decimal addressing to represent Modbus Holding register addresses.

Modbus client devices that are limited to 5-digit decimal addressing may still access registers 400001 to 409999 by using 5-digit decimal addresses 40001 to 49999. Registers 410000-465536 are inaccessible to these clients.

## Function codes

The adapter module supports the Modbus function codes shown below.



| Function code | Name | Description |
|---|---|---|
| 03h | Read Holding Registers | Reads the contents of a contiguous block of holding registers in a server device. |
| 06h | Write Single Register | Writes a single holding register in a server device. |
| 10h | Write Multiple Registers | Writes the contents of a contiguous block of holding registers in a server device. |

| Function code | Name | Description |
|---|---|---|
| 17h | Read/Write Multiple Registers | Writes the contents of a contiguous block of holding registers in a server device, then reads the contents of a contiguous block of holding registers (same or different than those written) in a server device. |
| 2Bh/0Eh | Encapsulated Interface Transport / Read Device Identification | Allows reading identification and other information of the server.<br>Parameter "Read Device ID code" allows one to define three access types:<br>• 01: Request to get the basic device identification (stream access)<br>• 02: Request to get the regular device identification (stream access)<br>• 04: Request to get one specific identification object (individual access). |

## Encapsulated Interface Transport / Read Device Identification

The adapter module supports the Modbus EIT/RDI objects shown below.



| Object ID | Name |
|---|---|
| 00h | Vendor Name |
| 01h | Product Code |
| 02h | Major/Minor Revision |
| 03h | Vendor URL |
| 04h | Product Name |

## Exception codes

The adapter module supports the Modbus exception codes shown below.

| Exception Code | Name | Description |
|---|---|---|
| 01h | ILLEGAL FUNCTION | The function code received in the query is not an allowable action for the server. |
| 02h | ILLEGAL DATA ADDRESSS | The data address received in the query is to an allowable address for the server. |
| 03h | ILLEGAL DATA VALUE | A value contained in the query data field is not an allowable value for the server. |
| 04h | SLAVE DEVICE FAILURE | An unrecoverable error occurred while the server was attempting to perform the requested action. |
| 06h | SLAVE DEVICE BUSY | The server is engaged in processing a long-duration command. The client should retransmit the message later when the server is free. |

## Communication profiles

Modbus is an application layer messaging protocol. It describes how data is transferred between the client and a server, but not the meaning of that data. Communication profiles are used to define the meaning of the data.

## ABB Drives profile - Classic

The ABB Drives profile - Classic communication profile provides register mapped access to the control, status, reference and actual values of the ABB Drives profile in the classic format for backward compatibility.

| Register Address[1)] | Register Data (16-bit) |
|---|---|
| (4)00001 | ABB Drives Profile Control |
| (4)00002 | ABB Drives Profile Reference 1 |
| (4)00003 | ABB Drives Profile Reference 2 |
| (4)00004 | ABB Drives Profile Status |
| (4)00005 | ABB Drive Profile Actual 1 |
| (4)00006 | ABB Drive Profile Actual 2 |
| (4)00101…(4)09999 | Drive Parameter Access (16-bit)<br>Register Address = (4)00000 + 100 × Group + Index<br>Example for Drive Parameter 3.18:<br>(4)00000 + 100 × 3 + 18 = 400318<br>**Note**: Addressing depends on the address mode selected with parameter 23 in group A (51/151, 54/154). |
| (4)20000…(4)29999 | Drive Parameter Access (32-bit)<br>(not supported with ACS355):<br>Register Address = (4)20000 + 200 × Group + 2 × Index<br>Example for Drive Parameter 1.27:<br>(4)20000 + 200 × 1 + 2 × 27 = 420254<br>**Note**: Addressing depends on the address mode selected with parameter 23 in group A (51/151, 54/154). |

1) 6-digit register addressing ([4]00001) is used instead of 5-digit register addressing ([4]0001) to describe the register map. See section *Register addressing* on page *100* for additional information.

## ABB Drives profile - Enhanced

The ABB Drives profile - Enhanced communication profile provides register mapped access to the control, status, reference and actual values of the ABB Drives profile. The mapping of the registers has been enhanced to allow writing of control and reading of status in a single Read/Write Multiple Register request.

| Register Address [1), 2)] | Register Data (16-bit) |
|---|---|
| (4)00001 | ABB Drives Profile Control |
| (4)00002 | ABB Drives Profile Reference 1 |
| (4)00003 | ABB Drives Profile Reference 2 |
| (4)00004 | DATA OUT 1 |
| (4)00005 | DATA OUT 2 |
| (4)00006 | DATA OUT 3 |
| (4)00007 | DATA OUT 4 |
| (4)00008 | DATA OUT 5 |
| (4)00009 | DATA OUT 6 |
| (4)00010 | DATA OUT 7 |
| (4)00011 | DATA OUT 8 |
| (4)00012 | DATA OUT 9 |
| (4)00013 | DATA OUT 10 |
| (4)00014 | DATA OUT 11 |
| (4)00015 | DATA OUT 12 |
| (4)00051 | ABB Drives Profile Status |
| (4)00052 | ABB Drive Profile Actual 1 |
| (4)00053 | ABB Drive Profile Actual 2 |
| (4)00054 | DATA IN 1 |
| (4)00055 | DATA IN 2 |
| (4)00056 | DATA IN 3 |
| (4)00057 | DATA IN 4 |
| (4)00058 | DATA IN 5 |
| (4)00059 | DATA IN 6 |

M

| Register Address [1), 2)] | Register Data (16-bit) |
|---|---|
| (4)00060 | DATA IN 7 |
| (4)00061 | DATA IN 8 |
| (4)00062 | DATA IN 9 |
| (4)00063 | DATA IN 10 |
| (4)00064 | DATA IN 11 |
| (4)00065 | DATA IN 12 |
| (4)00101…(4)09999 | Drive Parameter Access (16-bit)<br>Register Address = (4)00000 + 100 × Group + Index<br>Example for Drive Parameter 3.18:<br>(4)00000 + 100 × 3 + 18 = 400318<br>**Note**: Addressing depends on the address mode selected with parameter 23 in group A (51/151, 54/154). |
| (4)20000…(4)29999 | Drive Parameter Access (32-bit)<br>(not supported with ACS355):<br>Register Address = (4)20000 + 200 × Group + 2 × Index<br>Example for Drive Parameter 1.27:<br>(4)20000 + 200 × 1 + 2 × 27 = 420254<br>**Note**: Addressing depends on the address mode selected with parameter 23 in group A (51/151, 54/154). |

1) 6-digit register addressing ([4]00001) is used instead of 5-digit register addressing ([4]0001) to describe register map. See section *Register addressing* on page *100* for additional information.

2) Register addresses of the 32-bit parameters cannot be accessed by using 5-digit register numbers.

## Transparent 16-bit

The Transparent 16-bit communication profile provides unaltered 16-bit access to the configured drive profile.

| Register Address [1), 2)] | Register Data (16-bit) |
|---|---|
| (4)00001 | Native Drive Profile Control |
| (4)00002 | Native Drive Profile Reference 1 |
| (4)00003 | Native Drive Profile Reference 2 |
| (4)00004 | DATA OUT 1 |
| (4)00005 | DATA OUT 2 |
| (4)00006 | DATA OUT 3 |
| (4)00007 | DATA OUT 4 |
| (4)00008 | DATA OUT 5 |
| (4)00009 | DATA OUT 6 |
| (4)00010 | DATA OUT 7 |
| (4)00011 | DATA OUT 8 |
| (4)00012 | DATA OUT 9 |
| (4)00013 | DATA OUT 10 |
| (4)00014 | DATA OUT 11 |
| (4)00015 | DATA OUT 12 |
| (4)00051 | Native Drive Profile Status |
| (4)00052 | Native Drive Profile Actual 1 |
| (4)00053 | Native Drive Profile Actual 2 |
| (4)00054 | DATA IN 1 |
| (4)00055 | DATA IN 2 |
| (4)00056 | DATA IN 3 |
| (4)00057 | DATA IN 4 |
| (4)00058 | DATA IN 5 |
| (4)00059 | DATA IN 6 |
| (4)00060 | DATA IN 7 |
| (4)00061 | DATA IN 8 |

| Register Address [1), 2)] | Register Data (16-bit) |
|---|---|
| (4)00062 | DATA IN 9 |
| (4)00063 | DATA IN 10 |
| (4)00064 | DATA IN 11 |
| (4)00065 | DATA IN 12 |
| (4)00101…(4)19999 | Drive Parameter Access (16-bit)<br>Register Address = 400000 + 100 × Group + Index<br>Example for Drive Parameter 3.18:<br>(4)00000 + 100 × 3 + 18 = 400318<br>**Note**: Addressing depends on the address mode selected with parameter 23 in group A (51/151, 54/154). |
| (4)20000…(4)29999 | Drive Parameter Access (32-bit)<br>(not supported with ACS355):<br>Register Address = (4)20000 + 200 × Group + 2 × Index<br>Example for Drive Parameter 1.27:<br>(4)20000 + 200 × 1 + 2 × 27 = 420254<br>**Note**: Addressing depends on the address mode selected with parameter 23 in group A (51/151, 54/154). |

1) 6-digit register addressing ([4]00001) is used instead of 5-digit register addressing ([4]0001) to describe register map. See section *Register addressing* on page *100* for additional information.

2) Register addresses of the 32-bit parameters cannot be accessed by using 5-digit register numbers.

## Transparent 32-bit

The Transparent 32-bit communication profile provides unaltered 32-bit access to the configured drive profile.

| Register Address [1), 2)] | Register Data (16-bit) |
|---|---|
| (4)00001 | Native Drive Profile Control - Least Significant 16-bits |
| (4)00002 | Native Drive Profile Control - Most Significant 16-bits |
| (4)00003 | Native Drive Profile Reference 1 - Least Significant 16-bits |
| (4)00004 | Native Drive Profile Reference 1 - Most Significant 16-bits |
| (4)00005 | Native Drive Profile Reference 2 - Least Significant 16-bits |
| (4)00006 | Native Drive Profile Reference 2 - Most Significant 16-bits |
| (4)00007 | DATA OUT 1 |
| (4)00008 | DATA OUT 2 |
| (4)00009 | DATA OUT 3 |
| (4)00010 | DATA OUT 4 |
| (4)00011 | DATA OUT 5 |
| (4)00012 | DATA OUT 6 |
| (4)00013 | DATA OUT 7 |
| (4)00014 | DATA OUT 8 |
| (4)00015 | DATA OUT 9 |
| (4)00016 | DATA OUT 10 |
| (4)00017 | DATA OUT 11 |
| (4)00018 | DATA OUT 12 |
| (4)00051 | Native Drive Profile Status - Least Significant 16-bits |
| (4)00052 | Native Drive Profile Status - Most Significant 16-bits |
| (4)00053 | Native Drive Profile Actual 1 - Least Significant 16-bits |

| Register Address [1), 2)] | Register Data (16-bit) |
|---|---|
| (4)00054 | Native Drive Profile Actual 1 - Most Significant 16-bits |
| (4)00055 | Native Drive Profile Actual 2 - Least Significant 16-bits |
| (4)00056 | Native Drive Profile Actual 2 - Most Significant 16-bits |
| (4)00057 | DATA IN 1 |
| (4)00058 | DATA IN 2 |
| (4)00059 | DATA IN 3 |
| (4)00060 | DATA IN 4 |
| (4)00061 | DATA IN 5 |
| (4)00062 | DATA IN 6 |
| (4)00063 | DATA IN 7 |
| (4)00064 | DATA IN 8 |
| (4)00065 | DATA IN 9 |
| (4)00066 | DATA IN 10 |
| (4)00067 | DATA IN 11 |
| (4)00068 | DATA IN 12 |

| Register Address [1), 2)] | Register Data (16-bit) |
|---|---|
| (4)00101…(4)09999 | Drive Parameter Access (16-bit)<br>Register Address = (4)00000 + 100 × Group + Index<br>Example for Drive Parameter 3.18:<br>(4)00000 + 100 × 3 + 18 = 400318<br>**Note**: Addressing depends on the address mode selected with parameter 23 in group A (51/151, 54/154). |
| (4)20000…(4)29999 | Drive Parameter Access (32-bit)<br>(not supported with ACS355): in group A (51/151, 54/154)<br>Register Address = (4)20000 + 200 × Group + 2 × Index<br>Example for Drive Parameter 1.27:<br>(4)20000 + 200 × 1 + 2 × 27 = 420254<br>**Note**: Addressing depends on the address mode selected with parameter 23 in group A (51/151, 54/154). |

1) 6-digit register addressing ([4]00001) is used instead of 5-digit register addressing ([4]0001) to describe register map. See section *Register addressing* on page *100* for additional information.

2) Register addresses of the 32-bit parameters cannot be accessed by using 5-digit register numbers.

9

# Modbus/TCP – Diagnostics

## Contents of this chapter

This chapter explains how to trace faults with the status LEDs on the adapter module when the module is used for Modbus/TCP communication.

## Fault and warning messages

For the fault and warning messages concerning the adapter module, see the drive firmware manual.

## LEDs

The adapter module is equipped with three bicolor diagnostic LEDs. The LEDs are described below.




| Name | Color | Function |
|---|---|---|
| HOST | Blinking green | Establishing communication to host |
| | Green | Connection to host OK |
| | Blinking red | Communication to host lost temporarily |
| | Blinking orange, alternating with the MODULE blinking orange | Internal file system error. The error may be cleared by cycling drive power. If the error persists, contact your local ABB representative. |




| Name | Color | Function |
|---|---|---|
| MODULE | Off | There is no power applied to the device. |
| | Flashing orange | Device is attempting to obtain IP configuration from the DHCP server. |
| | Orange | Device is executing Duplicate Address Detection. |
| | Flashing green | Device is waiting for a Modbus request. |
| | Green | Device has received a Modbus request within the Modbus/TCP Timeout period. |
| | Flashing red | Ethernet link is down. |
| | Red | Ethernet interface is disabled. Duplicate Address Detection may have detected a duplicate address. Check the IP configuration and either initiate a Fieldbus Adapter parameter refresh or cycle power to the drive. |
| | Flashing orange, alternating with the HOST flashing orange | Internal file system error. The error may be cleared by cycling drive power. If the error persists, contact your local ABB representative. |
| NETWORK /NET | Off | Ethernet link is down. |
| | Flashing green | Ethernet link is up at 100 Mbps.<br>Flashing indicates activity on interface. |
| | Flashing orange | Ethernet link is up at 10 Mbps.<br>Flashing indicates activity on interface. |

## Internal error code registers

A Modbus query can fail in many ways in the drive. The Modbus standard does not specify detailed error descriptions. In addition to the standard error codes, the FENA adapter module provides an internal error register area for more detailed diagnostics.

The internal error register area is used if Modbus error code 0x04 occurs. The registers contain information about the last query. You can figure out the reason of the failure by reading the registers. The internal error register is cleared when a query has finished successfully.

| Address | Registers (16-bit word) |
|---|---|
| (4)00090 | Reset internal error registers (0 = Do nothing, 1 = Reset) |
| (4)00091 | Function code of the failed query |
| (4)00092 | Internal error code; see the error number. |
| (4)00093 | Failed register |
| (4)00094 | Last register that was written successfully |
| (4)00095 | Last register that was read successfully |

| Error code | Description | Situation |
|---|---|---|
| 0x00 | No error | Used when a Modbus query was successful |
| 0x02 | Low or high limit exceeded | Change access with a value outside the value limits |
| 0x03 | Faulty subindex | Access to an unavailable subindex of an array parameter |
| 0x05 | Incorrect data type | Change access with a value that does not match the data type of the parameter |
| 0x65 | General error in drive communication | Undefined error when handling a Modbus query |
| 0x66 | Timeout | Timeout in drive communication when handling a Modbus query |
| 0x70 | Read-only | An attempt to write a non-zero value to a read-only drive parameter |

| Error code | Description | Situation |
|---|---|---|
| 0x71 | Parameter group ended | An attempt to write to multiple parameter groups |
| 0x72 | MSB is not zero | An attempt to write a 16-bit parameter with a 32-register address and the MSB bytes are not zero |
| 0x73 | LSB query start | An attempt to access only the LSB register of the 32-bit parameter |
| 0x74 | MSB query end | An attempt to access only the MSB register of the 32-bit parameter |

# EtherNet/IP protocol

*EtherNet/IP – Start-up* . . . . . 119
*EtherNet/IP – Communication profiles* . . . . . 171
*EtherNet/IP – Communication protocol* . . . . . 193
*EtherNet/IP – Diagnostics* . . . . . 257

E

10

# EtherNet/IP – Start-up

## Contents of this chapter

This chapter contains:

- information on configuring the drive for operation with the adapter module
- drive-specific instructions on starting up the drive with the adapter module
- examples of configuring the client for communication with the adapter module.

## Warnings



**WARNING!** Obey the safety instructions given in this manual and the drive documentation.

# Drive configuration

The information in this section applies to all drive types compatible with the adapter module, unless otherwise stated.

## EtherNet/IP connection configuration

After the adapter module has been mechanically and electrically installed according to the instructions in chapters *Mechanical installation* and *Electrical installation*, you must prepare the drive for communication with the module.

The detailed procedure of activating the module for EtherNet/IP communication with the drive depends on the drive type. Normally, you must adjust a parameter to activate the communication. See the drive-specific start-up sections starting on page *134*.

Once communication between the drive and the adapter module has been established, several configuration parameters are copied to the drive. These parameters are shown in the tables below and must be checked first and adjusted where necessary. You can adjust the parameters via a drive control panel, a PC tool or a web user interface. For more information on the web user interface, see *Appendix C – FENA configuration web pages*.

**Note:**

- Not all drives display descriptive names for the configuration parameters. To help you identify the parameters in different drives, the names displayed by each drive are given in gray boxes in the tables.
- The new parameter settings take effect only when you power up the module the next time or when you activate the fieldbus adapter refresh parameter.

## FENA-01/-11/-21 configuration parameters – group A (group 1)

**Note:** The actual parameter group number depends on the drive type. Group A (group 1) corresponds to:

- parameter group 51 in ACS355, ACS380, ACSM1, ACS480, ACS580, ACS850 and ACQ810
- parameter group is typically 51/54 (group 151/154 in some variants) in ACS880 and ACS880-M04 if the adapter is installed as fieldbus adapter A/B.

| No. | Name/Value | Description | Default |
|---|---|---|---|
| 01 | FBA type | **Read-only.** Shows the fieldbus adapter type as detected by the drive. The value cannot be adjusted by the user.<br>If the value is **0** = None, the communication between the drive and the module has not been established. | **128** = ETHER-NET |
| 02 | Protocol/Profile | Selects the application protocol and communication profile for the network connection.<br>The selections available for EtherNet/IP communication are listed below.<br><br>1) **0** = Modbus/TCP: ABB Drives profile - Classic | **0**[1)] |
| | **100** = EIP AC/DC | EtherNet/IP protocol: ODVA AC/DC drive profile | |
| | **101** = EIP ABB Pro | EtherNet/IP protocol: ABB Drives profile | |
| | **102** = EIP T16 | EtherNet/IP protocol: Transparent 16-bit profile | |
| | **103** = EIP T32 | EtherNet/IP protocol: Transparent 32-bit profile | |
| 03 | Commrate | Sets the bit rate for the Ethernet interface.<br>In FENA-21 this parameter is used for configuring port 1. For configuring port 2, see parameter *14 Commrate Port 2*. | **0** = Auto |
| | **0** = Auto | Autonegotiate | |
| | **1** = 100 Mbps FD | 100 Mbps, full duplex | |
| | **2** = 100 Mbps HD | 100 Mbps, half duplex | |
| | **3** = 10 Mbps FD | 10 Mbps, full duplex | |
| | **4** = 10 Mbps HD | 10 Mbps, half duplex | |

| No. | Name/Value | Description | Default |
|---|---|---|---|
| 04 | IP configuration | Sets the method for configuring the IP address, subnet mask and gateway address for the adapter module. | **1** = Dyn IP DHCP |
| | **0** = Static IP | Configuration will be obtained from parameters *05…13*. | |
| | **1** = Dyn IP DHCP | Configuration will be obtained via DHCP. | |
| 05 | IP address 1 | An IP address is assigned to each IP node on a network. An IP address is a 32-bit number that is typically represented in “dotted decimal” notation consisting of four decimal integers, on the range 0…255, separated by periods. Each integer represents the value of one octet (8-bits) in the IP address. Parameters *05…08* define the four octets of the IP address. | 0 |
| | 0…255 | IP address | |
| … | … | … | … |
| 08 | IP address 4 | See parameter *05 IP address 1*. | 0 |
| | 0…255 | IP address | |

| No. | Name/Value | Description | Default |
|---|---|---|---|
| 09 | Subnet CIDR | Subnet masks are used for splitting networks into smaller networks called subnets. A subnet mask is a 32-bit binary number that splits the IP address into a network address and host address.<br>Subnet masks are typically represented in either dotted decimal notation or the more compact CIDR notation, as shown in the table below. | 0 |

| Dotted decimal | CIDR | Dotted decimal | CIDR |
|---|---|---|---|
| 255.255.255.254 | 31 | 255.254.0.0 | 15 |
| 255.255.255.252 | 30 | 255.252.0.0 | 14 |
| 255.255.255.248 | 29 | 255.248.0.0 | 13 |
| 255.255.255.240 | 28 | 255.240.0.0 | 12 |
| 255.255.255.224 | 27 | 255.224.0.0 | 11 |
| 255.255.255.192 | 26 | 255.224.0.0 | 10 |
| 255.255.255.128 | 25 | 255.128.0.0 | 9 |
| 255.255.255.0 | 24 | 255.0.0.0 | 8 |
| 255.255.254.0 | 23 | 254.0.0.0 | 7 |
| 255.255.252.0 | 22 | 252.0.0.0 | 6 |
| 255.255.248.0 | 21 | 248.0.0.0 | 5 |
| 255.255.240.0 | 20 | 240.0.0.0 | 4 |
| 255.255.224.0 | 19 | 224.0.0.0 | 3 |
| 255.255.192.0 | 18 | 192.0.0.0 | 2 |
| 255.255.128.0 | 17 | 128.0.0.0 | 1 |
| 255.255.0.0 | 16 | | |

| | | | |
|---|---|---|---|
| | 1…31 | Subnet mask in CIDR notation | |
| 10 | GW address 1 | IP gateways connect individual physical IP subnets into a unified IP network. When an IP node needs to communicate with an IP node on another subnet, the IP node sends the data to the IP gateway for forwarding. Parameters *10…13* define the four octets of the gateway address. | 0 |
| | 0…255 | GW address | |
| … | … | … | … |
| 13 | GW address 4 | See parameter *10 GW address 1*. | 0 |
| | 0…255 | GW address | |

| No. | Name/Value | Description | Default |
|---|---|---|---|
| 14 | Commrate Port 2 | Sets the bit rate for the Ethernet port 2.<br>This parameter is used only with FENA-21. | **0** = Auto |
| | **0** = Auto | Autonegotiate | |
| | **1** = 100 Mbps FD | 100 Mbps, full duplex | |
| | **2** = 100 Mbps HD | 100 Mbps, half duplex | |
| | **3** = 10 Mbps FD | 10 Mbps, full duplex | |
| | **4** = 10 Mbps HD | 10 Mbps, half duplex | |
| 15<br>…<br>18 | Reserved | These parameters are not used by the adapter module when the module is configured for EtherNet/IP. | N/A |
| 19 | T16 scale | Defines the reference multiplier/actual value divisor for the adapter module.<br>**Note**: The parameter is effective only when the following conditions are satisfied:<br>• transparent 16 profile is selected<br>• drive is using the native communication profile (e.g., DCU or FBA)<br>• drive is using a 16-bit transparent reference 1/actual value 1.<br>Reference 1 is multiplied by the value of this plus one and the actual value 1 is divided by the value of this plus one. With value 0, the reference 1/actual value 1 scale in the adapter module is 1 = 1.<br><br>With an ACS355 drive: For example, if the parameter has a value 99 and the reference of 1000 is given by the master, the reference is multiplied by 100 (i.e. 99 + 1) and forwarded to the drive as 100000.<br>According to the DCU profile, speed scale is 1000 = 1 rpm. This value is interpreted as a reference of 100 rpm in the drive.<br>With ACSM1, ACS850 and ACQ810, the DCU profile speed scale is approximately 65535 = 1 rpm.<br>With ACS880 and ACS580: Reference 1/actual value 1 base scale in transparent mode is 100 = 1, but using this reference value depends on the application of drive. | 99 |
| | 0…65535 | Reference multiplier/actual value divisor | |

| No. | Name/Value | Description | Default |
|---|---|---|---|
| 20 | Control timeout | Defines the control timeout value.<br>The EtherNet/IP protocol specifies connection timeout for I/O messaging (Class 1) and Connected explicit messaging (Class 3), but not Unconnected explicit messaging.<br>This parameter provides a timeout for Unconnected explicit messaging and for instances of Connected explicit messaging (Class 3), where the client breaks the connection in between requests. | 0 |

| Connection type | Control timeout | Timeout source |
|---|---|---|
| I/O messaging (Class 1) | 0…65535 | (Requested Packet Interval) X (Connection Timeout Multiplier)<br>**Note:** Timeout behavior may be modified by Watchdog Timeout Action attribute of Connection object. |
| Connected explicit messaging (Class 3) | 0 | (Requested Packet Interval) X (Connection Timeout Multiplier)<br>**Note:** Timeout behavior may be modified by Watchdog Timeout Action attribute of Connection object. |
| | 1…65534 | 100ms X (Control Timeout Value) since last Control Event |
| | 65535 | Never Timeout |
| Unconnected explicit messaging | 0 | Always Timeout<br>**Note:** Control Timeout must be greater than zero to control drive with Unconnected Explicit Messaging. |
| | 1…65534 | 100ms X (Control Timeout Value) since last Control Event |
| | 65535 | Never Timeout |

| No. | Name/Value | Description | Default |
|---|---|---|---|
| | | Control timeout events:<br>• Write of an output assembly object instance<br>• Write of control bits (Run1, Run2, NetCtrl, NetRef and FaultReset)<br>• Write Speed Reference<br>• Write Torque Reference<br>• Reset Control Supervisor object<br>• Write Force Fault via Control Supervisor object<br>If a timeout occurs, the adapter module signals the drive that communication with the client has been lost. The drive configuration then determines how to respond.<br>**Example:** If the timeout is 250 ms and the drive is configured to fault on a communication failure with a delay of 500 ms, then the drive will fault 750 ms after communications is lost. | |
| | 0…65535 | Control timeout value | |
| 21 | Idle action | I/O connections may include a Run/Idle notification. This parameter determines the action the drive takes in response to an Idle notification. | **0** = Off-line |
| | **0** = Off-line | In the event of an Idle notification, the adapter module signals the drive that communication with the client has been lost. The drive configuration then determines how to respond.<br>**Example:** If the timeout is 250 ms and the drive is configured to fault on a communication failure with a delay of 500 ms, then the drive will fault 750 ms after communications is lost. | |
| | **1** = On-line | In the event of an Idle notification, the drive will continue to operate using the last command and references received. | |
| 22 | Stop function | Determines how the motor is to be stopped when a stop command is received via EtherNet/IP.<br>This parameter only applies to the ODVA AC/DC drive profile. | **0** = Ramp |
| | **0** = Ramp | The motor decelerates along the active deceleration ramp. | |
| | **1** = Coast | The motor comes to a stop by coasting. | |

| No. | Name/Value | Description | Default |
|---|---|---|---|
| 23 | Speed scale | This parameter only applies to the ODVA AC/DC drive profile. The units of reference and actual speeds for the ODVA AC/DC drive profile are given by the formula below.<br><br>Speed unit = RPM × $2^{(-1 \times \text{ODVA speed scale value})}$<br><br>**Note:** While a wide range of resolutions may be configured, the actual performance is limited to the performance capabilities of the drive.<br>The table below shows the how the drive ODVA speed scale parameter values correspond to the ODVA speed scale units. | 128 |

| ODVA speed scale value[1)] | Speed scale value of drive parameter[2)] | Unit |
|---|---|---|
| -5 | 123 | 32 RPM |
| -4 | 124 | 16 RPM |
| -3 | 125 | 8 RPM |
| -2 | 126 | 4 RPM |
| -1 | 127 | 2 RPM |
| 0 (default) | 128 | 1 RPM |
| 1 | 129 | 0.5 RPM |
| 2 | 130 | 0.25 RPM |
| 3 | 131 | 0.125 RPM |
| 4 | 132 | 0.0625 RPM |
| 5 | 133 | 0.03125 RPM |

1) Use the ODVA speed scale value when reading/writing parameter *Speed scale* via *AC/DC-drive object, class 2Ah*. When written via the AC/DC drive object, the new value takes effect immediately.

2) Use the speed scale value of the drive parameter when reading/writing parameter *Speed scale* via the drive control panel, *Drive parameter object, class 90h* and *Fieldbus configuration object, class 91h*. When written via these methods, the new value takes effect after the drive is re-powered or a “Fieldbus Adapter Parameter refresh” is given.

| | | |
|---|---|---|
| 0…255 | Speed scale value of drive parameter | |

| No. | Name/Value | Description | Default |
|---|---|---|---|
| 24 | Torque scale | This parameter only applies to the ODVA AC/DC drive profile. The units of reference and actual torques for the ODVA AC/DC drive profile are given by the formula below.<br><br>Torque unit = N·m × $2^{(-1 \times \text{ODVA torque scale})}$<br><br>where:<br>(N·m = Newton × Meter)<br><br>**Note:** While a wide range of resolutions may be configured, the actual performance is limited to the performance capabilities of the drive.<br>The table below shows the how the drive ODVA torque scale parameter values correspond to the ODVA torque scale units. | 128 |

| ODVA torque scale value[1] | Torque scale value of drive parameter[2] | Unit |
|---|---|---|
| -5 | 123 | 32 N·m |
| -4 | 124 | 16 N·m |
| -3 | 125 | 8 N·m |
| -2 | 126 | 4 N·m |
| -1 | 127 | 2 N·m |
| 0 (default) | 128 | 1 N·m |
| 1 | 129 | 0.5 N·m |
| 2 | 130 | 0.25 N·m |
| 3 | 131 | 0.125 N·m |
| 4 | 132 | 0.0625 N·m |
| 5 | 133 | 0.03125 N·m |

[1] Use the ODVA torque scale value when reading/writing parameter *Torque scale* via *AC/DC-drive object, class 2Ah*. When written via the AC/DC drive object, the new value takes effect immediately.

[2] Use the torque scale value of the drive parameter when reading/writing parameter *Torque scale* via the drive control panel, *Drive parameter object, class 90h* and *Fieldbus configuration object, class 91h*. When written via these methods, the new value takes effect after the drive is re-powered or a “Fieldbus Adapter Parameter refresh” is given.

| | | |
|---|---|---|
| 0…255 | Torque scale value of drive parameter | |

| No. | Name/Value | Description | Default |
|---|---|---|---|
| 25<br>…<br>26 | Reserved for web page functionality.<br><br>For more information, see *Appendix C – FENA configuration web pages*. | These parameters are not used by the adapter module when the module is configured for EtherNet/IP. | N/A |
| 27 | FBA A/B par refresh | Validates any changed adapter module configuration parameter settings. After refreshing, the value reverts automatically to **0** = Done.<br>**Note:** This parameter cannot be changed while the drive is running. | **0** = Done |
| | **0** = Done | Refreshing done | |
| | **1** = Refresh | Refreshing | |
| 28 | FBA A/B par table ver | **Read-only.** Displays the parameter table revision of the fieldbus adapter module mapping file stored in the memory of the drive. In format **xyz**, where<br>**x** = major revision number<br>**y** = minor revision number<br>**z** = correction number<br>OR<br>in format **axyz**, where<br>**a** = major revision number<br>**xy** = minor revision numbers<br>**z** = correction number or letter. | N/A |
| | | Parameter table revision | |
| 29 | FBA A/B drive type code | **Read-only.** Displays the drive type code of the fieldbus adapter module mapping file stored in the memory of the drive. | N/A |
| | | Drive type code of the fieldbus adapter module mapping file | |
| 30 | FBA A/B mapping file ver | **Read-only.** Displays the fieldbus adapter module mapping file revision stored in the memory of the drive in decimal format. | N/A |
| | | Mapping file revision | |
| 31 | D2FBA A/B comm status | **Read-only.** Displays the status of the fieldbus adapter module communication.<br>**Note:** The value names may vary by drive. | **0** = Idle<br>OR<br>**4** = Off-line |
| | **0** = Idle | Adapter is not configured. | |

| No. | Name/Value | Description | Default |
|---|---|---|---|
| | **1** = Exec.init | Adapter is initializing. | |
| | **2** = Time out | A timeout has occurred in the communication between the adapter and the drive. | |
| | **3** = Conf.err | Adapter configuration error: The major or minor revision code of the common program revision in the fieldbus adapter module is not the revision required by the module or mapping file upload has failed more than three times. | |
| | **4** = Off-line | Adapter is off-line. | |
| | **5** = On-line | Adapter is on-line. | |
| | **6** = Reset | Adapter is performing a hardware reset. | |
| 32 | FBA A/B comm SW ver | **Read-only.** Displays firmware patch and build number of the adapter module in the **xxyy** format, where:<br>**xx** = patch number<br>**yy** = build number<br>Example: C80D ≥ 200.13<br>or 0 ≥ 0.0 | N/A |
| | | Common program version of the adapter module | |
| 33 | FBA A/B appl SW ver | **Read-only.** Displays firmware version of the adapter module in xxyy format, where:<br>**xx = major revision number**<br>**yy = minor revision number**<br>Example: 310 = 3.10<br>Version number is the form:<br><major>.<minor>.<patch>.<build><br>Example: 3.10.200.13<br>or 3.10.0.0 | N/A |
| | | Application program revision of the adapter module | |

## FENA-01/-11/-21 configuration parameters – group B (group 2)

**Note:** The actual parameter group number depends on the drive type. Group B (group 2) corresponds to:

- parameter group 55 in ACS355
- parameter group 53 in ACSM1, ACS380, ACS480, ACS580, ACS850 and ACQ810
- parameter group is typically 53/56 (group 153/156 in some variants) in ACS880 and ACS880-M04 if the adapter is installed as fieldbus adapter A/B.

| No.[1] | Name/Value | Description | Default |
|---|---|---|---|
| 01 | FBA A/B data out1 (client to drive) | In output assembly instances that include drive parameters, this parameter specifies which parameter's value will be placed in location Data out 1 value received by the drive from the EtherNet/IP client.<br>The content is defined by a decimal number in the range of 0 to 9999 as follows:<br>0 – Not used<br>1…99 – Virtual address area of drive control. Not used when the EtherNet/IP protocol is used.<br>101…9999 – Parameter area of the drive | **0** = None |
| | **0** = None | Not used | |
| | 101…9999 | Parameter index with format **xxyy**, where<br>• **xx** is the parameter group number (1…99)<br>• **yy** is the parameter number index within that group (01…99).<br>**Note:** In ACS480, ACS580 and ACS880, choose **Other** to display a list of mappable drive parameters. | |
| 02…10 | Data out 2 … Data out 10 | See parameter *01 FBA A/B data out1*. | **0** = None |

[1] The number of parameters in this group may vary by drive type and drive firmware.

## FENA-01/-11/-21 configuration parameters – group C (group 3)

**Note:** The actual parameter group number depends on the drive type. Group C (group 3) corresponds to:

- parameter group 54 in ACS355
- parameter group 52 in ACSM1, ACS380, ACS480, ACS580, ACS850 and ACQ810
- parameter group is typically 52/55 (group 152/155 in some variants) in ACS880 and ACS880-M04 if the adapter is installed as fieldbus adapter A/B.

<table>
<tr><th>No.[1)]</th><th>Name/Value</th><th>Description</th><th>Default</th></tr>
<tr><td>01</td><td>FBA A/B data in1 (drive to client)</td><td>In input assembly instances that include drive parameters, this parameter specifies which parameter’s value will be placed in location Data in 1 value sent by the drive to the EtherNet/IP client.<br>The content is defined by a decimal number in the range of 0 to 9999 as follows:<table><tr><td>0</td><td>Not used</td></tr><tr><td>1…99</td><td>Virtual address area of drive control. Not used when the EtherNet/IP protocol is used.</td></tr><tr><td>101… 9999</td><td>Parameter area of the drive</td></tr></table></td><td>0 = None</td></tr>
<tr><td></td><td>0 = None</td><td>Not used</td><td></td></tr>
<tr><td></td><td>101…9999</td><td>Parameter index with format xxyy, where<br>• xx is the parameter group number (1…99)<br>• yy is the parameter number index within that group (01…99).<br>Note: In ACS480, ACS580 and ACS880, choose Other to display a list of mappable drive parameters.</td><td></td></tr>
<tr><td>02… 10</td><td>Data in 2 … Data in 10</td><td>See parameter 01 FBA A/B data in1.</td><td>0 = None</td></tr>
</table>

[1)] The number of parameters in this group may vary by drive type and drive firmware.

## Control locations

ABB drives can receive control information from multiple sources including digital inputs, analog inputs, the drive control panel and a fieldbus adapter module. ABB drives allow the user to separately determine the source for each type of control information (Start, Stop, Direction, Reference, Fault reset, etc.).

To give the fieldbus client the most complete control over the drive, you must select the adapter module as the source of this information. The drive-specific parameter setting examples below contain the drive control parameters relevant in the examples. For a complete parameter list, see the drive documentation.

## Starting up fieldbus communication for ACS355 drives

1. Power up the drive.
2. Enable the communication between the adapter module and the drive with parameter **9802 COMM PROT SEL**.
3. Set the module configuration parameters in group 51.

   At the minimum, select the communication protocol and profile with parameter **5102** and configure the network settings with parameters **5103**…**5113**.
4. With parameter **3018 COMM FAULT FUNC**, select how the drive reacts to a fieldbus communication break.
5. With parameter **3019 COMM FAULT TIME**, define the time between communication break detection and the selected action.
6. Define the process data transferred to and from the drive in parameter groups 54 and 55.

   **Note:** The adapter module assigns the Control word, Status word, references 1…2 and actual values 1…2 automatically to cyclical communication according to the selected assembly instances.
7. Validate the settings made in parameter groups 51, 54 and 55 with parameter **5127 FBA PAR REFRESH**.
8. Set the relevant drive control parameters to control the drive according to the application.

   Examples of appropriate values are shown in the tables below.

## Parameter setting examples – ACS355

### Speed control using the ODVA AC/DC drive profile, Extended speed control assembly

This example shows how to configure a speed control application that uses the ODVA AC/DC drive profile, Extended speed control assembly. In addition, some application-specific data is added to the communication.

The start/stop commands and reference scaling are according to the ODVA AC/DC drive profile. For more information, see section *ODVA AC/DC drive profile* on page *173*.

When Reference 1 (REF1) is used for speed control and the parameter **5123** value is 128, an ODVA speed reference value of ±30000 (decimal) corresponds to an equal amount of rpm in the drive. The reference value sent from the PLC is limited by parameter **1105 REF1 MAX** in the forward and reverse directions.

The minimum and maximum 16-bit integer values that can be given through the fieldbus are -32768 and 32767 respectively.

| Bytes | Instance 121 | Instance 171 |
|---|---|---|
| 0…1 | Control word | Status word |
| 2…3 | Speed reference | Speed actual value |
| 4…5 | Constant speed 1[1)] | Power[1)] |
| 6…7 | Constant speed 2[1)] | DC bus voltage[1)] |

[1)] Example

The table below gives the recommended drive parameter settings.

| Drive parameter | Setting for ACS355 drives | Description |
|---|---|---|
| 9802 COMM PROT SEL | **4** = EXT FBA | Enables communication between the drive and the fieldbus adapter module. |
| 5101 FBA TYPE | ETHERNET[1)] | Displays the type of the fieldbus adapter module. |
| 5102 FB PAR 2 (PROTOCOL/PROFILE) | **100** (= EIP AC/DC) | Selects the EtherNet/IP protocol and the ODVA AC/DC drive profile. |

| Drive parameter | Setting for ACS355 drives | Description |
|---|---|---|
| 5103 FB PAR 3 (COMMRATE) | **0** (= Auto)[2)] | Ethernet communication rate is negotiated automatically by the device. |
| 5104 FB PAR 4 (IP CONFIGURATION) | **0** (= Static IP)[2)] | Configuration will be obtained from parameters *05...13*. |
| 5105 FB PAR 5 (IP ADDRESS 1) | 192[2)] | First part of the IP address |
| 5106 FB PAR 6 (IP ADDRESS 2) | 168[2)] | Second part of the IP address |
| 5107 FB PAR 7 (IP ADDRESS 3) | 0[2)] | Third part of the IP address |
| 5108 FB PAR 8 (IP ADDRESS 4) | 16[2)] | Last part of the IP address |
| 5123 FB PAR 23 (ODVA SPEED SCALE) | 128[2)] | Sets the scaling for the ODVA speed reference. |
| 3018 COMM FAULT FUNC | **1** = FAULT[2)] | Enables fieldbus communication fault monitoring. |
| 3019 COMM FAULT TIME | 3.0 s[2)] | Defines the fieldbus communication break supervision time. |
| 5401 FBA DATA IN 1 | 106[2)] | Power |
| 5402 FBA DATA IN 2 | 107[2)] | DC bus voltage |
| 5501 FBA DATA OUT 1 | 1202[2)] | Constant speed 1 |
| 5502 FBA DATA OUT 2 | 1203[2)] | Constant speed 2 |
| 5127 FBA PAR REFRESH | **1** = REFRESH | Validates the FENA-01/-11/-21 configuration parameter settings. |
| 9904 MOTOR CTRL MODE | **1** = VECTOR: SPEED | Selects the speed control mode as the motor control mode. |
| 1001 EXT1 COMMANDS | **10** = COMM | Selects the fieldbus interface as the source of the start and stop commands for external control location 1. |
| 1103 REF1 SELECT | **8** = COMM | Selects the fieldbus reference 1 as the source for speed reference 1. |

| Drive parameter | Setting for ACS355 drives | Description |
|---|---|---|
| 1601 RUN ENABLE | **7** = COMM | Selects the fieldbus interface as the source for the inverted Run enable signal (Run disable). |
| 1604 FAULT RESET SEL | **8** = COMM | Selects the fieldbus interface as the source for the fault reset signal. |

[1] Read-only or automatically detected/set
[2] Example

The start sequence for the parameter example above is given below.

Control word:

- Reset the fieldbus communication fault (if active).
- Enter 0h (0 decimal) → READY.
- Enter 1h (1 decimal) → ENABLED (Running forward)

  or

  Enter 2h (2 decimal) → ENABLED (Running reverse).

## Starting up fieldbus communication for ACSM1 drives

1. Power up the drive.
2. Enable the communication between the adapter module and the drive with parameter **50.01 FBA ENABLE**.
3. With parameter **50.02 COMM LOSS FUNC**, select how the drive reacts to a fieldbus communication break.

   Note that this function monitors both communication between the fieldbus master and the adapter module and communication between the adapter module and the drive.
4. With parameter **50.03 COMM LOSS T OUT**, define the time between communication break detection and the selected action.
5. Select application-specific values for parameters **50.04**…**50.11**.

   Examples of appropriate values are shown in the tables below.
6. Set the module configuration parameters in group 51.

   At the minimum, select the communication protocol and profile with parameter **51.02** and configure the network settings with parameters **51.03**…**51.13**.
7. Define the process data transferred to and from the drive in parameter groups 52 and 53.

   **Note:** The adapter module assigns the Control word, Status word, references 1…2 and actual values 1…2 automatically to cyclical communication according to the selected assembly instances.
8. Validate the settings made in parameter groups 51, 52 and 53 with parameter **51.27 FBA PAR REFRESH**.

9. Set the relevant drive control parameters to control the drive according to the application.

   Examples of appropriate values are shown in the tables below.

## Parameter setting examples – ACSM1

### Speed control using the ODVA AC/DC drive profile, Extended speed control assembly

This example shows how to configure a speed control application that uses the ODVA AC/DC drive profile, Extended speed control assembly. In addition, some application-specific data is added to the communication.

The start/stop commands and reference scaling are according to the ODVA AC/DC drive profile. For more information, see section *ODVA AC/DC drive profile* on page *173*.

When Reference 1 (REF1) is used for speed control and the value of parameter **51.23** is 128, an ODVA speed reference value of ±30000 (decimal) corresponds to an equal amount of rpm in the drive. The speed reference value sent by the PLC is limited by parameter **20.01 MAXIMUM SPEED** in the forward direction and **20.02 MINIMUM SPEED** in the reverse direction.

The minimum and maximum 16-bit integer values that can be given through the fieldbus are -32768 and 32767 respectively.

| Bytes | Instance 121 | Instance 171 |
|---|---|---|
| 0…1 | Control word | Status word |
| 2…3 | Speed reference | Speed actual value |
| 4…7 | Constant speed 1[1)] | Power[1)] |
| 8…11 | Speed reference for jogging function 1[1)] | DC bus voltage[1)] |

[1)] Example

The table below gives the recommended drive parameter settings.

| Drive parameter | Setting for ACSM1 drives | Description |
|---|---|---|
| 50.01 FBA ENABLE | Enable | Enables communication between the drive and the fieldbus adapter module. |
| 50.02 COMM LOSS FUNC | Fault[2)] | Enables fieldbus communication fault monitoring. |
| 50.03 COMM LOSS T OUT | 3.0 s[2)] | Defines the fieldbus communication break supervision time. |
| 50.04 FBA REF1 MODESEL | Speed | Selects the fieldbus reference 1 scaling. |
| 51.01 FBA TYPE | ETHERNET[1)] | Displays the type of the fieldbus adapter module. |
| 51.02 FBA PAR2 (PROTOCOL/PROFILE) | **100** (= EIP AC/DC) | Selects the EtherNet/IP protocol and the ODVA AC/DC drive profile. |
| 51.03 FBA PAR3 (COMMRATE) | **0** (= Auto[2)] | Ethernet communication rate is negotiated automatically by the device. |
| 51.04 FBA PAR4 (IP CONFIGURATION) | **0** (= Static IP)[2)] | Configuration will be obtained from parameters *05*…*13*. |
| 51.05 FBA PAR5 (IP ADDRESS 1) | 192[2)] | First part of the IP address |
| 51.06 FBA PAR6 (IP ADDRESS 2) | 168[2)] | Second part of the IP address |
| 51.07 FBA PAR7 (IP ADDRESS 3) | 0[2)] | Third part of the IP address |
| 51.08 FBA PAR8 (IP ADDRESS 4) | 16[2)] | Last part of the IP address |
| 51.09 FBA PAR9 (SUBNET CIDR) | 24[2)] | Sets the network mask as 255.255.255.0, allowing access only to the last subnet. |
| 51.23 FBA PAR23 (ODVA SPEED SCALE) | 128[2)] | Sets the scaling for the ODVA speed reference. |
| 52.01 FBA DATA IN1 | 122[2)] | Power |
| 52.03 FBA DATA IN3 | 107[2)] | DC bus voltage |
| 53.01 FBA DATA OUT1 | 2408[2)] | Constant speed |

| Drive parameter | Setting for ACSM1 drives | Description |
|---|---|---|
| 53.03 FBA DATA OUT3 | 2410[2)] | Speed reference for jogging function 1 |
| 51.27 FBA PAR REFRESH | REFRESH | Validates the FENA-11/-21 configuration parameter settings. |
| 10.01 EXT1 START FUNC | FBA | Selects the fieldbus interface as the source of the start and stop commands for external control location 1. |
| 24.01 SPEED REF1 SEL | FBA REF1 | Selects the fieldbus reference 1 as the source for speed reference 1. |
| 34.01 EXT1/EXT2 SEL | C.FALSE | Selects that the external control location is always EXT1. |
| 34.03 EXT1 CTRL MODE1 | Speed | Selects speed control as the control mode 1 for external control location 1. |

[1)] Read-only or automatically detected/set
[2)] Example

The start sequence for the parameter example above is given below.

Control word:

- Reset the fieldbus communication fault (if active).
- Enter 0h (0 decimal) → READY.
- Enter 1h (1 decimal) → ENABLED (Running forward).
- Enter 2h (2 decimal) → ENABLED (Running reverse).

## Starting up fieldbus communication for ACS850 and ACQ810 drives

1. Power up the drive.
2. Enable the communication between the adapter module and the drive with parameter **50.01 FBA enable**.
3. With parameter **50.02 Comm loss func**, select how the drive reacts to a fieldbus communication break.

   **Notes:**

   - This function monitors both communication between the fieldbus master and the adapter module and communication between the adapter module and the drive.
   - In ACQ810, you can select the control locations to be monitored with parameter **50.21 Comm loss enable**. By default, the monitoring is enabled in both control locations (EXT1 and EXT2).
4. With parameter **50.03 Comm loss t out**, define the time between communication break detection and the selected action.
5. Select application-specific values for parameters **50.04**…**50.11**.

   Examples of appropriate values are shown in the tables below.
6. Set the module configuration parameters in group 51.

   At the minimum, select the communication protocol and profile with parameter **51.02** and configure the network settings with parameters **51.03**…**51.13**.

7. Define the process data transferred to and from the drive in parameter groups 52 and 53.

   **Note:** The adapter module assigns the Control word, Status word, references 1…2 and actual values 1…2 automatically to cyclical communication according to the selected assembly instances.

8. Validate the settings made in parameter groups 51, 52 and 53 with parameter **51.27 FBA par refresh**.

9. Set the relevant drive control parameters to control the drive according to the application.

   Examples of appropriate values are shown in the tables below.

## Parameter setting examples – ACS850 and ACQ810

### Speed control using the ODVA AC/DC drive profile, Extended speed control assembly

This example shows how to configure a speed control application that uses the ODVA AC/DC drive profile, Extended speed control assembly. In addition, some application-specific data is added to the communication.

The start/stop commands and reference scaling are according to the ODVA AC/DC drive profile. For more information, see section *ODVA AC/DC drive profile* on page *173*.

When Reference 1 (REF1) is used for speed control and the value of parameter **51.23** is 128, an ODVA speed reference value of ±30000 (decimal) corresponds to an equal amount of rpm in the drive. The speed reference value sent from the PLC is limited by parameter **20.01 Maximum speed** in the forward direction and **20.02 Minimum speed** in the reverse direction.

The minimum and maximum 16-bit integer values that can be given through the fieldbus are -32768 and 32767 respectively.

| Bytes | Instance 121 | Instance 171 |
|---|---|---|
| 0…1 | Control word | Status word |
| 2…3 | Speed reference | Speed actual value |
| 4…7 | Constant speed 1[1)] | Power[1)] |
| 8…11 | Constant speed 2[1)] | DC bus voltage[1)] |

[1)] Example

The table below gives the recommended drive parameter settings.

| Drive parameter | Setting for ACS850/ACQ810 drives | Description |
|---|---|---|
| 50.01 Fba enable | Enable | Enables communication between the drive and the fieldbus adapter module. |
| 50.02 Comm loss func | Fault[2)] | Enables fieldbus communication fault monitoring. |
| 50.03 Comm loss t out | 3.0 s[2)] | Defines the fieldbus communication break supervision time. |
| 50.04 Fb ref1 modesel | Speed | Selects the fieldbus reference 1 scaling. |
| 51.01 FBA type | Ethernet[1)] | Displays the type of the fieldbus adapter module. |
| 51.02 FBA par2 (PROTOCOL/PROFILE) | **100** (= EIP AC/DC) | Selects the EtherNet/IP protocol and the ODVA AC/DC drive profile. |
| 51.03 FBA par3 (COMMRATE) | **0** (= Auto)[2)] | Ethernet communication rate is negotiated automatically by the device. |
| 51.04 FBA par4 (IP CONFIGURATION) | **0** (= Static IP)[2)] | Configuration will be obtained from parameters *05…13*. |
| 51.05 FBA par5 (IP ADDRESS 1) | 192[2)] | First part of the IP address |
| 51.06 FBA par6 (IP ADDRESS 2) | 168[2)] | Second part of the IP address |

| Drive parameter | Setting for ACS850/ACQ810 drives | Description |
|---|---|---|
| 51.07 FBA par7 (IP ADDRESS 3) | 0[2)] | Third part of the IP address |
| 51.08 FBA par8 (IP ADDRESS 4) | 16[2)] | Last part of the IP address |
| 51.09 FBA par9 (SUBNET CIDR) | 24[2)] | Sets the network mask as 255.255.255.0, allowing access only to the last subnet. |
| 51.23 FBA par23 (ODVA SPEED SCALE) | 128[2)] | Sets the scaling for the ODVA speed reference. |
| 52.01 FBA data in1 | 122[2)] | Power |
| 52.03 FBA data in3 | 107[2)] | DC bus voltage |
| 53.01 FBA data out1 | 2606[2)] | Constant speed 1 |
| 53.03 FBA data out3 | 2607[2)] | Constant speed 2 |
| 51.27 FBA par refresh | Refresh | Validates the FENA-11/-21 configuration parameter settings. |
| 10.01 Ext1 start func | FB | Selects the fieldbus interface as the source of the start and stop commands for external control location 1. |
| 21.01 Speed ref1 sel (ACS850)<br>21.01 Speed ref sel (ACQ810) | FBA ref1<br>FBA ref1 | Selects the fieldbus reference 1 as the source for speed reference 1. |

[1)] Read-only or automatically detected/set
[2)] Example

The start sequence for the parameter example above is given below.

Control word:

- Reset the fieldbus communication fault (if active).
- Enter 0h (0 decimal) → READY.
- Enter 1h (1 decimal) → ENABLED (Running forward).
- Enter 2h (2 decimal) → ENABLED (Running reverse).

## Starting up fieldbus communication for ACS480, ACS580 and ACS880 drives

1. Power up the drive.
2. Enable the communication between the adapter module and the drive by selecting the correct slot number in parameter **50.01 FBA A enable**.

   The selection must correspond to the slot where the adapter module is installed. For example, if the adapter module is installed in slot 1, you must select slot 1.
3. With parameter **50.02 FBA A comm loss func**, select how the drive reacts to a fieldbus communication break.

   Note that this function monitors both communication between the fieldbus master and the adapter module and communication between the adapter module and the drive.
4. With parameter **50.03 FBA A comm loss t out**, define the time between communication break detection and the selected action.
5. Select application-specific values for the rest of the parameters in group 50, starting from **50.04**.

   Examples of appropriate values are shown in the tables below.
6. Set the module configuration parameters in group 51.

   At the minimum, select the communication protocol and profile with parameter **51.02** and configure the network settings with parameters **51.03**…**51.13**.
7. Define the process data transferred to and from the drive in parameter groups 52 and 53.

   **Note:** The adapter module assigns the Control word, Status word, references 1…2 and actual values 1…2 automatically to cyclical communication according to the selected assembly instances.

8. Save the valid parameter values to permanent memory with parameter **96.07 Parameter save manually**.
9. Validate the settings made in parameter groups 51, 52 and 53 with parameter **51.27 FBA A par refresh**.
10. Set the relevant drive control parameters to control the drive according to the application.

    Examples of appropriate values are shown in the tables below.

## Parameter setting examples – ACS480, ACS580 and ACS880

### Speed control using the ODVA AC/DC drive profile, Extended speed control assembly

This example shows how to configure a speed control application that uses the ODVA AC/DC drive profile, Extended speed control assembly. In addition, some application-specific data is added to the communication.

The start/stop commands and reference scaling are according to the ODVA AC/DC drive profile. For more information, see section *ODVA AC/DC drive profile* on page *173*.

When Reference 1 (REF1) is used for speed control and the value of parameter **51.23** is 128, an ODVA speed reference value of ±30000 (decimal) corresponds to an equal amount of rpm in the drive. The speed reference value sent from the PLC is limited by parameter **30.12 Maximum speed** in the forward direction and **30.11 Minimum speed** in the reverse direction.

The minimum and maximum 16-bit integer values that can be given through the fieldbus are -32768 and 32767 respectively.

| Bytes | Instance 121 | Instance 171 |
|---|---|---|
| 0…1 | Control word | Status word |
| 2…3 | Speed reference | Speed actual value |
| 4…7 | Constant speed 1 [32][1)] | Output power [32][1)] |
| 8…11 | Constant speed 2 [32][1)] | DC voltage [32][1)] |

[1)] Example

The table below gives the recommended drive parameter settings.

| Drive parameter | Setting for ACS480, ACS580 and ACS880 drives | Description |
|---|---|---|
| 50.01 FBA A enable | **1** = Option slot 1[2)] | Enables communication between the drive and the fieldbus adapter module. |
| 50.02 FBA A comm loss func | **1** = Fault[2)] | Enables fieldbus A communication fault monitoring. |
| 50.03 FBA A comm loss t out | 3.0 s[2)] | Defines the fieldbus A communication break supervision time. |
| 50.04 FBA A ref1 type | **4** = Speed | Selects the fieldbus A reference 1 type and scaling. |
| 51.01 FBA A type | **128** = ETHERNET[1)] | Displays the type of the fieldbus adapter module. |
| 51.02 Protocol/Profile | **100** = EIP AC/DC | Selects the EtherNet/IP protocol and the ODVA AC/DC drive profile. |
| 51.03 Commrate | **0** = Auto[2)] | Ethernet communication rate is negotiated automatically by the device. |
| 51.04 IP configuration | **0** = Static IP[2)] | Configuration will be obtained from configuration parameters *05*…*13*. |
| 51.05 IP address 1 | 192[2)] | First part of the IP address |
| 51.06 IP address 2 | 168[2)] | Second part of the IP address |
| 51.07 IP address 3 | 0[2)] | Third part of the IP address |
| 51.08 IP address 4 | 16[2)] | Last part of the IP address |
| 51.09 Subnet CIDR | 24[2)] | Sets the network mask as 255.255.255.0, allowing access only to the last subnet. |
| 51.23 ODVA speed scale | 128[2)] | Sets the scaling for the ODVA speed reference. |
| 52.01 FBA data in1 | 01.14[2)] | Output power |
| 52.03 FBA data in3 | 01.11[2)] | DC voltage |
| 53.01 FBA data out1 | 22.26[2)] | Constant speed 1 |
| 53.03 FBA data out3 | 22.27[2)] | Constant speed 2 |

| Drive parameter | Setting for ACS480, ACS580 and ACS880 drives | Description |
|---|---|---|
| 51.27 FBA A par refresh | **1** = Refresh | Validates the FENA-11/-21 configuration parameter settings. |
| 20.01 Ext1 commands | **12** = Fieldbus A | Selects the fieldbus A interface as the source of the start and stop commands for external control location 1. |
| 22.11 Speed ref1 source | **4** = FB A ref1 | Selects the fieldbus A reference 1 as the source for speed reference 1. |

[1] Read-only or automatically detected/set
[2] Example

The start sequence for the parameter example above is given below.

Control word:

- Reset the fieldbus communication fault (if active).
- Enter 0h (0 decimal) → READY.
- Enter 1h (1 decimal) → ENABLED (Running forward).
- Enter 2h (2 decimal) → ENABLED (Running reverse).

# Configuring the client

After the adapter module has been initialized by the drive, you must prepare the client for communication with the module. An example of an Allen-Bradley® PLC is given below. If you are using another client system, refer to its documentation for more information.

The example applies to all drive types compatible with the module.

## Before you start

Decide on these points before you start the client configuration.

### Select protocol/profile

During the configuration of the drive and the client, it is necessary to select a communication protocol, in this case EtherNet/IP, and a communication profile. The communication profile determines which I/O assemblies and objects are available. See chapter *EtherNet/IP – Communication profiles* for more information.

### Select output and input assembly instances

EtherNet/IP devices implement multiple objects each with many attributes. While it is possible to write or read each attribute separately to control the drive, this is inefficient. Assembly object instances provide a means to group writes or reads of attributes. The selection of assembly objects is limited by the choice of the communication profile. This table gives a listing of the output and input assemblies.

| Name | Output instance | Input instance | Size (bytes) | Profile |
|---|---|---|---|---|
| Basic Speed Control | 20 | 70 | 4 | ODVA AC/DC drive |
| Enhanced Speed Control | 21 | 71 | 4 | ODVA AC/DC drive |
| Basic Speed and Torque Control | 22 | 72 | 6 | ODVA AC/DC drive |
| Enhanced Speed and Torque Control | 23 | 73 | 6 | ODVA AC/DC drive |
| Basic Speed Control plus Drive Parameters | 120 | 170 | 24 | ODVA AC/DC drive |

| Name | Output instance | Input instance | Size (bytes) | Profile |
|---|---|---|---|---|
| Enhanced Speed Control plus Drive Parameters | 121 | 171 | 24 | ODVA AC/DC drive |
| Basic Speed and Torque Control plus Drive Parameters | 122 | 172 | 26 | ODVA AC/DC drive |
| Enhanced Speed and Torque Control plus Drive Parameters | 123 | 173 | 26 | ODVA AC/DC drive |
| ABB Drives Profile w/ Set Speed | 1 | 51 | 4 | ABB Drives profile |
| ABB Drives Profile w/ Set Speed and Set Torque | 2 | 52 | 6 | ABB Drives profile |
| ABB Drives Profile w/ Set Speed plus Drive Parameters | 101 | 151 | 24 | ABB Drives profile |
| ABB Drives Profile w/ Set Speed and Set Torque plus Drive Parameters | 102 | 152 | 26 | ABB Drives profile |
| Transparent16 w/One | 11 | 61 | 4 | Transparent16 profile |
| Transparent16 w/Two | 12 | 62 | 6 | Transparent16 profile |
| Transparent16 w/One plus Drive Parameters | 111 | 161 | 24 | Transparent16 profile |
| Transparent16 w/Two plus Drive Parameters | 112 | 162 | 26 | Transparent16 profile |
| Transparent32 w/One | 21 | 71 | 8 | Transparent32 profile |
| Transparent32 w/Two | 22 | 72 | 12 | Transparent32 profile |
| Transparent32 w/One plus Drive Parameters | 121 | 171 | 28 | Transparent32 profile |
| Transparent32 w/Two plus Drive Parameters | 122 | 172 | 32 | Transparent32 profile |

### Select connection method

EtherNet/IP provides a variety of connection methods to communicate between devices. Not all methods are supported by all devices. Refer to the client documentation to determine which method(s) are supported by the client.

**Note:** The choice of the connection method has a significant impact on the timeout behavior. Refer to configuration parameters *20 Control timeout* and *21 Idle action* for more information.

The FENA adapter module supports the following connection methods:

*I/O connections*

The adapter module supports Class 1 I/O connections. I/O connections are often also referred to as “Implicit Messaging”. I/O connections are typically established by configuring an I/O scanner to write and read assembly object instances.

*Connected explicit messaging*

The adapter module supports Class 3 connected explicit messaging. Class 3 connected explicit messages are typically established by using a “message instruction” to write or read an attribute.

**Note:** When using Class 3 explicit messaging, some EtherNet/IP clients may close the connection after the MSG instruction is done. This will cause the module to behave as if it were controlled via unconnected explicit messaging.



*Unconnected explicit messaging*

The adapter module supports unconnected explicit messaging. Unconnected explicit messages are typically established by using a “message instruction” to write or read an attribute.

**Note:** EtherNet/IP does not provide a timeout means for unconnected explicit messaging. To use unconnected explicit messaging for control, refer to configuration parameter *20 Control timeout*.

## EDS files

Electronic Data Sheet (EDS) files specify the properties of the device for the EtherNet/IP client. The client identifies the device by means of the product code, device type and major revision attributes.

To enable the use of different ABB drive types on the same EtherNet/IP network, a unique product code has been given to each drive type and application combination.

EDS files are available from the Document library (*http://new.abb.com/drives/ethernet-ip*).

**Note:** Only one EDS file with the same EtherNet/IP product code can be installed in the PLC at a time.

## Configuring an Allen-Bradley® PLC

### Example 1: RSLogix 5000

This example shows how to prepare an Allen-Bradley® ControlLogix5555™ PLC for communication with the adapter module by using the RSLogix 5000® software as the configuration tool.

1. Start the RSLogix software and open/create an RSLogix project.

   **Note:** It is assumed that the PLC configuration has already been established in the RSLogix project.

2. In the RSLogix I/O, right-click the EtherNet/IP communication module and select **New Module**.

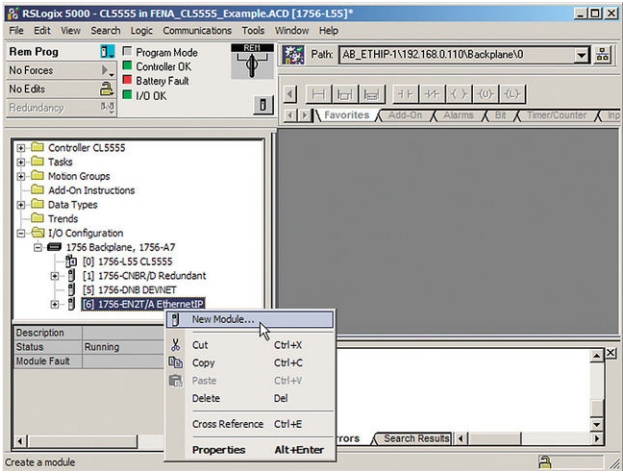

3. In the **Select Module** window, select ETHERNET-MODULE.

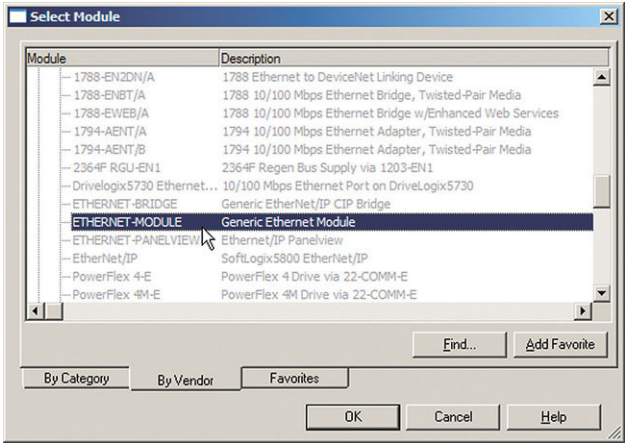

4. Select the input and output assembly instances and the PLC I/O memory size to be used.

   The table below shows the available combinations. The example below uses the ODVA AC/DC assembly instances 121 and 171.

| Input assembly instances | Output assembly instances | PLC word settings |
|---|---|---|
| 70 | 20 | 2 |
| 71 | 21 | 2 |
| 72 | 22 | 3 |
| 73 | 23 | 3 |
| 170 | 120 | 12 |
| 171 | 121 | 12 |
| 172 | 122 | 13 |
| 173 | 123 | 13 |
| 51 | 1 | 2 |
| 52 | 2 | 3 |
| 151 | 101 | 12 |
| 152 | 102 | 13 |
| 61 | 11 | 2 |
| 62 | 12 | 3 |
| 161 | 111 | 12 |
| 162 | 112 | 13 |



   For more information on the input/output assembly instances, see chapter *Select output and input assembly instances* on page *150*.

5. Enter the following information.

   The example below uses ODVA AC/DC assembly instances 121 and 171. The PLC will transmit and receive 12 words.

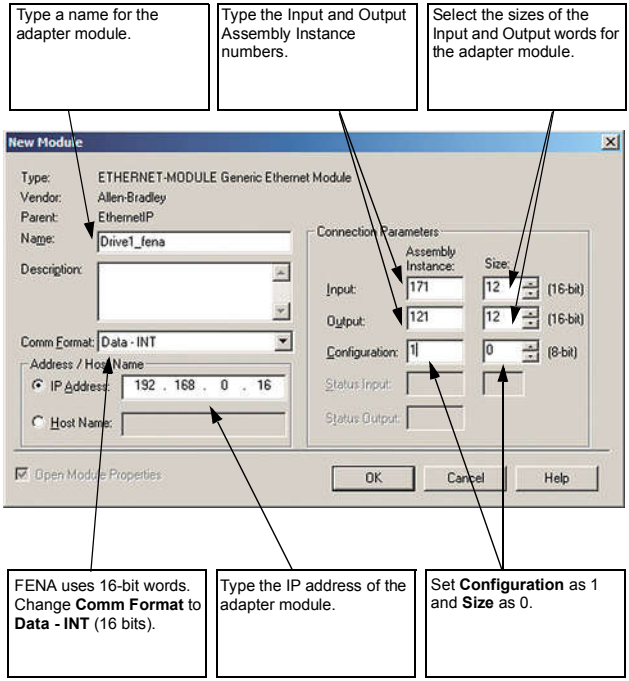

6. Click **OK**.

   The adapter module is now added to the PLC I/O.

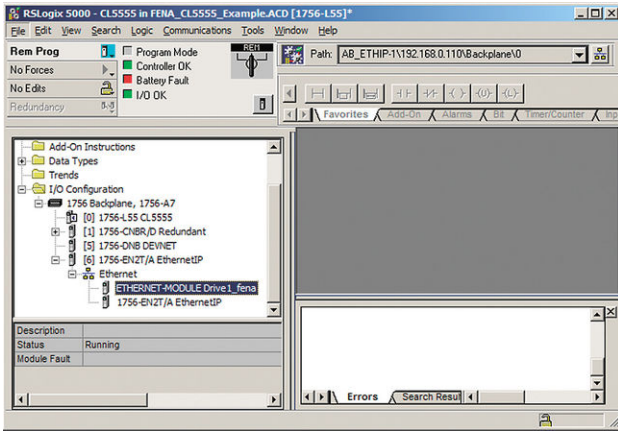


7. Click the FENA module to open the **Module Properties** window.

8. On the **Connection** tab, select the Requested Packet Interval (RPI) for the adapter module I/O communication.

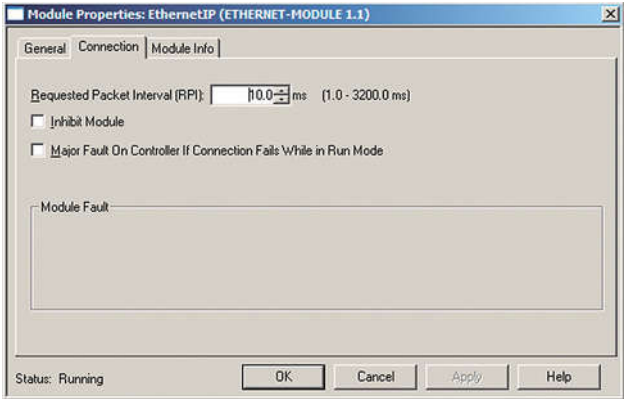


9. Download the new configuration to the PLC.

   The PLC is now ready for communication with the adapter module.

### Example 2: Studio 5000

This example shows how to prepare an Allen-Bradley® CompactLogix™ PLC for communication with the adapter module using the Studio 5000® software as the configuration tool.

1. Start the RSLogix software and open/create an RSLogix project.

   **Note:** It is assumed that the PLC configuration was already established in the Studio 5000® project.

2. If EDS file for the correct device is not installed, use the EDS hardware installation tool. To register a new EDS file:
   - Select **Tools** → **EDS Hardware Installation Tool**.

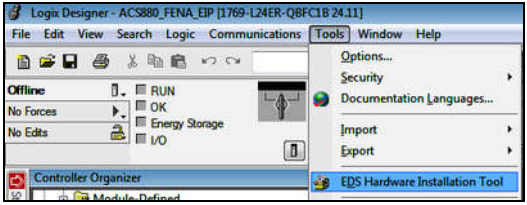


   - Select the option Register an EDS file(s). Click **Next**.



- Browse to FENA EDS file and select the file. Click **Next** to register the EDS file.

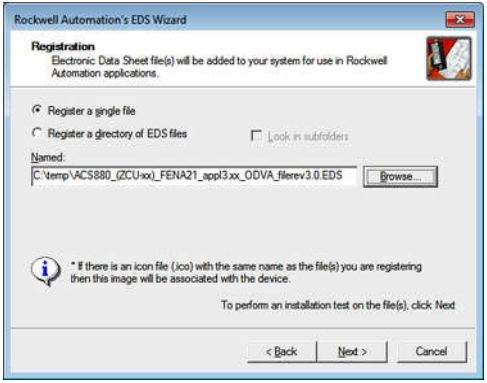


- Click **Next** and **Finish** to finalize registration. After the EDS file is successfully registered the device can be used in the PLC project.

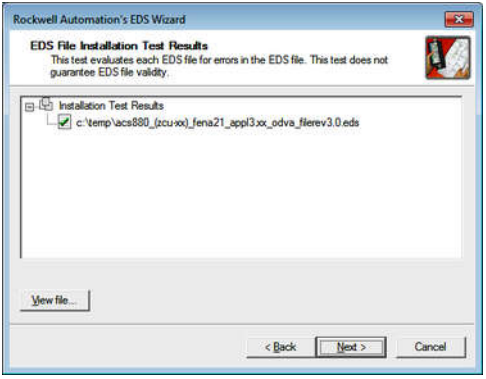

3. Add new devices to EtherNet/IP bus by right-clicking **Ethernet** under I/O Configuration and selecting **New Module**.




4. In the Select Module Type window, select ACS880 module (AC Drive Device). You can easily find the ABB devices using filters. Click **Create** to add a new module.

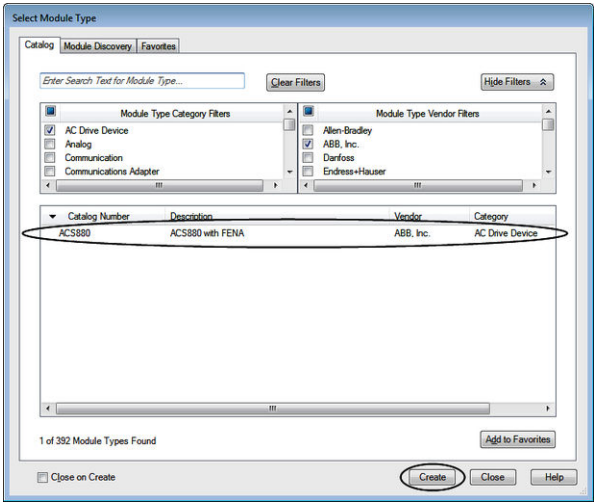

5. Enter the following information to configure the IP address and module name.

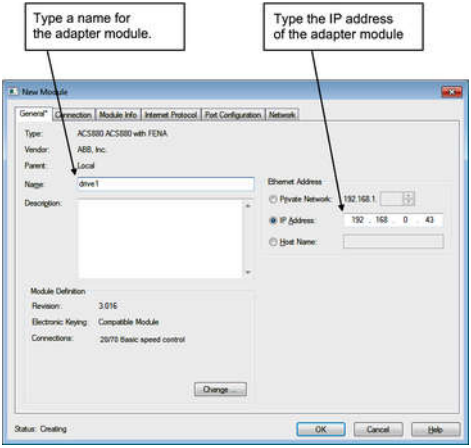


6. Click **Change**, to select the input and output assembly instances and the PLC I/O memory size to be used. The table below shows the available combinations.

| Input assembly instances | Output assembly instances | PLC word settings |
|---|---|---|
| 70 | 20 | 2 |
| 71 | 21 | 2 |
| 72 | 22 | 3 |
| 73 | 23 | 3 |
| 170 | 120 | 12 |
| 171 | 121 | 12 |
| 172 | 122 | 13 |
| 173 | 123 | 13 |
| 51 | 1 | 2 |
| 52 | 2 | 3 |

| Input assembly instances | Output assembly instances | PLC word settings |
|---|---|---|
| 151 | 101 | 12 |
| 152 | 102 | 13 |
| 61 | 11 | 2 |
| 62 | 12 | 3 |
| 161 | 111 | 12 |
| 162 | 112 | 13 |

For more information on the input/output assembly instances, see *Select output and input assembly instances* on page *150*.

FENA uses 16-bit words. Change the size to INT (16 bits). The example below uses ODVA AC/DC assembly instances 121 and 171. The PLC transmits and receives 12 words.

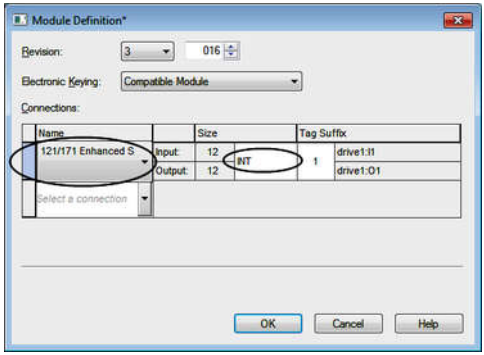

7. Click **OK** and confirm selection to change the module data types.

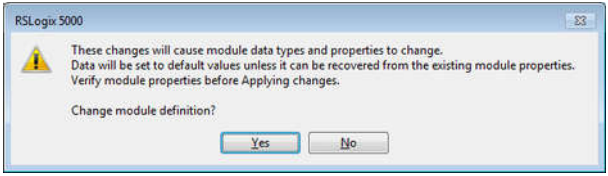


8. On the Connection tab, select the Requested Packet Interval (RPI) for the adapter module I/O communication.

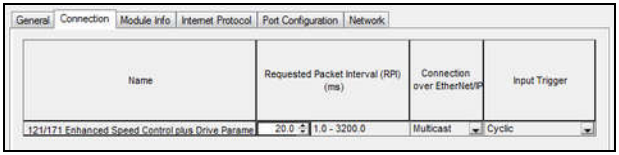


9. Click **OK**. The adapter module is now added to the PLC I/O. You can add more modules by choosing **Create** or exit the window by choosing **Close**.

10. Download the new configuration to the PLC. The PLC is now ready for communication with the adapter module.

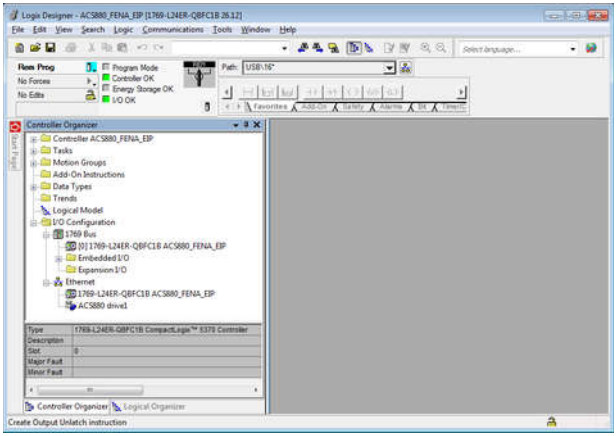

## Configuring DLR topology for FENA-21

This example shows how to prepare an Allen-Bradley® CompactLogix™ PLC for DLR topology with FENA-21 adapter modules. After installing the devices on the DLR network, at least one supervisor node must be configured. Configuration can be done by using the Studio 5000® Logix Designer or RSLinx® Classic Lite software.

**Note**: The examples below uses ACSxxx drive. You can also use this configuration with other drives that supports FENA-21.

### Setup using Logix Designer

1. Open the Studio 5000® software. Test setup uses an Allen Bradley PLC connected in a ring topology with two FENA-21 fieldbus Ethernet modules. The topology used in the example is shown below. More devices can be added, but the recommended maximum number of nodes on a single DLR network is 50.

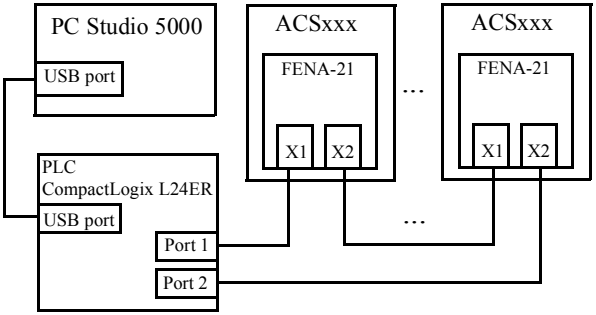


**Note**: It is assumed that the PLC configuration was already established in the Studio 5000® project and the EDS file(s) are installed and at least two FENA-21 modules are added to the project.

For more information on adding modules to a project and installing EDS files, see chapter *Configuring an Allen-Bradley® PLC*.

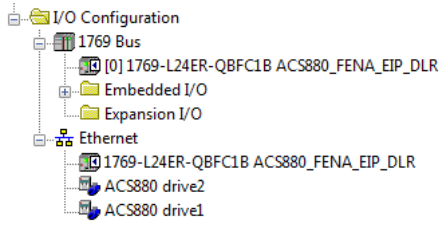


2. Download the project to the PLC.
3. Go online with the PLC and leave it in Program mode.
4. Double-click the module in the **I/O Configuration**. In the Controller Properties window, open Network tab and select **Enable Supervisor Mode**. Click **OK**.

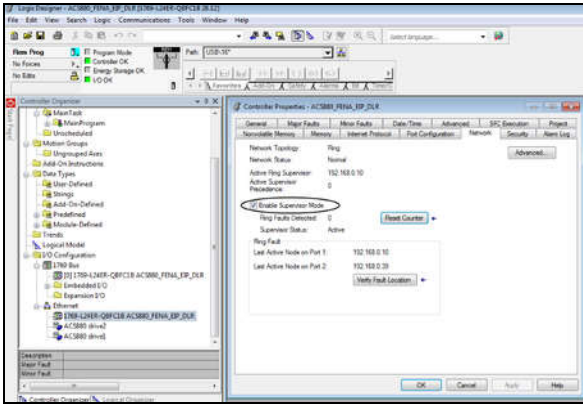

### Setup using RSLinx® Classic

You can configure and enable DLR supervisor via RSLinx®Classic.

1. Open the RSLinx®Classic software.
2. Browse to the DLR network.




3. Open the **Module Configuration** by right-clicking on the ring supervisor in the list.

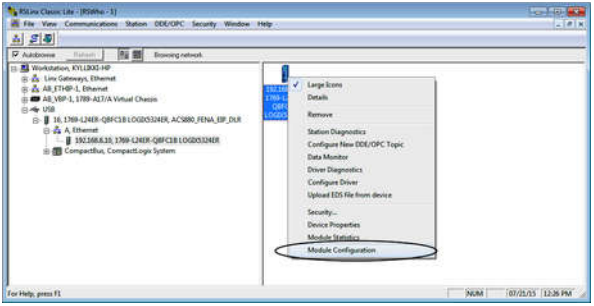

4. On the Network tab, select **Enable Ring Supervisor**, to enable DLR messages in the ring.

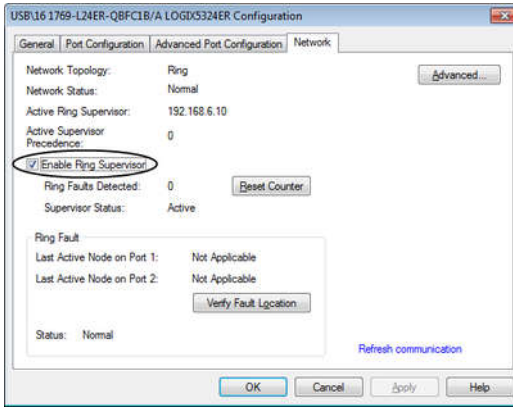


5. Click **Advanced...** to configure DLR parameters, such as Beacon Interval and Beacon Timeout.

   **Note**: It is recommended to use the default values.

6. Go back to Logix Designer and make sure that none of the FENA-21 modules are faulted, that is no warning symbols are displayed.

# 11

# EtherNet/IP – Communication profiles

## Contents of this chapter

This chapter describes the communication profiles used in the communication between the EtherNet/IP client, the adapter module and the drive.

## Communication profiles

Communication profiles are ways of conveying control commands (Control word, Status word, references and actual values) between the master station and the drive.

With the FENA adapter module, the EtherNet/IP network may employ either the ODVA AC/DC drive profile or the ABB Drives profile. Both are converted to the native profile (e.g., DCU or FBA) by the adapter module. In addition, two Transparent modes – for 16-bit and 32-bit words respectively – are available. With the Transparent modes, no data conversion takes place.

The figure below illustrates the profile selection:

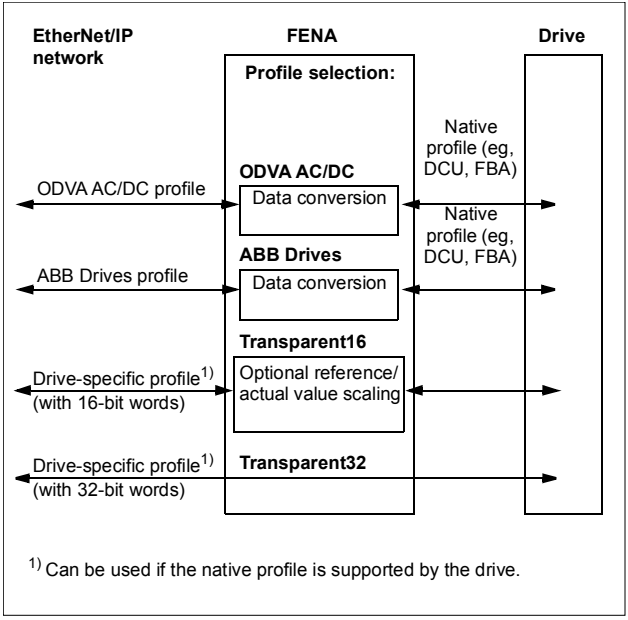


The following sections describe the Control word, the Status word, references and actual values for the ODVA AC/DC drive and ABB Drives communication profiles. Refer to the drive manuals for details on the native profiles.

E

## ODVA AC/DC drive profile

This section briefly describes the ODVA AC/DC drive profile. Additional information is available at www.odva.org.

An EtherNet/IP node is modeled as a collection of abstract objects. Each object represents the interface to and behavior of a component within the product. The ODVA AC/DC drive profile defines a collection of objects suitable for the control of AC and DC drives. The objects supported by the adapter module are listed in section *Class objects* on page *229*.

Objects are defined by:

- Service
- Class
- Instance
- Attribute
- Behavior.

For example, to set the drive speed reference, the Set_Attribute_Single service can be requested for the SpeedRef attribute of the AC/DC drive object class. The resulting behavior is that the reference speed of the drive is set to the requested value.

This is an example of explicit messaging, where each attribute of a class is set individually. While this is allowed, it is inefficient. Instead, implicit messaging using input and output assembly Instances is recommended. Implicit messaging allows the EtherNet/IP client to set or get predefined groups of attributes in a single message exchange. The assembly instances supported by the adapter module are listed and defined in section *Assembly objects* on page *194*.

## ODVA output attributes

This section briefly describes the instances found in the output assemblies of the ODVA AC/DC drive profile. Note that all output assembly instances do not support all attributes listed here.

### Run Forward & Run Reverse (Control supervisor object)

These attributes are used to assert run and stop commands to the Control supervisor object state machine according to the following Run/Stop event matrix. See *State (Control supervisor object)* on page *179*.

| RunFwd (Run1) | RunRev (Run2) | Trigger event | Run type |
|---|---|---|---|
| 0 | 0 | Stop | N/A |
| 0 ⟶ 1 | 0 | Run | RunFwd |
| 0 | 0 ⟶ 1 | Run | RunRev |
| 0 ⟶ 1 | 0 ⟶ 1 | No Action | N/A |
| 1 | 1 | No Action | N/A |
| 0 ⟶ 1 | 1 | Run | RunRev |
| 1 | 1 ⟶ 0 | Run | RunFwd |

### Fault Reset (Control supervisor object)

This attribute resets a drive fault on a transition from zero to one if the condition that caused the fault has been cleared.

### Net Ctrl (Control supervisor object)

E

This attribute requests that the drive Run/Stop command be supplied locally (Net Ctrl = 0) or by the network (Net Ctrl = 1).

### Net Ref (AC/DC drive object)

This attribute requests that the drive speed and torque references be supplied locally (Net Ref = 0) or by the network (Net Ref = 1).

### Speed Reference (AC/DC drive object)

This attribute is the speed reference for the drive. The units are scaled by the Speed Scale attribute of the AC/DC drive object. See parameter *23 Speed scale* for details.

*Scalar mode*

When the drive is operating in the scalar mode, the adapter module provides the drive with a frequency reference. The ODVA AC/DC drive profile uses rpm units for the speed reference. The drive frequency reference is calculated as follows:

$$\mathrm{Dfr} = \frac{\mathrm{Osr} \times \mathrm{Us} \times \mathrm{Mf}}{\mathrm{Mss}}$$

where

Dfr = Drive Frequency Reference in Hz
Osr = ODVA Speed Reference
Us = ODVA Speed Unit (see *23 Speed scale* on page *127*)
Mf = Motor Nominal Frequency in Hz
Mss = Motor Synchronous Speed in rpm (not Motor Nominal Speed).

For example, for a 4-pole 60 Hz motor (Mss = 1800 rpm) with a unit of 1 rpm and an ODVA Speed Reference of 900, the drive frequency reference is:

$$\mathrm{Dfr} = \frac{\mathrm{Osr} \times \mathrm{Us} \times \mathrm{Mf}}{\mathrm{Mss}} = \frac{900 \times 1\,\mathrm{rpm} \times 60\,\mathrm{Hz}}{1800\,\mathrm{rpm}} = 30\,\mathrm{Hz}$$

E

*Vector mode*

When the drive is operating in the vector mode, the adapter module provides the drive with a speed reference. The ODVA AC/DC drive profile uses rpm units for the speed reference. The drive speed reference is calculated as follows:

$$\mathrm{Dsr} = \mathrm{Osr} \times \mathrm{Us}$$

where

Dsr = Drive Speed Reference in rpm
Osr = ODVA Speed Reference
Us = ODVA Speed Unit (see *23 Speed scale* on page *127*).

For example, for an ODVA Speed Reference of 900 rpm with a unit of 0.5 rpm, the drive speed reference is:

$$\mathrm{Dsr} = \mathrm{Osr} \times \mathrm{Us} = 900 \times 0.5\mathrm{rpm} = 450\mathrm{rpm}$$

### Torque Reference (AC/DC drive object)

This attribute is the torque reference for the drive. The units are scaled by the Torque Scale attribute of the AC/DC drive object. See parameter *24 Torque scale* for details.

The adapter module provides the drive with a torque reference in percent of the motor nominal torque. The ODVA AC/DC drive profile uses Newton-meter (N·m) units for the torque reference. The drive torque reference is calculated as follows:

$$\mathrm{Dtr} = \frac{100 \times \mathrm{Otr} \times \mathrm{Ut}}{\mathrm{Mt}}$$

where

Dtr = Drive Torque Reference in Percent of Motor Nominal Torque
Otr = ODVA Torque Reference
Ut = ODVA Torque Unit (see *24 Torque scale* on page *128*)
Mt = Motor Nominal Torque in N·m.

For example, for a 1000 N·m Motor Nominal Torque with a unit of 1 N·m and an ODVA Torque Reference of 500, the drive torque reference is:

$$\mathrm{Dtr} = \frac{100 \times \mathrm{Otr} \times \mathrm{Ut}}{\mathrm{Mt}} = \frac{100 \times 500 \times 1\,\mathrm{Nm}}{1000\,\mathrm{Nm}} = 50$$

E

## ODVA input attributes

This section briefly describes the instances found in the ODVA AC/DC drive profile's input assemblies. Note that all input assembly instances do not support all attributes listed here.

**Faulted (Control supervisor object)**

This attribute indicates that the drive has experienced a fault. The fault code may be read from the FaultCode attribute of the Control supervisor object.

**Warning (Control supervisor object)**

This attribute indicates that the drive is experiencing a warning condition. The warning code may be read from the WarnCode attribute of the Control supervisor object.

**Running Forward (Control supervisor object)**

This attribute indicates that the drive is running in the forward direction.

**Running Reverse (Control supervisor object)**

This attribute indicates that the drive is running in the reverse direction.

**Ready (Control supervisor object)**

This attribute indicates that the Control supervisor object state machine is in the Ready, Running or Stopping state. See *State (Control supervisor object)* on page *179*.



**Ctrl From Net (Control supervisor object)**

This attribute indicates if the Run/Stop command is being supplied locally (Ctrl From Net = 0) or by the network (Ctrl From Net = 1).

**Ref From Net (AC/DC drive object)**

This attribute indicates if the speed and torque references are being supplied locally (Ref From Net = 0) or by the network (Ref From Net = 1).

**At Reference (AC/DC drive object)**

This attribute indicates that the drive is operating at the specified speed or torque reference.

**State (Control supervisor object)**

This attribute indicates the current state of the Control supervisor object.

| State | Description | State | Description |
|---|---|---|---|
| 0 | Vendor Specific | 4 | Enabled |
| 1 | Startup | 5 | Stopping |
| 2 | Not Ready | 6 | Fault Stop |
| 3 | Ready | 7 | Faulted |

The ODVA state transition diagram is shown below:

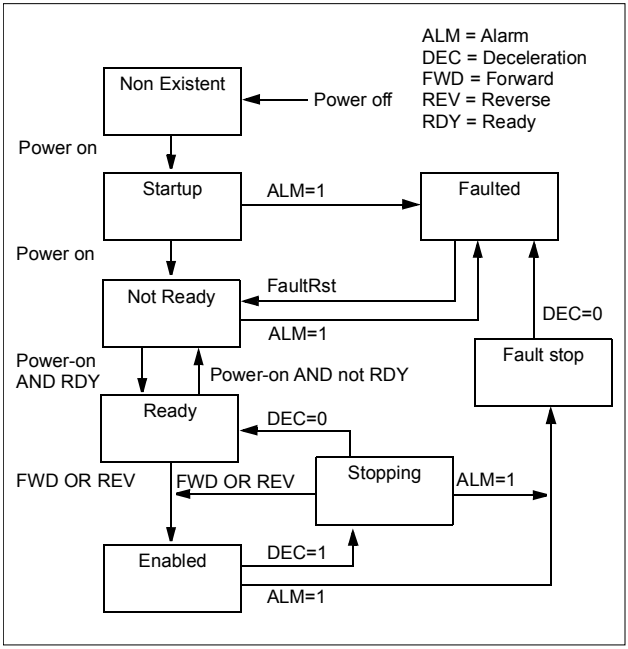


E

### Speed Actual (AC/DC drive object)

This attribute indicates the actual speed at which the drive is operating. The units are scaled by the SpeedScale attribute of the AC/DC drive object. See parameter *23 Speed scale* for details.

*Scalar mode*

When the drive is operating in the scalar mode, the drive provides the adapter module with a frequency actual. The ODVA AC/DC drive profile uses rpm units for the speed actual. The ODVA Speed Actual is calculated as follows:

$$Osa = \frac{Dfa \times Mss}{Mf \times Us}$$

where

Osa = ODVA Speed Actual
Dfa = Drive Frequency Actual in Hz
Us = ODVA Speed Unit (see *23 Speed scale* on page *127*)
Mf = Motor Nominal Frequency in Hz
Mss = Motor Synchronous Speed in rpm (not Motor Nominal Speed).

For example, for a 4-pole 60 Hz motor (Mss = 1800 rpm) with a unit of 1 rpm and a Drive Frequency Actual of 30 Hz, the ODVA Speed Actual is:

$$Osa = \frac{Dfa \times Mss}{Mf \times Us} = \frac{30Hz \times 1800rpm}{60Hz \times 1rpm} = 900$$

E

*Vector mode*

When the drive is operating in the vector mode, the drive provides the adapter module with a speed actual. The ODVA AC/DC drive profile uses rpm units for the speed actual. The ODVA Speed Actual is calculated as follows:

$$\mathrm{Osa} = \frac{\mathrm{Dsa}}{\mathrm{Us}}$$

where

Dsa = Drive Speed Actual in rpm
Osa = ODVA Speed Actual
Us = ODVA Speed Unit (see *23 Speed scale* on page *127*).

For example, for a Drive Speed Actual of 900 rpm with a unit of 0.5 rpm, the ODVA Speed Actual is:

$$\mathrm{Osa} = \frac{\mathrm{Dsa}}{\mathrm{Us}} = \frac{450\,\mathrm{rpm}}{0.5\,\mathrm{rpm}} = 900$$

### Torque Actual (AC/DC drive object)

This attribute indicates the actual torque at which the drive is operating. The units are scaled by the Torque Scale attribute of the AC/DC drive object. See parameter *24 Torque scale* for details.

The drive provides the adapter module with a torque actual in percent of the Motor Nominal Torque. The ODVA AC/DC drive profile uses Newton-meter (N·m) units for the torque actual. The ODVA Torque Actual is calculated as follows:

$$\mathrm{Ota} = \frac{\mathrm{Dta} \times \mathrm{Mt}}{100 \times \mathrm{Ut}}$$

where

Dta = Drive Torque Actual in Percent of Motor Nominal Torque
Ota = ODVA Torque Actual
Ut = ODVA Torque Unit (see *24 Torque scale* on page *128*)
Mt = Motor Nominal Torque in N·m.

For example, for a 1000 N·m Motor Nominal Torque with a unit of 1 N·m and a drive torque actual of 50%, the ODVA Torque Actual is:

$$\mathrm{Ota} = \frac{\mathrm{Dta} \times \mathrm{Mt}}{100 \times \mathrm{Ut}} = \frac{50 \times 1000\,\mathrm{Nm}}{100 \times 1\,\mathrm{Nm}} = 500$$

# ABB Drives communication profile

## Control word and Status word

The Control word is the principal means for controlling the drive from a fieldbus system. It is sent by the fieldbus client station to the drive through the adapter module. The drive switches between its states according to the bit-coded instructions in the Control word and returns status information to the client in the Status word.

The contents of the Control word and the Status word are detailed below. The drive states are presented on page *189*.

### Control word contents

The table below shows the contents of the Control word for the ABB Drives communication profile. The upper case boldface text refers to the states shown in the state machine on page *189*.

| Bit | Name | Value | STATE/Description |
|---|---|---|---|
| 0 | OFF1_ CONTROL | 1 | Proceed to **READY TO OPERATE**. |
| | | 0 | Stop along currently active deceleration ramp. Proceed to **OFF1 ACTIVE**; proceed to **READY TO SWITCH ON** unless other interlocks (OFF2, OFF3) are active. |
| 1 | OFF2_ CONTROL | 1 | Continue operation (OFF2 inactive). |
| | | 0 | Emergency OFF, coast to stop. Proceed to **OFF2 ACTIVE**, proceed to **SWITCH-ON INHIBITED**. |
| 2 | OFF3_ CONTROL | 1 | Continue operation (OFF3 inactive). |
| | | 0 | Emergency stop, stop within time defined by drive parameter. Proceed to **OFF3 ACTIVE**; proceed to **SWITCH-ON INHIBITED**. **Warning:** Ensure that motor and driven machine can be stopped using this stop mode. |

| Bit | Name | Value | STATE/Description |
|---|---|---|---|
| 3 | INHIBIT_ OPERATION | 1 | Proceed to **OPERATION ENABLED**. **Note:** Run enable signal must be active; see drive documentation. If the drive is set to receive the Run enable signal from the fieldbus, this bit activates the signal. |
| | | 0 | Inhibit operation. Proceed to **OPERATION INHIBITED**. |
| 4 | RAMP_OUT_ ZERO | 1 | Normal operation. Proceed to **RAMP FUNCTION GENERATOR: OUTPUT ENABLED**. |
| | | 0 | Force Ramp Function Generator output to zero. Drive ramps to stop (current and DC voltage limits in force). |
| 5 | RAMP_HOLD | 1 | Enable ramp function. Proceed to **RAMP FUNCTION GENERATOR: ACCELERATOR ENABLED**. |
| | | 0 | Halt ramping (Ramp Function Generator output held). |
| 6 | RAMP_IN_ ZERO | 1 | Normal operation. Proceed to **OPERATION**. **Note:** This bit is effective only if the fieldbus interface is set as the source for this signal by drive parameters. |
| | | 0 | Force Ramp Function Generator input to zero. |
| 7 | RESET | 0 → 1 | Fault reset if an active fault exists. Proceed to **SWITCH-ON INHIBITED**. **Note:** This bit is effective only if the fieldbus interface is set as the source for this signal by drive parameters. |
| | | 0 | Continue normal operation. |
| 8…9 | Drive-specific (For information, see the drive documentation.) | | |

| Bit | Name | Value | STATE/Description |
|---|---|---|---|
| 10 | REMOTE_ CMD | 1 | Fieldbus control enabled. |
| | | 0 | Control word and reference not getting through to the drive, except for CW bits OFF1, OFF2 and OFF3. |
| 11 | EXT_CTRL_ LOC | 1 | Select External Control Location EXT2. Effective if control location parameterized to be selected from fieldbus. |
| | | 0 | Select External Control Location EXT1. Effective if control location parameterized to be selected from fieldbus. |
| 12… 15 | Reserved | | |

### Status word contents

The table below shows the contents of the Status word for the ABB Drives communication profile. The upper case boldface text refers to the states shown in the state machine on page 189.

| Bit | Name | Value | STATE/Description |
|---|---|---|---|
| 0 | RDY_ON | 1 | **READY TO SWITCH ON** |
| | | 0 | **NOT READY TO SWITCH ON** |
| 1 | RDY_RUN | 1 | **READY TO OPERATE** |
| | | 0 | **OFF1 ACTIVE** |
| 2 | RDY_REF | 1 | **OPERATION ENABLED** |
| | | 0 | **OPERATION INHIBITED** |
| 3 | TRIPPED | 1 | **FAULT** |
| | | 0 | No fault |
| 4 | OFF_2_STA | 1 | OFF2 inactive |
| | | 0 | **OFF2 ACTIVE** |
| 5 | OFF_3_STA | 1 | OFF3 inactive |
| | | 0 | **OFF3 ACTIVE** |
| 6 | SWC_ON_ INHIB | 1 | **SWITCH-ON INHIBITED** |
| | | 0 | – |
| 7 | ALARM | 1 | Warning/Alarm |
| | | 0 | No warning/alarm |
| 8 | AT_ SETPOINT | 1 | **OPERATION.** Actual value equals reference (= is within tolerance limits, i.e., in speed control, speed error is 10% max. of nominal motor speed). |
| | | 0 | Actual value differs from reference (= is outside tolerance limits). |
| 9 | REMOTE | 1 | Drive control location: REMOTE (EXT1 or EXT2) |
| | | 0 | Drive control location: LOCAL |

| Bit | Name | Value | STATE/Description |
|---|---|---|---|
| 10 | ABOVE_ LIMIT | 1 | Actual frequency or speed equals or exceeds supervision limit (set by drive parameter). Valid in both directions of rotation. |
| | | 0 | Actual frequency or speed within supervision limit |
| 11 | EXT_CTRL_ LOC | 1 | External Control Location EXT2 selected. **Note concerning ACS880:** This bit is effective only if the fieldbus interface is set as the target for this signal by drive parameters. User bit 0 selection (06.33) |
| | | 0 | External Control Location EXT1 selected |
| 12 | EXT_RUN_ ENABLE | 1 | External Run Enable signal received. **Note concerning ACS880:** This bit is effective only if the fieldbus interface is set as the target for this signal by drive parameters. User bit 1 selection (06.34) |
| | | 0 | No External Run Enable signal received |
| 13… 14 | Reserved | | |
| 15 | FBA_ ERROR | 1 | Communication error detected by fieldbus adapter module |
| | | 0 | Fieldbus adapter communication OK |

## State machine

The state machine for the ABB Drives communication profile is shown below.

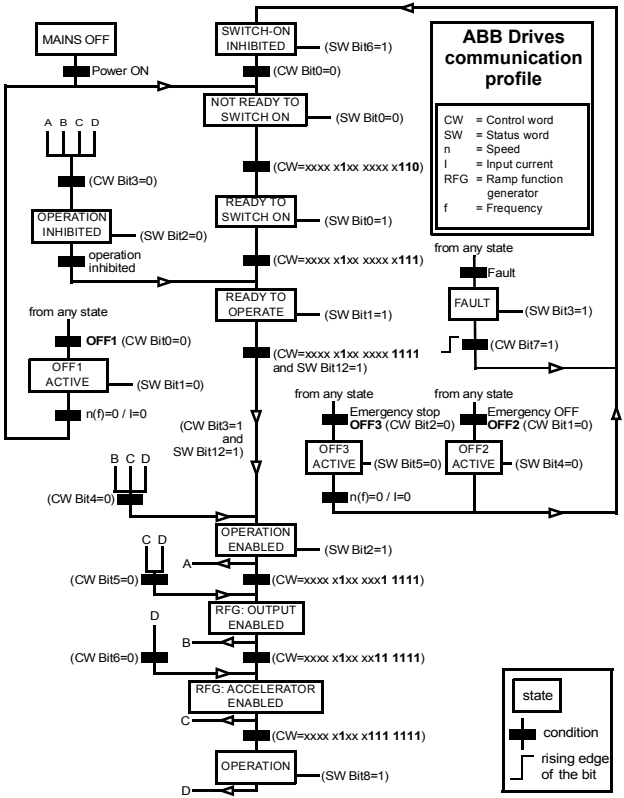

## References

References are 16-bit words containing a sign bit and a 15-bit integer. A negative reference (indicating reversed direction of rotation) is formed by calculating the two's complement from the corresponding positive reference.

ABB drives can receive control information from multiple sources including analog and digital inputs, the drive control panel and a fieldbus adapter module (for example, FENA). To have the drive controlled through the fieldbus, you must select the module as the source for control information, for example, reference.

### Scaling

References are scaled as shown below.

**Note:** The values of REF1 MAX and REF2 MAX are set with drive parameters. See the drive manuals for further information.

In ACSM1, ACS480, ACS580, ACS850, ACQ810 and ACS880 the speed reference (REFx) in decimal (0…20000) corresponds to 0…100% of the speed scaling value (as defined with a drive parameter).

In ACS355, drive parameter REFx MIN may limit the actual minimum reference.

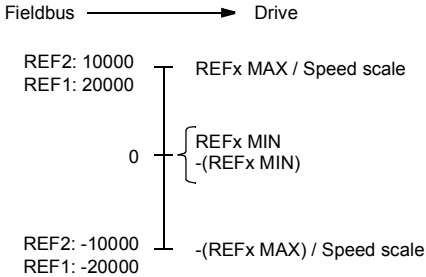

## Actual values

Actual values are 16-bit words containing information on the operation of the drive. The functions to be monitored are selected with a drive parameter.

### Scaling

Actual values are scaled as shown below.

**Note:** The values of REF1 MAX and REF2 MAX are set with drive parameters. See the drive manuals for further information.

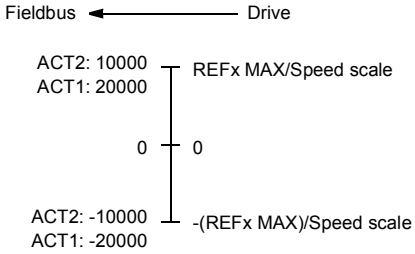

12

# EtherNet/IP – Communication protocol

## Contents of this chapter

This chapter describes the EtherNet/IP communication protocol for the adapter module.

## EtherNet/IP

EtherNet/IP is a variant of the Common Industrial Protocol (CIP) family of communication protocols intended for supervision and control of automation equipment. Specifically, it covers the use of CIP messaging over an IP network, typically using Ethernet as the media.

The FENA adapter module acts as a server on an EtherNet/IP network with support for the ODVA AC/DC drive, ABB Drives and Transparent profiles.

Two simultaneous EtherNet/IP connections are supported, that is, two clients can be connected to the adapter module at a time.

Further information on the EtherNet/IP protocol is available at www.odva.org.

## Object modeling and functional profiles

One of the main features of EtherNet/IP is object modeling. A group of objects can be described with a Functional Profile. The FENA adapter module realizes the ODVA AC/DC drive Functional Profile with additional features.

## Assembly objects

I/O assembly instances may also be referred to as Block Transfer of data. Intelligent devices realizing a Functional Profile, such as FENA, have several objects. Since it is not possible to transmit more than one object data through a single connection, it is practical and more efficient to group attributes from different objects into a single I/O connection using the assembly object. The assembly object acts as a tool for grouping these attributes.

The assembly selections described above are, in fact, instances of the assembly object class. The adapter module uses static assemblies (in other words, fixed groupings of different object data only). The following tables describe the assembly instances supported by the adapter module.

### Basic speed control assembly

The Basic speed control assembly is defined by the ODVA AC/DC drive profile. The format of the output assembly is:

| Instance 20 (ODVA AC/DC profile) | | | | | | | | |
|---|---|---|---|---|---|---|---|---|
| **Byte** | **Bit 7** | **Bit 6** | **Bit 5** | **Bit 4** | **Bit 3** | **Bit 2** | **Bit 1** | **Bit 0** |
| **0** | | | | | | Fault Reset | | Run Fwd |
| **1** | | | | | | | | |
| **2** | Speed Reference (Low Byte) | | | | | | | |
| **3** | Speed Reference (High Byte) | | | | | | | |

The format of the input assembly is:

| Instance 70 (ODVA AC/DC profile) | | | | | | | | |
|---|---|---|---|---|---|---|---|---|
| **Byte** | **Bit 7** | **Bit 6** | **Bit 5** | **Bit 4** | **Bit 3** | **Bit 2** | **Bit 1** | **Bit 0** |
| **0** | | | | | | Running1 (Fwd) | | Faulted |
| **1** | | | | | | | | |
| **2** | Speed Actual (Low Byte) | | | | | | | |
| **3** | Speed Actual (High Byte) | | | | | | | |

## Basic speed control plus drive parameters assembly

The Basic speed control plus drive parameters assembly, defined by ABB, adds configurable drive parameters to the Basic speed control assembly of the ODVA AC/DC drive profile.

The format of the output assembly is:

| Instance 120 (ODVA AC/DC profile) | | | | | | | | |
|---|---|---|---|---|---|---|---|---|
| **Byte** | **Bit 7** | **Bit 6** | **Bit 5** | **Bit 4** | **Bit 3** | **Bit 2** | **Bit 1** | **Bit 0** |
| **0** | | | | | | Fault Reset | | Run Fwd |
| **1** | | | | | | | | |
| **2** | Speed Reference (Low Byte) | | | | | | | |
| **3** | Speed Reference (High Byte) | | | | | | | |
| **4** | DATA OUT 1 Value (Low Byte) | | | | | | | |
| **5** | DATA OUT 1 Value (High Byte) | | | | | | | |
| **6** | DATA OUT 2 Value (Low Byte) | | | | | | | |
| **7** | DATA OUT 2 Value (High Byte) | | | | | | | |
| **8** | DATA OUT 3 Value (Low Byte) | | | | | | | |
| **9** | DATA OUT 3 Value (High Byte) | | | | | | | |
| **10** | DATA OUT 4 Value (Low Byte) | | | | | | | |
| **11** | DATA OUT 4 Value (High Byte) | | | | | | | |
| **12** | DATA OUT 5 Value (Low Byte) | | | | | | | |

| Instance 120 (ODVA AC/DC profile) | | | | | | | | |
|---|---|---|---|---|---|---|---|---|
| **Byte** | **Bit 7** | **Bit 6** | **Bit 5** | **Bit 4** | **Bit 3** | **Bit 2** | **Bit 1** | **Bit 0** |
| **13** | DATA OUT 5 Value (High Byte) | | | | | | | |
| **14** | DATA OUT 6 Value (Low Byte) | | | | | | | |
| **15** | DATA OUT 6 Value (High Byte) | | | | | | | |
| **16** | DATA OUT 7 Value (Low Byte) | | | | | | | |
| **17** | DATA OUT 7 Value (High Byte) | | | | | | | |
| **18** | DATA OUT 8 Value (Low Byte) | | | | | | | |
| **19** | DATA OUT 8 Value (High Byte) | | | | | | | |
| **20** | DATA OUT 9 Value (Low Byte) | | | | | | | |
| **21** | DATA OUT 9 Value (High Byte) | | | | | | | |
| **22** | DATA OUT 10 Value (Low Byte) | | | | | | | |
| **23** | DATA OUT 10 Value (High Byte) | | | | | | | |

The format of the input assembly is:

| Instance 170 (ODVA AC/DC profile) | | | | | | | | |
|---|---|---|---|---|---|---|---|---|
| **Byte** | **Bit 7** | **Bit 6** | **Bit 5** | **Bit 4** | **Bit 3** | **Bit 2** | **Bit 1** | **Bit 0** |
| **0** | | | | | | Running1 (Fwd) | | Faulted |
| **1** | | | | | | | | |
| **2** | Speed Actual (Low Byte) | | | | | | | |
| **3** | Speed Actual (High Byte) | | | | | | | |
| **4** | DATA IN 1 Value (Low Byte) | | | | | | | |
| **5** | DATA IN 1 Value (High Byte) | | | | | | | |
| **6** | DATA IN 2 Value (Low Byte) | | | | | | | |
| **7** | DATA IN 2 Value (High Byte) | | | | | | | |
| **8** | DATA IN 3 Value (Low Byte) | | | | | | | |
| **9** | DATA IN 3 Value (High Byte) | | | | | | | |
| **10** | DATA IN 4 Value (Low Byte) | | | | | | | |
| **11** | DATA IN 4 Value (High Byte) | | | | | | | |

| Instance 170 (ODVA AC/DC profile) | | | | | | | | |
|---|---|---|---|---|---|---|---|---|
| **Byte** | **Bit 7** | **Bit 6** | **Bit 5** | **Bit 4** | **Bit 3** | **Bit 2** | **Bit 1** | **Bit 0** |
| **12** | DATA IN 5 Value (Low Byte) | | | | | | | |
| **13** | DATA IN 5 Value (High Byte) | | | | | | | |
| **14** | DATA IN 6 Value (Low Byte) | | | | | | | |
| **15** | DATA IN 6 Value (High Byte) | | | | | | | |
| **16** | DATA IN 7 Value (Low Byte) | | | | | | | |
| **17** | DATA IN 7 Value (High Byte) | | | | | | | |
| **18** | DATA IN 8 Value (Low Byte) | | | | | | | |
| **19** | DATA IN 8 Value (High Byte) | | | | | | | |
| **20** | DATA IN 9 Value (Low Byte) | | | | | | | |
| **21** | DATA IN 9 Value (High Byte) | | | | | | | |
| **22** | DATA IN 10 Value (Low Byte) | | | | | | | |
| **23** | DATA IN 10 Value (High Byte) | | | | | | | |

## Extended speed control assembly

The Extended speed control assembly is defined by the ODVA AC/DC drive profile. The format of the output assembly is:

| Instance 21 (ODVA AC/DC profile) | | | | | | | | |
|---|---|---|---|---|---|---|---|---|
| **Byte** | **Bit 7** | **Bit 6** | **Bit 5** | **Bit 4** | **Bit 3** | **Bit 2** | **Bit 1** | **Bit 0** |
| **0** | | NetRef | NetCtrl | | | Fault Reset | Run Rev | Run Fwd |
| **1** | | | | | | | | |
| **2** | Speed Reference (Low Byte) | | | | | | | |
| **3** | Speed Reference (High Byte) | | | | | | | |

The format of the input assembly is:

| Instance 71 (ODVA AC/DC profile) | | | | | | | | |
|---|---|---|---|---|---|---|---|---|
| **Byte** | **Bit 7** | **Bit 6** | **Bit 5** | **Bit 4** | **Bit 3** | **Bit 2** | **Bit 1** | **Bit 0** |
| **0** | At Reference | Ref From Net | Ctrl From Net | Ready | Running2 (Rev) | Running1 (Fwd) | Warning | Faulted |
| **1** | Drive State.<br>See section *State (Control supervisor object)* on page *179*. | | | | | | | |
| **2** | Speed Actual (Low Byte) | | | | | | | |
| **3** | Speed Actual (High Byte) | | | | | | | |

## Extended speed control plus drive parameters assembly

The Extended speed control plus drive parameters assembly, defined by ABB, adds configurable drive parameters to the Extended speed control assembly of the ODVA AC/DC drive profile.

The format of the output assembly is:

| Instance 121 (ODVA AC/DC profile) | | | | | | | | |
|---|---|---|---|---|---|---|---|---|
| **Byte** | **Bit 7** | **Bit 6** | **Bit 5** | **Bit 4** | **Bit 3** | **Bit 2** | **Bit 1** | **Bit 0** |
| **0** | | Net Ref | Net Ctrl | | | Fault Reset | Run Rev | Run Fwd |
| **1** | | | | | | | | |
| **2** | Speed Reference (Low Byte) | | | | | | | |
| **3** | Speed Reference (High Byte) | | | | | | | |
| **4** | DATA OUT 1 Value (Low Byte) | | | | | | | |
| **5** | DATA OUT 1 Value (High Byte) | | | | | | | |
| **6** | DATA OUT 2 Value (Low Byte) | | | | | | | |
| **7** | DATA OUT 2 Value (High Byte) | | | | | | | |
| **8** | DATA OUT 3 Value (Low Byte) | | | | | | | |
| **9** | DATA OUT 3 Value (High Byte) | | | | | | | |
| **10** | DATA OUT 4 Value (Low Byte) | | | | | | | |

| Instance 121 (ODVA AC/DC profile) | | | | | | | | |
|---|---|---|---|---|---|---|---|---|
| **Byte** | **Bit 7** | **Bit 6** | **Bit 5** | **Bit 4** | **Bit 3** | **Bit 2** | **Bit 1** | **Bit 0** |
| **11** | DATA OUT 4 Value (High Byte) | | | | | | | |
| **12** | DATA OUT 5 Value (Low Byte) | | | | | | | |
| **13** | DATA OUT 5 Value (High Byte) | | | | | | | |
| **14** | DATA OUT 6 Value (Low Byte) | | | | | | | |
| **15** | DATA OUT 6 Value (High Byte) | | | | | | | |
| **16** | DATA OUT 7 Value (Low Byte) | | | | | | | |
| **17** | DATA OUT 7 Value (High Byte) | | | | | | | |
| **18** | DATA OUT 8 Value (Low Byte) | | | | | | | |
| **19** | DATA OUT 8 Value (High Byte) | | | | | | | |
| **20** | DATA OUT 9 Value (Low Byte) | | | | | | | |
| **21** | DATA OUT 9 Value (High Byte) | | | | | | | |
| **22** | DATA OUT 10 Value (Low Byte) | | | | | | | |
| **23** | DATA OUT 10 Value (High Byte) | | | | | | | |

The format of the input assembly is:

| Instance 171 (ODVA AC/DC profile) | | | | | | | | |
|---|---|---|---|---|---|---|---|---|
| **Byte** | **Bit 7** | **Bit 6** | **Bit 5** | **Bit 4** | **Bit 3** | **Bit 2** | **Bit 1** | **Bit 0** |
| **0** | At Refer-ence | Ref From Net | Ctrl From Net | Ready | Run-ning2 (Rev) | Run-ning1 (Fwd) | Warn-ing | Faulted |
| **1** | Drive State<br>See section *State (Control supervisor object)* on page *179*. | | | | | | | |
| **2** | Speed Actual (Low Byte) | | | | | | | |
| **3** | Speed Actual (High Byte) | | | | | | | |
| **4** | DATA IN 1 Value (Low Byte) | | | | | | | |
| **5** | DATA IN 1 Value (High Byte) | | | | | | | |
| **6** | DATA IN 2 Value (Low Byte) | | | | | | | |
| **7** | DATA IN 2 Value (High Byte) | | | | | | | |
| **8** | DATA IN 3 Value (Low Byte) | | | | | | | |

| Instance 171 (ODVA AC/DC profile) | | | | | | | | |
|---|---|---|---|---|---|---|---|---|
| **Byte** | **Bit 7** | **Bit 6** | **Bit 5** | **Bit 4** | **Bit 3** | **Bit 2** | **Bit 1** | **Bit 0** |
| **9** | DATA IN 3 Value (High Byte) | | | | | | | |
| **10** | DATA IN 4 Value (Low Byte) | | | | | | | |
| **11** | DATA IN 4 Value (High Byte) | | | | | | | |
| **12** | DATA IN 5 Value (Low Byte) | | | | | | | |
| **13** | DATA IN 5 Value (High Byte) | | | | | | | |
| **14** | DATA IN 6 Value (Low Byte) | | | | | | | |
| **15** | DATA IN 6 Value (High Byte) | | | | | | | |
| **16** | DATA IN 7 Value (Low Byte) | | | | | | | |
| **17** | DATA IN 7 Value (High Byte) | | | | | | | |
| **18** | DATA IN 8 Value (Low Byte) | | | | | | | |
| **19** | DATA IN 8 Value (High Byte) | | | | | | | |
| **20** | DATA IN 9 Value (Low Byte) | | | | | | | |
| **21** | DATA IN 9 Value (High Byte) | | | | | | | |
| **22** | DATA IN 10 Value (Low Byte) | | | | | | | |
| **23** | DATA IN 10 Value (High Byte) | | | | | | | |

## Basic speed and torque control assembly

The Basic speed and torque control assembly is defined by the ODVA AC/DC drive profile. The format of the output assembly is:

| Instance 22 (ODVA AC/DC profile) | | | | | | | | |
|---|---|---|---|---|---|---|---|---|
| **Byte** | **Bit 7** | **Bit 6** | **Bit 5** | **Bit 4** | **Bit 3** | **Bit 2** | **Bit 1** | **Bit 0** |
| **0** | | | | | | Fault Reset | | Run Fwd |
| **1** | | | | | | | | |
| **2** | Speed Reference (Low Byte) | | | | | | | |
| **3** | Speed Reference (High Byte) | | | | | | | |
| **4** | Torque Reference (Low Byte) | | | | | | | |
| **5** | Torque Reference (High Byte) | | | | | | | |

The format of the input assembly is:

| Instance 72 (ODVA AC/DC profile) | | | | | | | | |
|---|---|---|---|---|---|---|---|---|
| **Byte** | **Bit 7** | **Bit 6** | **Bit 5** | **Bit 4** | **Bit 3** | **Bit 2** | **Bit 1** | **Bit 0** |
| **0** | | | | | | Running1 (Fwd) | | Faulted |
| **1** | | | | | | | | |
| **2** | Speed Actual (Low Byte) | | | | | | | |
| **3** | Speed Actual (High Byte) | | | | | | | |
| **4** | Torque Actual (Low Byte) | | | | | | | |
| **5** | Torque Actual (High Byte) | | | | | | | |

## Basic speed and torque control plus drive parameters assembly

The Basic speed and torque control plus drive parameters assembly, defined by ABB, adds configurable drive parameters to the Basic speed and torque control assembly of the ODVA AC/DC drive profile.

The format of the output assembly is:

| Instance 122 (ODVA AC/DC profile) | | | | | | | | |
|---|---|---|---|---|---|---|---|---|
| **Byte** | **Bit 7** | **Bit 6** | **Bit 5** | **Bit 4** | **Bit 3** | **Bit 2** | **Bit 1** | **Bit 0** |
| **0** | | | | | | Fault Reset | | Run Fwd |
| **1** | | | | | | | | |
| **2** | Speed Reference (Low Byte) | | | | | | | |
| **3** | Speed Reference (High Byte) | | | | | | | |
| **4** | Torque Reference (Low Byte) | | | | | | | |
| **5** | Torque Reference (High Byte) | | | | | | | |
| **6** | DATA OUT 1 Value (Low Byte) | | | | | | | |
| **7** | DATA OUT 1 Value (High Byte) | | | | | | | |
| **8** | DATA OUT 2 Value (Low Byte) | | | | | | | |
| **9** | DATA OUT 2 Value (High Byte) | | | | | | | |
| **10** | DATA OUT 3 Value (Low Byte) | | | | | | | |
| **11** | DATA OUT 3 Value (High Byte) | | | | | | | |
| **12** | DATA OUT 4 Value (Low Byte) | | | | | | | |
| **13** | DATA OUT 4 Value (High Byte) | | | | | | | |
| **14** | DATA OUT 5 Value (Low Byte) | | | | | | | |
| **15** | DATA OUT 5 Value (High Byte) | | | | | | | |
| **16** | DATA OUT 6 Value (Low Byte) | | | | | | | |
| **17** | DATA OUT 6 Value (High Byte) | | | | | | | |
| **18** | DATA OUT 7 Value (Low Byte) | | | | | | | |
| **19** | DATA OUT 7 Value (High Byte) | | | | | | | |
| **20** | DATA OUT 8 Value (Low Byte) | | | | | | | |

| Instance 122 (ODVA AC/DC profile) | | | | | | | | |
|---|---|---|---|---|---|---|---|---|
| **Byte** | **Bit 7** | **Bit 6** | **Bit 5** | **Bit 4** | **Bit 3** | **Bit 2** | **Bit 1** | **Bit 0** |
| **21** | DATA OUT 8 Value (High Byte) | | | | | | | |
| **22** | DATA OUT 9 Value (Low Byte) | | | | | | | |
| **23** | DATA OUT 9 Value (High Byte) | | | | | | | |
| **24** | DATA OUT 10 Value (Low Byte) | | | | | | | |
| **25** | DATA OUT 10 Value (High Byte) | | | | | | | |

The format of the input assembly is:

| Instance 172 (ODVA AC/DC profile) | | | | | | | | |
|---|---|---|---|---|---|---|---|---|
| **Byte** | **Bit 7** | **Bit 6** | **Bit 5** | **Bit 4** | **Bit 3** | **Bit 2** | **Bit 1** | **Bit 0** |
| **0** | | | | | | Running1 (Fwd) | | Faulted |
| **1** | | | | | | | | |
| **2** | Speed Actual (Low Byte) | | | | | | | |
| **3** | Speed Actual (High Byte) | | | | | | | |
| **4** | Torque Actual (Low Byte) | | | | | | | |
| **5** | Torque Actual (High Byte) | | | | | | | |
| **6** | DATA IN 1 Value (Low Byte) | | | | | | | |
| **7** | DATA IN 1 Value (High Byte) | | | | | | | |
| **8** | DATA IN 2 Value (Low Byte) | | | | | | | |
| **9** | DATA IN 2 Value (High Byte) | | | | | | | |
| **10** | DATA IN 3 Value (Low Byte) | | | | | | | |
| **11** | DATA IN 3 Value (High Byte) | | | | | | | |
| **12** | DATA IN 4 Value (Low Byte) | | | | | | | |
| **13** | DATA IN 4 Value (High Byte) | | | | | | | |
| **14** | DATA IN 5 Value (Low Byte) | | | | | | | |
| **15** | DATA IN 5 Value (High Byte) | | | | | | | |
| **16** | DATA IN 6 Value (Low Byte) | | | | | | | |
| **17** | DATA IN 6 Value (High Byte) | | | | | | | |

| Instance 172 (ODVA AC/DC profile) | | | | | | | | |
|---|---|---|---|---|---|---|---|---|
| **Byte** | **Bit 7** | **Bit 6** | **Bit 5** | **Bit 4** | **Bit 3** | **Bit 2** | **Bit 1** | **Bit 0** |
| **18** | DATA IN 7 Value (Low Byte) | | | | | | | |
| **19** | DATA IN 7 Value (High Byte) | | | | | | | |
| **20** | DATA IN 8 Value (Low Byte) | | | | | | | |
| **21** | DATA IN 8 Value (High Byte) | | | | | | | |
| **22** | DATA IN 9 Value (Low Byte) | | | | | | | |
| **23** | DATA IN 9 Value (High Byte) | | | | | | | |
| **24** | DATA IN 10 Value (Low Byte) | | | | | | | |
| **25** | DATA IN 10 Value (High Byte) | | | | | | | |

## Extended speed and torque control assembly

The Extended speed and torque control assembly is defined by the ODVA AC/DC drive profile. The format of the output assembly is:

| Instance 23 (ODVA AC/DC profile) | | | | | | | | |
|---|---|---|---|---|---|---|---|---|
| **Byte** | **Bit 7** | **Bit 6** | **Bit 5** | **Bit 4** | **Bit 3** | **Bit 2** | **Bit 1** | **Bit 0** |
| **0** | | Net Ref | Net Ctrl | | | Fault Reset | Run Rev | Run Fwd |
| **1** | | | | | | | | |
| **2** | Speed Reference (Low Byte) | | | | | | | |
| **3** | Speed Reference (High Byte) | | | | | | | |
| **4** | Torque Reference (Low Byte) | | | | | | | |
| **5** | Torque Reference (High Byte) | | | | | | | |

The format of the input assembly is:

| Instance 73 (ODVA AC/DC profile) | | | | | | | | |
|---|---|---|---|---|---|---|---|---|
| **Byte** | **Bit 7** | **Bit 6** | **Bit 5** | **Bit 4** | **Bit 3** | **Bit 2** | **Bit 1** | **Bit 0** |
| **0** | At Reference | Ref From Net | Ctrl From Net | Ready | Running2 (Rev) | Running1 (Fwd) | Warning | Faulted |
| **1** | Drive State<br>See section *State (Control supervisor object)* on page *179*. | | | | | | | |
| **2** | Speed Actual (Low Byte) | | | | | | | |
| **3** | Speed Actual (High Byte) | | | | | | | |
| **4** | Torque Actual (Low Byte) | | | | | | | |
| **5** | Torque Actual (High Byte) | | | | | | | |

## Extended speed and torque control plus drive parameters assembly

The Extended speed and torque control plus drive parameters assembly, defined by ABB, adds configurable drive parameters to the Extended speed and torque control assembly of the ODVA AC/DC drive profile.

The format of the output assembly is:

| Instance 123 (ODVA AC/DC profile) | | | | | | | | |
|---|---|---|---|---|---|---|---|---|
| **Byte** | **Bit 7** | **Bit 6** | **Bit 5** | **Bit 4** | **Bit 3** | **Bit 2** | **Bit 1** | **Bit 0** |
| **0** | | NetRef | NetCtl | | | Fault Reset | Run Rev | Run Fwd |
| **1** | | | | | | | | |
| **2** | Speed Reference (Low Byte) | | | | | | | |
| **3** | Speed Reference (High Byte) | | | | | | | |
| **4** | Torque Reference (Low Byte) | | | | | | | |
| **5** | Torque Reference (High Byte) | | | | | | | |
| **6** | DATA OUT 1 Value (Low Byte) | | | | | | | |
| **7** | DATA OUT 1 Value (High Byte) | | | | | | | |
| **8** | DATA OUT 2 Value (Low Byte) | | | | | | | |

| Instance 123 (ODVA AC/DC profile) | | | | | | | | |
|---|---|---|---|---|---|---|---|---|
| **Byte** | **Bit 7** | **Bit 6** | **Bit 5** | **Bit 4** | **Bit 3** | **Bit 2** | **Bit 1** | **Bit 0** |
| **9** | DATA OUT 2 Value (High Byte) | | | | | | | |
| **10** | DATA OUT 3 Value (Low Byte) | | | | | | | |
| **11** | DATA OUT 3 Value (High Byte) | | | | | | | |
| **12** | DATA OUT 4 Value (Low Byte) | | | | | | | |
| **13** | DATA OUT 4 Value (High Byte) | | | | | | | |
| **14** | DATA OUT 5 Value (Low Byte) | | | | | | | |
| **15** | DATA OUT 5 Value (High Byte) | | | | | | | |
| **16** | DATA OUT 6 Value (Low Byte) | | | | | | | |
| **17** | DATA OUT 6 Value (High Byte) | | | | | | | |
| **18** | DATA OUT 7 Value (Low Byte) | | | | | | | |
| **19** | DATA OUT 7 Value (High Byte) | | | | | | | |
| **20** | DATA OUT 8 Value (Low Byte) | | | | | | | |
| **21** | DATA OUT 8 Value (High Byte) | | | | | | | |
| **22** | DATA OUT 9 Value (Low Byte) | | | | | | | |
| **23** | DATA OUT 9 Value (High Byte) | | | | | | | |
| **24** | DATA OUT 10 Value (Low Byte) | | | | | | | |
| **25** | DATA OUT 10 Value (High Byte) | | | | | | | |

The format of the input assembly is:

| Instance 173 (ODVA AC/DC profile) | | | | | | | | |
|---|---|---|---|---|---|---|---|---|
| **Byte** | **Bit 7** | **Bit 6** | **Bit 5** | **Bit 4** | **Bit 3** | **Bit 2** | **Bit 1** | **Bit 0** |
| **0** | At Refer-ence | Ref From Net | Ctrl From Net | Ready | Run-ning2 (Rev) | Run-ning1 (Fwd) | Warn-ing | Faulted |
| **1** | Drive State<br>See section *State (Control supervisor object)* on page *179*. | | | | | | | |
| **2** | Speed Actual (Low Byte) | | | | | | | |
| **3** | Speed Actual (High Byte) | | | | | | | |
| **4** | Torque Actual (Low Byte) | | | | | | | |

| Instance 173 (ODVA AC/DC profile) | | | | | | | | |
|---|---|---|---|---|---|---|---|---|
| **Byte** | **Bit 7** | **Bit 6** | **Bit 5** | **Bit 4** | **Bit 3** | **Bit 2** | **Bit 1** | **Bit 0** |
| **5** | Torque Actual (High Byte) | | | | | | | |
| **6** | DATA IN 1 Value (Low Byte) | | | | | | | |
| **7** | DATA IN 1 Value (High Byte) | | | | | | | |
| **8** | DATA IN 2 Value (Low Byte) | | | | | | | |
| **9** | DATA IN 2 Value (High Byte) | | | | | | | |
| **10** | DATA IN 3 Value (Low Byte) | | | | | | | |
| **11** | DATA IN 3 Value (High Byte) | | | | | | | |
| **12** | DATA IN 4 Value (Low Byte) | | | | | | | |
| **13** | DATA IN 4 Value (High Byte) | | | | | | | |
| **14** | DATA IN 5 Value (Low Byte) | | | | | | | |
| **15** | DATA IN 5 Value (High Byte) | | | | | | | |
| **16** | DATA IN 6 Value (Low Byte) | | | | | | | |
| **17** | DATA IN 6 Value (High Byte) | | | | | | | |
| **18** | DATA IN 7 Value (Low Byte) | | | | | | | |
| **19** | DATA IN 7 Value (High Byte) | | | | | | | |
| **20** | DATA IN 8 Value (Low Byte) | | | | | | | |
| **21** | DATA IN 8 Value (High Byte) | | | | | | | |
| **22** | DATA IN 9 Value (Low Byte) | | | | | | | |
| **23** | DATA IN 9 Value (High Byte) | | | | | | | |
| **24** | DATA IN 10 Value (Low Byte) | | | | | | | |
| **25** | DATA IN 10 Value (High Byte) | | | | | | | |

## ABB Drives profile with set speed assembly

The ABB Drives profile with set speed assembly is defined by ABB. The format of the output assembly is:

| Instance 1 (ABB Drives profile) | | | | | | | | |
|---|---|---|---|---|---|---|---|---|
| **Byte** | **Bit 7** | **Bit 6** | **Bit 5** | **Bit 4** | **Bit 3** | **Bit 2** | **Bit 1** | **Bit 0** |
| **0** | Reset | Ramp in Zero | Ramp Hold | Ramp Out Zero | Inhibit Oper-ation | Off 3 Control | Off 2 Control | Off 1 Control |
| **1** | | | | | Ext Ctrl Loc | Remote Cmd | | |
| **2** | Set Speed (Low Byte) | | | | | | | |
| **3** | Set Speed (High Byte) | | | | | | | |

The format of the input assembly is:

| Instance 51 (ABB Drives profile) | | | | | | | | |
|---|---|---|---|---|---|---|---|---|
| **Byte** | **Bit 7** | **Bit 6** | **Bit 5** | **Bit 4** | **Bit 3** | **Bit 2** | **Bit 1** | **Bit 0** |
| **0** | Alarm | Swc On Inhib | Off 3 Sta | Off 2 Sta | Tripped | Rdy Ref | Rdy Run | Rdy On |
| **1** | Field-bus Error | | | Ext Run Enable | Ext Ctrl Loc | Above Limit | Re-mote | At Set-point |
| **2** | Actual Speed (Low Byte) | | | | | | | |
| **3** | Actual Speed (High Byte) | | | | | | | |

## ABB Drives profile with set speed plus drive parameters assembly

The ABB Drives profile with set speed plus drive parameters assembly, defined by ABB, adds configurable drive parameters to the ABB Drives profile with set speed of the ABB Drives profile.

The format of the output assembly is:

| Instance 101 (ABB Drives profile) | | | | | | | | |
|---|---|---|---|---|---|---|---|---|
| **Byte** | **Bit 7** | **Bit 6** | **Bit 5** | **Bit 4** | **Bit 3** | **Bit 2** | **Bit 1** | **Bit 0** |
| **0** | Reset | Ramp in Zero | Ramp Hold | Ramp Out Zero | Inhibit Oper-ation | Off 3 Control | Off 2 Con-trol | Off 1 Con-trol |
| **1** | | | | | Ext Ctrl Loc | Remote Cmd | | |
| **2** | Set Speed (Low Byte) | | | | | | | |
| **3** | Set Speed (High Byte) | | | | | | | |
| **4** | DATA OUT 1 Value (Low Byte) | | | | | | | |
| **5** | DATA OUT 1 Value (High Byte) | | | | | | | |
| **6** | DATA OUT 2 Value (Low Byte) | | | | | | | |
| **7** | DATA OUT 2 Value (High Byte) | | | | | | | |
| **8** | DATA OUT 3 Value (Low Byte) | | | | | | | |
| **9** | DATA OUT 3 Value (High Byte) | | | | | | | |
| **10** | DATA OUT 4 Value (Low Byte) | | | | | | | |
| **11** | DATA OUT 4 Value (High Byte) | | | | | | | |
| **12** | DATA OUT 5 Value (Low Byte) | | | | | | | |
| **13** | DATA OUT 5 Value (High Byte) | | | | | | | |
| **14** | DATA OUT 6 Value (Low Byte) | | | | | | | |
| **15** | DATA OUT 6 Value (High Byte) | | | | | | | |
| **16** | DATA OUT 7 Value (Low Byte) | | | | | | | |
| **17** | DATA OUT 7 Value (High Byte) | | | | | | | |
| **18** | DATA OUT 8 Value (Low Byte) | | | | | | | |

| Instance 101 (ABB Drives profile) | | | | | | | | |
|---|---|---|---|---|---|---|---|---|
| **Byte** | **Bit 7** | **Bit 6** | **Bit 5** | **Bit 4** | **Bit 3** | **Bit 2** | **Bit 1** | **Bit 0** |
| **19** | DATA OUT 8 Value (High Byte) | | | | | | | |
| **20** | DATA OUT 9 Value (Low Byte) | | | | | | | |
| **21** | DATA OUT 9 Value (High Byte) | | | | | | | |
| **22** | DATA OUT 10 Value (Low Byte) | | | | | | | |
| **23** | DATA OUT 10 Value (High Byte) | | | | | | | |

The format of the input assembly is:

| Instance 151 (ABB Drives profile) | | | | | | | | |
|---|---|---|---|---|---|---|---|---|
| **Byte** | **Bit 7** | **Bit 6** | **Bit 5** | **Bit 4** | **Bit 3** | **Bit 2** | **Bit 1** | **Bit 0** |
| **0** | Alarm | Swc On Inhib | Off 3 Sta | Off 2 Sta | Tripped | Rdy Ref | Rdy Run | Rdy On |
| **1** | Field-bus Error | | | Ext Run Enable | Ext Ctrl Loc | Above Limit | Remote | At Set-point |
| **2** | Actual Speed (Low Byte) | | | | | | | |
| **3** | Actual Speed (High Byte) | | | | | | | |
| **4** | DATA IN 1 Value (Low Byte) | | | | | | | |
| **5** | DATA IN 1 Value (High Byte) | | | | | | | |
| **6** | DATA IN 2 Value (Low Byte) | | | | | | | |
| **7** | DATA IN 2 Value (High Byte) | | | | | | | |
| **8** | DATA IN 3 Value (Low Byte) | | | | | | | |
| **9** | DATA IN 3 Value (High Byte) | | | | | | | |
| **10** | DATA IN 4 Value (Low Byte) | | | | | | | |
| **11** | DATA IN 4 Value (High Byte) | | | | | | | |
| **12** | DATA IN 5 Value (Low Byte) | | | | | | | |
| **13** | DATA IN 5 Value (High Byte) | | | | | | | |
| **14** | DATA IN 6 Value (Low Byte) | | | | | | | |
| **15** | DATA IN 6 Value (High Byte) | | | | | | | |

| Instance 151 (ABB Drives profile) | | | | | | | | |
|---|---|---|---|---|---|---|---|---|
| **Byte** | **Bit 7** | **Bit 6** | **Bit 5** | **Bit 4** | **Bit 3** | **Bit 2** | **Bit 1** | **Bit 0** |
| **16** | DATA IN 7 Value (Low Byte) | | | | | | | |
| **17** | DATA IN 7 Value (High Byte) | | | | | | | |
| **18** | DATA IN 8 Value (Low Byte) | | | | | | | |
| **19** | DATA IN 8 Value (High Byte) | | | | | | | |
| **20** | DATA IN 9 Value (Low Byte) | | | | | | | |
| **21** | DATA IN 9 Value (High Byte) | | | | | | | |
| **22** | DATA IN 10 Value (Low Byte) | | | | | | | |
| **23** | DATA IN 10 Value (High Byte) | | | | | | | |

## ABB Drives profile with set speed and set torque assembly

The ABB Drives profile with set speed and set torque assembly is defined by ABB. The format of the output assembly is:

| Instance 2 (ABB Drives profile) | | | | | | | | |
|---|---|---|---|---|---|---|---|---|
| **Byte** | **Bit 7** | **Bit 6** | **Bit 5** | **Bit 4** | **Bit 3** | **Bit 2** | **Bit 1** | **Bit 0** |
| **0** | Reset | Ramp in Zero | Ramp Hold | Ramp Out Zero | Inhibit Oper-ation | Off 3 Control | Off 2 Control | Off 1 Control |
| **1** | | | | | Ext Ctrl Loc | Remote Cmd | | |
| **2** | Set Speed (Low Byte) | | | | | | | |
| **3** | Set Speed (High Byte) | | | | | | | |
| **4** | Set Torque (Low Byte) | | | | | | | |
| **5** | Set Torque (High Byte) | | | | | | | |

The format of the input assembly is:

| Instance 52 (ABB Drives profile) | | | | | | | | |
|---|---|---|---|---|---|---|---|---|
| **Byte** | **Bit 7** | **Bit 6** | **Bit 5** | **Bit 4** | **Bit 3** | **Bit 2** | **Bit 1** | **Bit 0** |
| **0** | Alarm | Swc On Inhib | Off 3 Sta | Off 2 Sta | Tripped | Rdy Ref | Rdy Run | Rdy On |
| **1** | Field-bus Error | | | Ext Run Enable | Ext Ctrl Loc | Above Limit | Remote | At Set-point |
| **2** | Actual Speed (Low Byte) | | | | | | | |
| **3** | Actual Speed (High Byte) | | | | | | | |
| **4** | Actual Torque (Low Byte) | | | | | | | |
| **5** | Actual Torque (High Byte) | | | | | | | |

## ABB Drives profile with set speed and set torque plus drive parameters assembly

The ABB Drives profile with set speed and set torque plus drive parameters assembly, defined by ABB, adds configurable drive parameters to the ABB Drives profile with set speed and set torque of the ABB Drives profile.

The format of the output assembly is:

| Instance 102 (ABB Drives profile) | | | | | | | | |
|---|---|---|---|---|---|---|---|---|
| **Byte** | **Bit 7** | **Bit 6** | **Bit 5** | **Bit 4** | **Bit 3** | **Bit 2** | **Bit 1** | **Bit 0** |
| **0** | Reset | Ramp in Zero | Ramp Hold | Ramp Out Zero | Inhibit Oper-ation | Off 3 Con-trol | Off 2 Con-trol | Off 1 Con-trol |
| **1** | | | | | Ext Ctrl Loc | Re-mote Cmd | | |
| **2** | Set Speed (Low Byte) | | | | | | | |
| **3** | Set Speed (High Byte) | | | | | | | |
| **4** | Set Torque (Low Byte) | | | | | | | |
| **5** | Set Torque (High Byte) | | | | | | | |

| Instance 102 (ABB Drives profile) | | | | | | | | |
|---|---|---|---|---|---|---|---|---|
| **Byte** | **Bit 7** | **Bit 6** | **Bit 5** | **Bit 4** | **Bit 3** | **Bit 2** | **Bit 1** | **Bit 0** |
| **6** | DATA OUT 1 Value (Low Byte) | | | | | | | |
| **7** | DATA OUT 1 Value (High Byte) | | | | | | | |
| **8** | DATA OUT 2 Value (Low Byte) | | | | | | | |
| **9** | DATA OUT 2 Value (High Byte) | | | | | | | |
| **10** | DATA OUT 3 Value (Low Byte) | | | | | | | |
| **11** | DATA OUT 3 Value (High Byte) | | | | | | | |
| **12** | DATA OUT 4 Value (Low Byte) | | | | | | | |
| **13** | DATA OUT 4 Value (High Byte) | | | | | | | |
| **14** | DATA OUT 5 Value (Low Byte) | | | | | | | |
| **15** | DATA OUT 5 Value (High Byte) | | | | | | | |
| **16** | DATA OUT 6 Value (Low Byte) | | | | | | | |
| **17** | DATA OUT 6 Value (High Byte) | | | | | | | |
| **18** | DATA OUT 7 Value (Low Byte) | | | | | | | |
| **19** | DATA OUT 7 Value (High Byte) | | | | | | | |
| **20** | DATA OUT 8 Value (Low Byte) | | | | | | | |
| **21** | DATA OUT 8 Value (High Byte) | | | | | | | |
| **22** | DATA OUT 9 Value (Low Byte) | | | | | | | |
| **23** | DATA OUT 9 Value (High Byte) | | | | | | | |
| **24** | DATA OUT 10 Value (Low Byte) | | | | | | | |
| **25** | DATA OUT 10 Value (High Byte) | | | | | | | |

The format of the input assembly is:

| Instance 152 (ABB Drives profile) | | | | | | | | |
|---|---|---|---|---|---|---|---|---|
| **Byte** | **Bit 7** | **Bit 6** | **Bit 5** | **Bit 4** | **Bit 3** | **Bit 2** | **Bit 1** | **Bit 0** |
| **0** | Alarm | Swc On Inhib | Off 3 Sta | Off 2 Sta | Tripped | Rdy Ref | Rdy Run | Rdy On |
| **1** | Field-bus Error | | | Ext Run Enable | Ext Ctrl Loc | Above Limit | Remote | At Set-point |
| **2** | Actual Speed (Low Byte) | | | | | | | |
| **3** | Actual Speed (High Byte) | | | | | | | |
| **4** | Actual Torque (Low Byte) | | | | | | | |
| **5** | Actual Torque (High Byte) | | | | | | | |
| **6** | DATA IN 1 Value (Low Byte) | | | | | | | |
| **7** | DATA IN 1 Value (High Byte) | | | | | | | |
| **8** | DATA IN 2 Value (Low Byte) | | | | | | | |
| **9** | DATA IN 2 Value (High Byte) | | | | | | | |
| **10** | DATA IN 3 Value (Low Byte) | | | | | | | |
| **11** | DATA IN 3 Value (High Byte) | | | | | | | |
| **12** | DATA IN 4 Value (Low Byte) | | | | | | | |
| **13** | DATA IN 4 Value (High Byte) | | | | | | | |
| **14** | DATA IN 5 Value (Low Byte) | | | | | | | |
| **15** | DATA IN 5 Value (High Byte) | | | | | | | |
| **16** | DATA IN 6 Value (Low Byte) | | | | | | | |
| **17** | DATA IN 6 Value (High Byte) | | | | | | | |
| **18** | DATA IN 7 Value (Low Byte) | | | | | | | |
| **19** | DATA IN 7 Value (High Byte) | | | | | | | |
| **20** | DATA IN 8 Value (Low Byte) | | | | | | | |
| **21** | DATA IN 8 Value (High Byte) | | | | | | | |
| **22** | DATA IN 9 Value (Low Byte) | | | | | | | |
| **23** | DATA IN 9 Value (High Byte) | | | | | | | |

| Instance 152 (ABB Drives profile) | | | | | | | | |
|---|---|---|---|---|---|---|---|---|
| **Byte** | **Bit 7** | **Bit 6** | **Bit 5** | **Bit 4** | **Bit 3** | **Bit 2** | **Bit 1** | **Bit 0** |
| **24** | DATA IN 10 Value (Low Byte) | | | | | | | |
| **25** | DATA IN 10 Value (High Byte) | | | | | | | |

## Transparent 16 with one assembly

The Transparent 16 with one assembly, defined by ABB, provides unaltered 16-bit access to the configured drive profile.

The format of the output assembly is:

| Instance 11 (Transparent 16 profile) | | | | | | | | |
|---|---|---|---|---|---|---|---|---|
| **Byte** | **Bit 7** | **Bit 6** | **Bit 5** | **Bit 4** | **Bit 3** | **Bit 2** | **Bit 1** | **Bit 0** |
| **0** | Drive Profile 16-bit Control Word (Low Byte) | | | | | | | |
| **1** | Drive Profile 16-bit Control Word (High Byte) | | | | | | | |
| **2** | Drive Profile 16-bit Reference 1 Word (Low Byte) | | | | | | | |
| **3** | Drive Profile 16-bit Reference 1 Word (High Byte) | | | | | | | |

The format of the input assembly is:

| Instance 61 (Transparent 16 profile) | | | | | | | | |
|---|---|---|---|---|---|---|---|---|
| **Byte** | **Bit 7** | **Bit 6** | **Bit 5** | **Bit 4** | **Bit 3** | **Bit 2** | **Bit 1** | **Bit 0** |
| **0** | Drive Profile 16-bit Status Word (Low Byte) | | | | | | | |
| **1** | Drive Profile 16-bit Status Word (High Byte) | | | | | | | |
| **2** | Drive Profile 16-bit Actual 1 Word (Low Byte) | | | | | | | |
| **3** | Drive Profile 16-bit Actual 1 Word (High Byte) | | | | | | | |

## Transparent 16 with one assembly plus drive parameters

The Transparent 16 with one assembly plus drive parameters, defined by ABB, adds configurable drive parameters to the Transparent 16 with one assembly.

The format of the output assembly is:

| Instance 111 (Transparent 16 profile) | | | | | | | | |
|---|---|---|---|---|---|---|---|---|
| **Byte** | **Bit 7** | **Bit 6** | **Bit 5** | **Bit 4** | **Bit 3** | **Bit 2** | **Bit 1** | **Bit 0** |
| **0** | Drive Profile 16-bit Control Word (Low Byte) | | | | | | | |
| **1** | Drive Profile 16-bit Control Word (High Byte) | | | | | | | |
| **2** | Drive Profile 16-bit Reference 1 Word (Low Byte) | | | | | | | |
| **3** | Drive Profile 16-bit Reference 1 Word (High Byte) | | | | | | | |
| **4** | DATA OUT 1 Value (Low Byte) | | | | | | | |
| **5** | DATA OUT 1 Value (High Byte) | | | | | | | |
| **6** | DATA OUT 2 Value (Low Byte) | | | | | | | |
| **7** | DATA OUT 2 Value (High Byte) | | | | | | | |
| **8** | DATA OUT 3 Value (Low Byte) | | | | | | | |
| **9** | DATA OUT 3 Value (High Byte) | | | | | | | |
| **10** | DATA OUT 4 Value (Low Byte) | | | | | | | |
| **11** | DATA OUT 4 Value (High Byte) | | | | | | | |
| **12** | DATA OUT 5 Value (Low Byte) | | | | | | | |
| **13** | DATA OUT 5 Value (High Byte) | | | | | | | |
| **14** | DATA OUT 6 Value (Low Byte) | | | | | | | |
| **15** | DATA OUT 6 Value (High Byte) | | | | | | | |
| **16** | DATA OUT 7 Value (Low Byte) | | | | | | | |
| **17** | DATA OUT 7 Value (High Byte) | | | | | | | |
| **18** | DATA OUT 8 Value (Low Byte) | | | | | | | |
| **19** | DATA OUT 8 Value (High Byte) | | | | | | | |
| **20** | DATA OUT 9 Value (Low Byte) | | | | | | | |
| **21** | DATA OUT 9 Value (High Byte) | | | | | | | |

| Instance 111 (Transparent 16 profile) | | | | | | | | |
|---|---|---|---|---|---|---|---|---|
| **Byte** | **Bit 7** | **Bit 6** | **Bit 5** | **Bit 4** | **Bit 3** | **Bit 2** | **Bit 1** | **Bit 0** |
| **22** | DATA OUT 10 Value (Low Byte) | | | | | | | |
| **23** | DATA OUT 10 Value (High Byte) | | | | | | | |

The format of the input assembly is:

| Instance 161 (Transparent 16 profile) | | | | | | | | |
|---|---|---|---|---|---|---|---|---|
| **Byte** | **Bit 7** | **Bit 6** | **Bit 5** | **Bit 4** | **Bit 3** | **Bit 2** | **Bit 1** | **Bit 0** |
| **0** | Drive Profile 16-bit Status Word (Low Byte) | | | | | | | |
| **1** | Drive Profile 16-bit Status Word (High Byte) | | | | | | | |
| **2** | Drive Profile 16-bit Actual 1 Word (Low Byte) | | | | | | | |
| **3** | Drive Profile 16-bit Actual 1 Word (High Byte) | | | | | | | |
| **4** | DATA IN 1 Value (Low Byte) | | | | | | | |
| **5** | DATA IN 1 Value (High Byte) | | | | | | | |
| **6** | DATA IN 2 Value (Low Byte) | | | | | | | |
| **7** | DATA IN 2 Value (High Byte) | | | | | | | |
| **8** | DATA IN 3 Value (Low Byte) | | | | | | | |
| **9** | DATA IN 3 Value (High Byte) | | | | | | | |
| **10** | DATA IN 4 Value (Low Byte) | | | | | | | |
| **11** | DATA IN 4 Value (High Byte) | | | | | | | |
| **12** | DATA IN 5 Value (Low Byte) | | | | | | | |
| **13** | DATA IN 5 Value (High Byte) | | | | | | | |
| **14** | DATA IN 6 Value (Low Byte) | | | | | | | |
| **15** | DATA IN 6 Value (High Byte) | | | | | | | |
| **16** | DATA IN 7 Value (Low Byte) | | | | | | | |
| **17** | DATA IN 7 Value (High Byte) | | | | | | | |
| **18** | DATA IN 8 Value (Low Byte) | | | | | | | |
| **19** | DATA IN 8 Value (High Byte) | | | | | | | |
| **20** | DATA IN 9 Value (Low Byte) | | | | | | | |
| **21** | DATA IN 9 Value (High Byte) | | | | | | | |

| Instance 161 (Transparent 16 profile) | | | | | | | | |
|---|---|---|---|---|---|---|---|---|
| **Byte** | **Bit 7** | **Bit 6** | **Bit 5** | **Bit 4** | **Bit 3** | **Bit 2** | **Bit 1** | **Bit 0** |
| **22** | DATA IN 10 Value (Low Byte) | | | | | | | |
| **23** | DATA IN 10 Value (High Byte) | | | | | | | |

## Transparent 16 with two assembly

The Transparent 16 with two assembly, defined by ABB, provides unaltered 16-bit access to the configured drive profile.

The format of the output assembly is:

| Instance 12 (Transparent 16 profile) | | | | | | | | |
|---|---|---|---|---|---|---|---|---|
| **Byte** | **Bit 7** | **Bit 6** | **Bit 5** | **Bit 4** | **Bit 3** | **Bit 2** | **Bit 1** | **Bit 0** |
| **0** | Drive Profile 16-bit Control Word (Low Byte) | | | | | | | |
| **1** | Drive Profile 16-bit Control Word (High Byte) | | | | | | | |
| **2** | Drive Profile 16-bit Reference 1 Word (Low Byte) | | | | | | | |
| **3** | Drive Profile 16-bit Reference 1 Word (High Byte) | | | | | | | |
| **4** | Drive Profile16-bit Reference 2 Word (Low Byte) | | | | | | | |
| **5** | Drive Profile 16-bit Reference 2 Word (High Byte) | | | | | | | |

The format of the input assembly is:

| Instance 62 (Transparent 16 profile) | | | | | | | | |
|---|---|---|---|---|---|---|---|---|
| **Byte** | **Bit 7** | **Bit 6** | **Bit 5** | **Bit 4** | **Bit 3** | **Bit 2** | **Bit 1** | **Bit 0** |
| **0** | Drive Profile 16-bit Status Word (Low Byte) | | | | | | | |
| **1** | Drive Profile 16-bit Status Word (High Byte) | | | | | | | |
| **2** | Drive Profile 16-bit Actual 1 Word (Low Byte) | | | | | | | |
| **3** | Drive Profile 16-bit Actual 1 Word (High Byte) | | | | | | | |
| **4** | Drive Profile16-bit Actual 2 Word (Low Byte) | | | | | | | |
| **5** | Drive Profile 16-bit Actual 2 Word (High Byte) | | | | | | | |

## Transparent 16 with two assembly plus drive parameters

The Transparent 16 with two assembly plus drive parameters, defined by ABB, adds configurable drive parameters to the Transparent 16 with two assembly.

The format of the output assembly is:

| Instance 112 (Transparent 16 profile) | | | | | | | | |
|---|---|---|---|---|---|---|---|---|
| **Byte** | **Bit 7** | **Bit 6** | **Bit 5** | **Bit 4** | **Bit 3** | **Bit 2** | **Bit 1** | **Bit 0** |
| **0** | Drive Profile 16-bit Control Word (Low Byte) | | | | | | | |
| **1** | Drive Profile 16-bit Control Word (High Byte) | | | | | | | |
| **2** | Drive Profile 16-bit Reference 1 Word (Low Byte) | | | | | | | |
| **3** | Drive Profile 16-bit Reference 1 Word (High Byte) | | | | | | | |
| **4** | Drive Profile 16-bit Reference 2 Word (Low Byte) | | | | | | | |
| **5** | Drive Profile 16-bit Reference 2 Word (High Byte) | | | | | | | |
| **6** | DATA OUT 1 Value (Low Byte) | | | | | | | |
| **7** | DATA OUT 1 Value (High Byte) | | | | | | | |
| **8** | DATA OUT 2 Value (Low Byte) | | | | | | | |
| **9** | DATA OUT 2 Value (High Byte) | | | | | | | |
| **10** | DATA OUT 3 Value (Low Byte) | | | | | | | |
| **11** | DATA OUT 3 Value (High Byte) | | | | | | | |
| **12** | DATA OUT 4 Value (Low Byte) | | | | | | | |
| **13** | DATA OUT 4 Value (High Byte) | | | | | | | |
| **14** | DATA OUT 5 Value (Low Byte) | | | | | | | |
| **15** | DATA OUT 5 Value (High Byte) | | | | | | | |
| **16** | DATA OUT 6 Value (Low Byte) | | | | | | | |
| **17** | DATA OUT 6 Value (High Byte) | | | | | | | |
| **18** | DATA OUT 7 Value (Low Byte) | | | | | | | |
| **19** | DATA OUT 7 Value (High Byte) | | | | | | | |
| **20** | DATA OUT 8 Value (Low Byte) | | | | | | | |
| **21** | DATA OUT 8 Value (High Byte) | | | | | | | |

| Instance 112 (Transparent 16 profile) | | | | | | | | |
|---|---|---|---|---|---|---|---|---|
| **Byte** | **Bit 7** | **Bit 6** | **Bit 5** | **Bit 4** | **Bit 3** | **Bit 2** | **Bit 1** | **Bit 0** |
| **22** | DATA OUT 9 Value (Low Byte) | | | | | | | |
| **23** | DATA OUT 9 Value (High Byte) | | | | | | | |
| **24** | DATA OUT 10 Value (Low Byte) | | | | | | | |
| **25** | DATA OUT 10 Value (High Byte) | | | | | | | |

The format of the input assembly is:

| Instance 162 (Transparent 16 profile) | | | | | | | | |
|---|---|---|---|---|---|---|---|---|
| **Byte** | **Bit 7** | **Bit 6** | **Bit 5** | **Bit 4** | **Bit 3** | **Bit 2** | **Bit 1** | **Bit 0** |
| **0** | Drive Profile 16-bit Status Word (Low Byte) | | | | | | | |
| **1** | Drive Profile 16-bit Status Word (High Byte) | | | | | | | |
| **2** | Drive Profile 16-bit Actual 1 Word (Low Byte) | | | | | | | |
| **3** | Drive Profile 16-bit Actual 1 Word (High Byte) | | | | | | | |
| **4** | Drive Profile 16-bit Actual 2 Word (Low Byte) | | | | | | | |
| **5** | Drive Profile 16-bit Actual 2 Word (High Byte) | | | | | | | |
| **6** | DATA IN 1 Value (Low Byte) | | | | | | | |
| **7** | DATA IN 1 Value (High Byte) | | | | | | | |
| **8** | DATA IN 2 Value (Low Byte) | | | | | | | |
| **9** | DATA IN 2 Value (High Byte) | | | | | | | |
| **10** | DATA IN 3 Value (Low Byte) | | | | | | | |
| **11** | DATA IN 3 Value (High Byte) | | | | | | | |
| **12** | DATA IN 4 Value (Low Byte) | | | | | | | |
| **13** | DATA IN 4 Value (High Byte) | | | | | | | |
| **14** | DATA IN 5 Value (Low Byte) | | | | | | | |
| **15** | DATA IN 5 Value (High Byte) | | | | | | | |
| **16** | DATA IN 6 Value (Low Byte) | | | | | | | |
| **17** | DATA IN 6 Value (High Byte) | | | | | | | |
| **18** | DATA IN 7 Value (Low Byte) | | | | | | | |
| **19** | DATA IN 7 Value (High Byte) | | | | | | | |

| Instance 162 (Transparent 16 profile) | | | | | | | | |
|---|---|---|---|---|---|---|---|---|
| **Byte** | **Bit 7** | **Bit 6** | **Bit 5** | **Bit 4** | **Bit 3** | **Bit 2** | **Bit 1** | **Bit 0** |
| **20** | DATA IN 8 Value (Low Byte) | | | | | | | |
| **21** | DATA IN 8 Value (High Byte) | | | | | | | |
| **22** | DATA IN 9 Value (Low Byte) | | | | | | | |
| **23** | DATA IN 9 Value (High Byte) | | | | | | | |
| **24** | DATA IN 10 Value (Low Byte) | | | | | | | |
| **25** | DATA IN 10 Value (High Byte) | | | | | | | |

## Transparent 32 with one assembly

The Transparent 32 with one assembly, defined by ABB, provides unaltered 32-bit access to the configured drive profile.

The format of the output assembly is:

| Instance 21 (Transparent 32 profile) | | | | | | | | |
|---|---|---|---|---|---|---|---|---|
| **Byte** | **Bit 7** | **Bit 6** | **Bit 5** | **Bit 4** | **Bit 3** | **Bit 2** | **Bit 1** | **Bit 0** |
| **0** | Drive Profile 32-bit Control Word (Low Byte) | | | | | | | |
| **1** | Drive Profile 32-bit Control Word | | | | | | | |
| **2** | Drive Profile 32-bit Control Word | | | | | | | |
| **3** | Drive Profile 32-bit Control Word (High Byte) | | | | | | | |
| **4** | Drive Profile 32-bit Reference 1 Word (Low Byte) | | | | | | | |
| **5** | Drive Profile 32-bit Reference 1 Word | | | | | | | |
| **6** | Drive Profile 32-bit Reference 1 Word | | | | | | | |
| **7** | Drive Profile 32-bit Reference 1 Word (High Byte) | | | | | | | |

The format of the input assembly is:

| Instance 71 (Transparent 32 profile) | | | | | | | | |
|---|---|---|---|---|---|---|---|---|
| **Byte** | **Bit 7** | **Bit 6** | **Bit 5** | **Bit 4** | **Bit 3** | **Bit 2** | **Bit 1** | **Bit 0** |
| **0** | Drive Profile 32-bit Status Word (Low Byte) | | | | | | | |
| **1** | Drive Profile 32-bit Status Word | | | | | | | |
| **2** | Drive Profile 32-bit Status Word | | | | | | | |
| **3** | Drive Profile 32-bit Status Word (High Byte) | | | | | | | |
| **4** | Drive Profile 32-bit Actual 1 Word (Low Byte) | | | | | | | |
| **5** | Drive Profile 32-bit Actual 1 Word | | | | | | | |
| **6** | Drive Profile 32-bit Actual 1 Word | | | | | | | |
| **7** | Drive Profile 32-bit Actual 1 Word (High Byte) | | | | | | | |

### Transparent 32 with one assembly plus drive parameters

The Transparent 32 with one assembly plus drive parameters, defined by ABB, adds configurable drive parameters to the Transparent 32 with one assembly.

The format of the output assembly is:

| Instance 121 (Transparent 32 profile) | | | | | | | | |
|---|---|---|---|---|---|---|---|---|
| **Byte** | **Bit 7** | **Bit 6** | **Bit 5** | **Bit 4** | **Bit 3** | **Bit 2** | **Bit 1** | **Bit 0** |
| **0** | Drive Profile 32-bit Control Word (Low Byte) | | | | | | | |
| **1** | Drive Profile 32-bit Control Word | | | | | | | |
| **2** | Drive Profile 32-bit Control Word | | | | | | | |
| **3** | Drive Profile 32-bit Control Word (High Byte) | | | | | | | |
| **4** | Drive Profile 32-bit Reference 1 Word (Low Byte) | | | | | | | |
| **5** | Drive Profile 32-bit Reference 1 Word | | | | | | | |
| **6** | Drive Profile 32-bit Reference 1 Word | | | | | | | |
| **7** | Drive Profile 32-bit Reference 1 Word (High Byte) | | | | | | | |
| **8** | DATA OUT 1 Value (Low Byte) | | | | | | | |
| **9** | DATA OUT 1 Value (High Byte) | | | | | | | |

| Instance 121 (Transparent 32 profile) | | | | | | | | |
|---|---|---|---|---|---|---|---|---|
| **Byte** | **Bit 7** | **Bit 6** | **Bit 5** | **Bit 4** | **Bit 3** | **Bit 2** | **Bit 1** | **Bit 0** |
| **10** | DATA OUT 2 Value (Low Byte) | | | | | | | |
| **11** | DATA OUT 2 Value (High Byte) | | | | | | | |
| **12** | DATA OUT 3 Value (Low Byte) | | | | | | | |
| **13** | DATA OUT 3 Value (High Byte) | | | | | | | |
| **14** | DATA OUT 4 Value (Low Byte) | | | | | | | |
| **15** | DATA OUT 4 Value (High Byte) | | | | | | | |
| **16** | DATA OUT 5 Value (Low Byte) | | | | | | | |
| **17** | DATA OUT 5 Value (High Byte) | | | | | | | |
| **18** | DATA OUT 6 Value (Low Byte) | | | | | | | |
| **19** | DATA OUT 6 Value (High Byte) | | | | | | | |
| **20** | DATA OUT 7 Value (Low Byte) | | | | | | | |
| **21** | DATA OUT 7 Value (High Byte) | | | | | | | |
| **22** | DATA OUT 8 Value (Low Byte) | | | | | | | |
| **23** | DATA OUT 8 Value (High Byte) | | | | | | | |
| **24** | DATA OUT 9 Value (Low Byte) | | | | | | | |
| **25** | DATA OUT 9 Value (High Byte) | | | | | | | |
| **26** | DATA OUT 10 Value (Low Byte) | | | | | | | |
| **27** | DATA OUT 10 Value (High Byte) | | | | | | | |

The format of the input assembly is:

| Instance 171 (Transparent 32 profile) | | | | | | | | |
|---|---|---|---|---|---|---|---|---|
| **Byte** | **Bit 7** | **Bit 6** | **Bit 5** | **Bit 4** | **Bit 3** | **Bit 2** | **Bit 1** | **Bit 0** |
| **0** | Drive Profile 32-bit Status Word (Low Byte) | | | | | | | |
| **1** | Drive Profile 32-bit Status Word | | | | | | | |
| **2** | Drive Profile 32-bit Status Word | | | | | | | |
| **3** | Drive Profile 32-bit Status Word (High Byte) | | | | | | | |
| **4** | Drive Profile 32-bit Actual 1 Word (Low Byte) | | | | | | | |
| **5** | Drive Profile 32-bit Actual 1 Word (High Byte) | | | | | | | |

| Instance 171 (Transparent 32 profile) | | | | | | | | |
|---|---|---|---|---|---|---|---|---|
| **Byte** | **Bit 7** | **Bit 6** | **Bit 5** | **Bit 4** | **Bit 3** | **Bit 2** | **Bit 1** | **Bit 0** |
| **6** | Drive Profile 32-bit Actual 1 Word | | | | | | | |
| **7** | Drive Profile 32-bit Actual 1 Word (High Byte) | | | | | | | |
| **8** | DATA IN 1 Value (Low Byte) | | | | | | | |
| **9** | DATA IN 1 Value (High Byte) | | | | | | | |
| **10** | DATA IN 2 Value (Low Byte) | | | | | | | |
| **11** | DATA IN 2 Value (High Byte) | | | | | | | |
| **12** | DATA IN 3 Value (Low Byte) | | | | | | | |
| **13** | DATA IN 3 Value (High Byte) | | | | | | | |
| **14** | DATA IN 4 Value (Low Byte) | | | | | | | |
| **15** | DATA IN 4 Value (High Byte) | | | | | | | |
| **16** | DATA IN 5 Value (Low Byte) | | | | | | | |
| **17** | DATA IN 5 Value (High Byte) | | | | | | | |
| **18** | DATA IN 6 Value (Low Byte) | | | | | | | |
| **19** | DATA IN 6 Value (High Byte) | | | | | | | |
| **20** | DATA IN 7 Value (Low Byte) | | | | | | | |
| **21** | DATA IN 7 Value (High Byte) | | | | | | | |
| **22** | DATA IN 8 Value (Low Byte) | | | | | | | |
| **23** | DATA IN 8 Value (High Byte) | | | | | | | |
| **24** | DATA IN 9 Value (Low Byte) | | | | | | | |
| **25** | DATA IN 9 Value (High Byte) | | | | | | | |
| **26** | DATA IN 10 Value (Low Byte) | | | | | | | |
| **27** | DATA IN 10 Value (High Byte) | | | | | | | |

## Transparent 32 with two assembly

The Transparent 32 with two assembly, defined by ABB, provides unaltered 32-bit access to the configured drive profile.

The format of the output assembly is:

| Instance 22 (Transparent 32 profile) | | | | | | | | |
|---|---|---|---|---|---|---|---|---|
| **Byte** | **Bit 7** | **Bit 6** | **Bit 5** | **Bit 4** | **Bit 3** | **Bit 2** | **Bit 1** | **Bit 0** |
| **0** | Drive Profile 32-bit Control Word (Low Byte) | | | | | | | |
| **1** | Drive Profile 32-bit Control Word | | | | | | | |
| **2** | Drive Profile 32-bit Control Word | | | | | | | |
| **3** | Drive Profile 32-bit Control Word (High Byte) | | | | | | | |
| **4** | Drive Profile 32-bit Reference 1 Word (Low Byte) | | | | | | | |
| **5** | Drive Profile 32-bit Reference 1 Word | | | | | | | |
| **6** | Drive Profile 32-bit Reference 1 Word | | | | | | | |
| **7** | Drive Profile 32-bit Reference 1 Word (High Byte) | | | | | | | |
| **8** | Drive Profile 32-bit Reference 2 Word (Low Byte) | | | | | | | |
| **9** | Drive Profile 32-bit Reference 2 Word | | | | | | | |
| **10** | Drive Profile 32-bit Reference 2 Word | | | | | | | |
| **11** | Drive Profile 32-bit Reference 2 Word (High Byte) | | | | | | | |

The format of the input assembly is:

| Instance 72 (Transparent 32 profile) | | | | | | | | |
|---|---|---|---|---|---|---|---|---|
| **Byte** | **Bit 7** | **Bit 6** | **Bit 5** | **Bit 4** | **Bit 3** | **Bit 2** | **Bit 1** | **Bit 0** |
| **0** | Drive Profile 32-bit Status Word (Low Byte) | | | | | | | |
| **1** | Drive Profile 32-bit Status Word | | | | | | | |
| **2** | Drive Profile 32-bit Status Word | | | | | | | |
| **3** | Drive Profile 32-bit Status Word (High Byte) | | | | | | | |
| **4** | Drive Profile 32-bit Actual 1 Word (Low Byte) | | | | | | | |
| **5** | Drive Profile 32-bit Actual 1 Word | | | | | | | |
| **6** | Drive Profile 32-bit Actual 1 Word | | | | | | | |
| **7** | Drive Profile 32-bit Actual 1 Word (High Byte) | | | | | | | |

| Instance 72 (Transparent 32 profile) | |
|---|---|
| **8** | Drive Profile 32-bit Actual 2 Word (Low Byte) |
| **9** | Drive Profile 32-bit Actual 2 Word |
| **10** | Drive Profile 32-bit Actual 2 Word |
| **11** | Drive Profile 32-bit Actual 2 Word (High Byte) |

## Transparent 32 with two assembly plus drive parameters

The Transparent 32 with two assembly plus drive parameters, defined by ABB, adds configurable drive parameters to the Transparent 32 with two assembly.

The format of the output assembly is:

| Instance 122 (Transparent 32 profile) | | | | | | | | |
|---|---|---|---|---|---|---|---|---|
| **Byte** | **Bit 7** | **Bit 6** | **Bit 5** | **Bit 4** | **Bit 3** | **Bit 2** | **Bit 1** | **Bit 0** |
| **0** | Drive Profile 32-bit Control Word (Low Byte) | | | | | | | |
| **1** | Drive Profile 32-bit Control Word | | | | | | | |
| **2** | Drive Profile 32-bit Control Word | | | | | | | |
| **3** | Drive Profile 32-bit Control Word (High Byte) | | | | | | | |
| **4** | Drive Profile 32-bit Reference 1 Word (Low Byte) | | | | | | | |
| **5** | Drive Profile 32-bit Reference 1 Word | | | | | | | |
| **6** | Drive Profile 32-bit Reference 1 Word | | | | | | | |
| **7** | Drive Profile 32-bit Reference 1 Word (High Byte) | | | | | | | |
| **8** | Drive Profile 32-bit Reference 2 Word (Low Byte) | | | | | | | |
| **9** | Drive Profile 32-bit Reference 2 Word | | | | | | | |
| **10** | Drive Profile 32-bit Reference 2 Word | | | | | | | |
| **11** | Drive Profile 32-bit Reference 2 Word (High Byte) | | | | | | | |
| **12** | DATA OUT 1 Value (Low Byte) | | | | | | | |
| **13** | DATA OUT 1 Value (High Byte) | | | | | | | |
| **14** | DATA OUT 2 Value (Low Byte) | | | | | | | |
| **15** | DATA OUT 2 Value (High Byte) | | | | | | | |

| Instance 122 (Transparent 32 profile) | | | | | | | | |
|---|---|---|---|---|---|---|---|---|
| **Byte** | **Bit 7** | **Bit 6** | **Bit 5** | **Bit 4** | **Bit 3** | **Bit 2** | **Bit 1** | **Bit 0** |
| **16** | DATA OUT 3 Value (Low Byte) | | | | | | | |
| **17** | DATA OUT 3 Value (High Byte) | | | | | | | |
| **18** | DATA OUT 4 Value (Low Byte) | | | | | | | |
| **19** | DATA OUT 4 Value (High Byte) | | | | | | | |
| **20** | DATA OUT 5 Value (Low Byte) | | | | | | | |
| **21** | DATA OUT 5 Value (High Byte) | | | | | | | |
| **22** | DATA OUT 6 Value (Low Byte) | | | | | | | |
| **23** | DATA OUT 6 Value (High Byte) | | | | | | | |
| **24** | DATA OUT 7 Value (Low Byte) | | | | | | | |
| **25** | DATA OUT 7 Value (High Byte) | | | | | | | |
| **26** | DATA OUT 8 Value (Low Byte) | | | | | | | |
| **27** | DATA OUT 8 Value (High Byte) | | | | | | | |
| **28** | DATA OUT 9 Value (Low Byte) | | | | | | | |
| **29** | DATA OUT 9 Value (High Byte) | | | | | | | |
| **30** | DATA OUT 10 Value (Low Byte) | | | | | | | |
| **31** | DATA OUT 10 Value (High Byte) | | | | | | | |

The format of the input assembly is:

| Instance 172 (Transparent 32 profile) | | | | | | | | |
|---|---|---|---|---|---|---|---|---|
| **Byte** | **Bit 7** | **Bit 6** | **Bit 5** | **Bit 4** | **Bit 3** | **Bit 2** | **Bit 1** | **Bit 0** |
| **0** | Drive Profile 32-bit Status Word (Low Byte) | | | | | | | |
| **1** | Drive Profile 32-bit Status Word | | | | | | | |
| **2** | Drive Profile 32-bit Status Word | | | | | | | |
| **3** | Drive Profile 32-bit Status Word (High Byte) | | | | | | | |
| **4** | Drive Profile 32-bit Actual 1 Word (Low Byte) | | | | | | | |
| **5** | Drive Profile 32-bit Actual 1 Word | | | | | | | |
| **6** | Drive Profile 32-bit Actual 1 Word | | | | | | | |
| **7** | Drive Profile 32-bit Actual 1 Word (High Byte) | | | | | | | |

| Instance 172 (Transparent 32 profile) | | | | | | | | |
|---|---|---|---|---|---|---|---|---|
| **Byte** | **Bit 7** | **Bit 6** | **Bit 5** | **Bit 4** | **Bit 3** | **Bit 2** | **Bit 1** | **Bit 0** |
| **8** | Drive Profile 32-bit Actual 2 Word (Low Byte) | | | | | | | |
| **9** | Drive Profile 32-bit Actual 2 Word | | | | | | | |
| **10** | Drive Profile 32-bit Actual 2 Word | | | | | | | |
| **11** | Drive Profile 32-bit Actual 2 Word (High Byte) | | | | | | | |
| **12** | DATA IN 1 Value (Low Byte) | | | | | | | |
| **13** | DATA IN 1 Value (High Byte) | | | | | | | |
| **14** | DATA IN 2 Value (Low Byte) | | | | | | | |
| **15** | DATA IN 2 Value (High Byte) | | | | | | | |
| **16** | DATA IN 3 Value (Low Byte) | | | | | | | |
| **17** | DATA IN 3 Value (High Byte) | | | | | | | |
| **18** | DATA IN 4 Value (Low Byte) | | | | | | | |
| **19** | DATA IN 4 Value (High Byte) | | | | | | | |
| **20** | DATA IN 5 Value (Low Byte) | | | | | | | |
| **21** | DATA IN 5 Value (High Byte) | | | | | | | |
| **22** | DATA IN 6 Value (Low Byte) | | | | | | | |
| **23** | DATA IN 6 Value (High Byte) | | | | | | | |
| **24** | DATA IN 7 Value (Low Byte) | | | | | | | |
| **25** | DATA IN 7 Value (High Byte) | | | | | | | |
| **26** | DATA IN 8 Value (Low Byte) | | | | | | | |
| **27** | DATA IN 8 Value (High Byte) | | | | | | | |
| **28** | DATA IN 9 Value (Low Byte) | | | | | | | |
| **29** | DATA IN 9 Value (High Byte) | | | | | | | |
| **30** | DATA IN 10 Value (Low Byte) | | | | | | | |
| **31** | DATA IN 10 Value (High Byte) | | | | | | | |

## Class objects

The following table lists the data types used in the class object descriptions of this manual.

| Legend | Data type |
|---|---|
| UINT8 | Unsigned Integer 8 bit |
| UINT16 | Unsigned Integer 16 bit |
| SINT16 | Signed Integer 16 bit |
| UINT32 | Unsigned Integer 32 bit |
| BOOL | Boolean value |

**Note:** The adapter module is designed to provide EtherNet/IP communications for a variety of drives with different capabilities. Default, minimum and maximum values for attributes necessarily vary based upon the capabilities of the drive to which the module is attached and are not documented herein. Default, minimum and maximum values for attributes may be found in the:

- drive manuals
- Electronic Data Sheet Files (EDS) for the drive.

Note that the units of the attributes may differ from those of the parameters documented elsewhere, and those differences must be considered when interfacing to the drive via the module.

The table below shows the service names of the class objects.

| Service | Name |
|---|---|
| GET | 0x0E Get_Attribute_Single |
| SET | 0x10 Set_Attribute_Single |
| SET ALL | 0x02 Set_Attribute_All |
| GET ALL | 0x01 Get_Attribute_All |

## Identity object, class 01h

This object provides identification of and general information about the device.

### Class attributes (Instance #0)

| # | Attribute name | Services | Description | Data type |
|---|---|---|---|---|
| 1 | Revision | Get | Revision of the identity object | Array of UINT8 |

### Instance attributes (Instance #1)

| # | Attribute name | Services | Description | Data type |
|---|---|---|---|---|
| 1 | Vendor ID | Get | Identification of the device vendor | UINT16 |
| 2 | Device Type | Get | Identification of the general product type | UINT16 |
| 3 | Product Code | Get | Assigned vendor code to describe the device | UINT16 |
| 4 | Revision | Get | Revision of the item the identity object represents | Array[UINT8 UINT8] |
| 5 | Status | Get | Summary status of the device | UINT16 |
| 6 | ODVA Serial Number | Get | Serial number of the EtherNet/IP module | UINT32 |
| 7 | Product Name | Get | Product identification. Max 32 characters. | Short String |

### Reset service (Service code 05h)

| Value (reset type) | Type of reset |
|---|---|
| 0 | Reset the adapter |
| 1 | Reset the adapter (* and factory default configuration) |
| 2 | Reset the adapter (* and set the out-of-box configuration with the exception of communication link parameters) |

* not implemented

### Attribute explanations

*Vendor ID*

Vendor IDs are managed by the Open DeviceNet Vendor Association, Inc. (ODVA). The ABB Vendor ID is 46.

*Device Type*

The list of device types is managed by ODVA. It is used to identify the device profile that a particular product is using.

| Drive Type | Profile | Device Type | Value |
|---|---|---|---|
| AC | ODVA AC/DC Drive | ODVA AC Drive | 02h |
| | ABB Drives Profile | ABB AC Drive | 64h |
| | Transparent 16 | ABB AC Drive | 64h |
| | Transparent 32 | ABB AC Drive | 64h |
| DC | ODVA AC/DC Drive | ODVA DC Drive | 13h |
| | ABB Drives Profile | ABB DC Drive | 65h |
| | Transparent 16 | ABB DC Drive | 65h |
| | Transparent 32 | ABB DC Drive | 65h |



*Product Code*

Every ABB drive type or application of the drive has a dedicated product code. The product code is 100 + the value of parameter *29 FBA A/B drive type code*.

*Revision*

Revision attribute, which consists of Major and Minor Revisions, identifies the revision of the item the identity object represents.

*Status*

This attribute represents the current status of the entire device. Its value changes as the state of the device changes. The Status attribute is a WORD, with the following bit definitions:

| Bit(s) | Type/Name | Definition |
|---|---|---|
| 0 | Owned | TRUE indicates the device (or an object within the device) has an owner. Within the Master/Slave paradigm the setting of this bit means that the Predefined Master/Slave Connection Set has been allocated to a master. Outside the Master/Slave paradigm the meaning of this bit is to be defined. |
| 1 | | Reserved, set to 0 |
| 2 | Configured | TRUE indicates that the application of the device has been configured to do something that differs from the “out–of–box” default. This does not include configuration of the communications. |
| 3 | | Reserved, set to 0 |
| 4, 5, 6, 7 | | Vendor-specific |
| 8 | Minor Recoverable Fault | TRUE indicates the device detected a recoverable problem. The problem does not cause the device fault state. |
| 9 | Minor Unrecoverable Fault | TRUE indicates the device detected a unrecoverable problem. The problem does not cause the device fault state. |
| 10 | Major Recoverable Fault | TRUE indicates the device detected a problem which caused the device to transfer into the “Major Recoverable Fault” state. |
| 11 | Major Unrecoverable Fault | TRUE indicates the device detected a problem which caused the device to transfer into the “Major Unrecoverable Fault” state. |
| 12, 13, 14, 15 | | Reserved, set to 0 |

*ODVA Serial Number*

This attribute is a number used in conjunction with the Vendor ID to form a unique identifier for each device on EtherNet/IP. The value of this attribute is 02000000h plus the SERNO value from the device label.

*Product Name*

This text string should represent a short description of the product/product family represented by the product code in attribute 3.

## Motor data object, class 28h

The Motor data object can only be used if the ODVA AC/DC drive profile is in use.

The object serves as a database for motor parameters. Different motor types require different data to describe the motor. For example, AC induction motors do not need field current data like a DC motor to describe the motor.

| Motor class | Motor types in class |
|---|---|
| AC motors | 3 - PM synchronous<br>6 - Wound rotor induction<br>7 - Squirrel cage induction motor |
| DC motors | 1 - PM DC motor<br>2 - FC DC motor |

### Class attributes (Instance #0)

| # | Attribute name | Services | Description | Data type |
|---|---|---|---|---|
| 1 | Revision | Get | Revision of the CIP Object Class Definition upon which the implementation is based | Array of UINT8 |

### Instance attributes (Instance #1)

| # | Attribute name | Services | Description | Motor type | Data type |
|---|---|---|---|---|---|
| 3 | Motor Type | Get | See the table above. | AC | UINT8 |
| 6 | Rated Current | Get, Set | Rated Stator Current from motor name plate<br>Units: [100mA] | AC/DC | UINT16 |
| 7 | Rated Voltage | Get, Set | Rated Base Voltage from motor name plate<br>Units: [V] | AC/DC | UINT16 |
| 8 | Rated Power | Get, Set | Rated Power at Rated Frequency<br>Units: [W] | AC/DC | UINT32 |

| # | Attribute name | Services | Description | Motor type | Data type |
|---|---|---|---|---|---|
| 9 | Rated Frequency | Get, Set | Rated Electrical Frequency<br>Units: [Hz] | AC | UINT16 |
| 12 | Pole Count | Get | Number of poles in the motor | AC | UINT16 |
| 15 | Base Speed | Get, Set | Nominal speed at rated frequency from nameplate<br>Units [RPM] | AC/DC | UINT16 |

## Control supervisor object, class 29h

The Control supervisor object can only be used if the ODVA AC/DC drive profile is in use.

The object models all the management functions for devices within the 'Hierarchy of Motor Control Devices'. The behavior of motor control devices is described by:

- *AC/DC-drive object, class 2Ah* (page *237*) and
- Run/Stop event matrix under *Run Forward & Run Reverse (Control supervisor object)* (page *174*).

See also section *State (Control supervisor object)* on page *179*.

**Note:** If assembly instances are used, they override this object, for example, upon drive power-up.

**Class attributes (Instance #0)**

| # | Attribute name | Services | Description | Data type |
|---|---|---|---|---|
| 1 | Revision | Get | Revision of the CIP Object Class Definition upon which the implementation is based | Array of UINT8 |

### Instance attributes (Instance #1)

| # | Attribute name | Services | Description | Data type |
|---|---|---|---|---|
| 3 | Run 1 (RunFwd) | Get, Set | 0 = Stop, 1 = Run. See the Run/Stop event matrix on page 174. | BOOL |
| 4 | Run 2 (RunRev) | Get, Set | 0 = Stop, 1 = Run. See the Run/Stop event matrix on page 174. | BOOL |
| 5 | Net Control | Get, Set | 0 = Local Control, 1 = Network Control | BOOL |
| 6 | State | Get | State of Object. See section *State (Control supervisor object)* on page 179. | UINT8 |
| 7 | Running 1 (Fwd) | Get | 0 = Stopped, 1 = Running | BOOL |
| 8 | Running 2 (Rev) | Get | 0 = Stopped, 1 = Running | BOOL |
| 9 | Ready | Get | 1 = Ready, Enabled or Stopping; 0 = Other state | BOOL |
| 10 | Faulted | Get | 0 = Not faulted, 1 = Fault occurred | BOOL |
| 11 | Warning | Get | 0 = No Warnings present, 1 = Warning | BOOL |
| 12 | FaultRst | Get, Set | 0 → 1 Fault Reset | BOOL |
| 13 | Fault Code | Get | The fault that caused the last transition to the Faulted state. DRIVECOMM codes are reported. See the drive manual for further information on DRIVECOMM codes. | UINT16 |

| # | Attribute name | Services | Description | Data type |
|---|---|---|---|---|
| 14 | Warning Code | Get | Code word indicating the warning present. If multiple warnings are present, the lowest code value is displayed. DRIVECOMM codes are reported. See the drive manual for further information on DRIVECOMM codes. | UINT16 |
| 15 | CtlFromNet | Get | 0 = NetControl disabled<br>1 = NetControl enabled | BOOL |
| 16 | DNFaultMode | Get, Set | 2 = Vendor specified | UINT8 |
| 17 | ForceFault | Get, Set | 0 → 1 forces the drive to fault | BOOL |

## AC/DC-drive object, class 2Ah

The AC/DC-drive object can only be used if the ODVA AC/DC drive profile is in use.

The object models the functions specific to an AC or DC Drive.

### Class attributes (Instance #0)

| # | Attribute name | Services | Description | Data type |
|---|---|---|---|---|
| 1 | Revision | Get | Revision of the CIP Object Class Definition upon which the implementation is based | Array of UINT8 |

### Instance attributes (Instance #1)

| # | Attribute name | Services | Description | Data type |
|---|---|---|---|---|
| 3 | At Reference | Get | Frequency arrival | BOOL |
| 4 | NetRef | Get, Set | Requests torque or speed reference to be local or from the network.<br>0 = Set Reference not DN Control<br>1 = Set Reference at DN Control<br>Note that the actual status of torque or speed reference is reflected in attribute 29, RefFromNet. | BOOL |
| 6 | Drive mode | Get, Set | 0 = Vendor specific | UINT8 |
| 7 | Speed Actual | Get | Units = See parameter *23 Speed scale*. | SINT16 |
| 8 | SpeedRef | Get, Set | Units = See parameter *23 Speed scale*. | SINT16 |
| 11 | Torque Actual | Get | Units = See parameter *24 Torque scale*. | SINT16 |
| 12 | TorqueRef | Get, Set | Units = See parameter *24 Torque scale*. | SINT16 |
| 18 | AccelTime | Get, Set | Units = milliseconds | UINT16 |
| 19 | DecelTime | Get, Set | Units = milliseconds | UINT16 |
| 22 | Speed Scale | Get, Set | Speed scaling factor. See parameter *23 Speed scale*. | UINT8 |
| 24 | Torque Scale | Get, Set | Torque scaling factor. See parameter *24 Torque scale*. | UINT8 |
| 29 | Ref From Net | Get | Reflecting attribute 4 | BOOL |

## Drive parameter object, class 90h

With the FENA adapter module, drive parameters can also be accessed via Explicit Messaging. Explicit Messaging makes use of objects consisting of three parts: *class*, *instance* and *attribute*.

**Note:** When you use the drive parameter object to update the fieldbus configuration groups, changes to the fieldbus configuration will only take effect when the module is powered up the next time or when a 'Fieldbus Adapter parameter refresh' is given.

*Class* is always 144 (90h). *Instance* and *attribute* correspond to the drive parameter group and index in the following way:

- *Instance* = Parameter group (0…99) (ACx880/580: 0...255)
- *Attribute* = Parameter index (01…99) (ACx880/580: 0...255)

For example, Parameter **99.01** is accessed as follows:

- *Class* = 144 = 90h
- *Instance* = 99 = 63h
- *Attribute* = 1 = 01h

## Fieldbus configuration object, class 91h

The fieldbus configuration object allows you to configure the fieldbus configuration groups without the need to know the drive-specific groups associated with the configuration groups.

**Note:** When you use the fieldbus configuration object to update the fieldbus configuration groups, changes to the fieldbus configuration will only take effect when a reset service is requested of the Identity Object, the module is powered up the next time or when a 'Fieldbus Adapter parameter refresh' is given.

### Class attributes

| # | Attribute name | Services | Description | Data type |
|---|---|---|---|---|
| 1 | Revision | Get | Revision of the Configuration Object | Array of UINT8 |

### Instance #1: FENA-01/-11/-21 configuration parameters group A (group 1)

The actual parameter group number depends on the drive type. Group A (group 1) corresponds to:

- parameter group 51 in ACS355, ACSM1, ACS480, ACS580, ACS850 and ACQ810
- parameter group is typically 51/54 (group 151/154 in some variants) in ACS880 if the adapter is installed as fieldbus adapter A/B.



| # | Attribute name | Services | Description | Data type |
|---|---|---|---|---|
| 1 | Configuration Group A (Group 1) - Parameter 1 | Get, Set | See *01 FBA type* on page *121*. | UINT16 |
| 2 | Configuration Group A (Group 1) - Parameter 2 | Get, Set | See *02 Protocol/Profile* on page *121*. | UINT16 |
| 3 | Configuration Group A (Group 1) - Parameter 3 | Get, Set | See *03 Commrate* on page *121*. | UINT16 |

| # | Attribute name | Services | Description | Data type |
|---|---|---|---|---|
| 4 | Configuration Group A (Group 1) - Parameter 4 | Get, Set | See *04 IP configuration* on page *122*. | UINT16 |
| 5 | Configuration Group A (Group 1) - Parameter 5 | Get, Set | See *05 IP address 1* … *08 IP address 4*. | UINT16 |
| 6 | Configuration Group A (Group 1) - Parameter 6 | Get, Set | See *05 IP address 1* … *08 IP address 4*. | UINT16 |
| 7 | Configuration Group A (Group 1) - Parameter 7 | Get, Set | See *05 IP address 1* … *08 IP address 4*. | UINT16 |
| 8 | Configuration Group A (Group 1) - Parameter 8 | Get, Set | See *05 IP address 1* … *08 IP address 4*. | UINT16 |
| 9 | Configuration Group A (Group 1) - Parameter 9 | Get, Set | See *09 Subnet CIDR* on page *123*. | UINT16 |
| 10 | Configuration Group A (Group 1) - Parameter 10 | Get, Set | See *10 GW address 1* …*13 GW address 4*. | UINT16 |
| 11 | Configuration Group A (Group 1) - Parameter 11 | Get, Set | See *10 GW address 1* … *13 GW address 4*. | UINT16 |
| 12 | Configuration Group A (Group 1) - Parameter 12 | Get, Set | See *10 GW address 1* … *13 GW address 4*. | UINT16 |
| 13 | Configuration Group A (Group 1) - Parameter 13 | Get, Set | See *10 GW address 1* … *13 GW address 4*. | UINT16 |
| 14 | Configuration Group A (Group 1) - Parameter 14 | Get, Set | See *15… 18 Reserved* on page *124*. | UINT16 |
| 15 | Configuration Group A (Group 1) - Parameter 15 | Get, Set | See *15… 18 Reserved* on page *124*. | UINT16 |

| # | Attribute name | Services | Description | Data type |
|---|---|---|---|---|
| 16 | Configuration Group A (Group 1) - Parameter 16 | Get, Set | See *15… 18 Reserved* on page *124*. | UINT16 |
| 17 | Configuration Group A (Group 1) - Parameter 17 | Get, Set | See *15… 18 Reserved* on page *124*. | UINT16 |
| 18 | Configuration Group A (Group 1) - Parameter 18 | Get, Set | See *15… 18 Reserved* on page *124*. | UINT16 |
| 19 | Configuration Group A (Group 1) - Parameter 19 | Get, Set | See *19 T16 scale* on page *124*. | UINT16 |
| 20 | Configuration Group A (Group 1) - Parameter 20 | Get, Set | See *20 Control timeout* on page *125*. | UINT16 |
| 21 | Configuration Group A (Group 1) - Parameter 21 | Get, Set | See *21 Idle action* on page *126*. | UINT16 |
| 22 | Configuration Group A (Group 1) - Parameter 22 | Get, Set | See *22 Stop function* on page *126*. | UINT16 |
| 23 | Configuration Group A (Group 1) - Parameter 23 | Get, Set | See *23 Speed scale* on page *127*. | UINT16 |
| 24 | Configuration Group A (Group 1) - Parameter 24 | Get, Set | See *24 Torque scale* on page *128*. | UINT16 |
| 25 | Configuration Group A (Group 1) - Parameter 25 | Get, Set | See *25 … 26 Reserved for web page functionality.* on page *129*. | UINT16 |
| 26 | Configuration Group A (Group 1) - Parameter 26 | Get, Set | See *25 … 26 Reserved for web page functionality.* on page *129*. | UINT16 |

| # | Attribute name | Services | Description | Data type |
|---|---|---|---|---|
| 27 | Configuration Group A (Group 1) - Parameter 27 | Get, Set | See *27 FBA A/B par refresh* on page *129*. | UINT16 |
| 28 | Configuration Group A (Group 1) - Parameter 28 | Get | See *28 FBA A/B par table ver* on page *129*. | UINT16 |
| 29 | Configuration Group A (Group 1) - Parameter 29 | Get | See *29 FBA A/B drive type code* on page *129*. | UINT16 |
| 30 | Configuration Group A (Group 1) - Parameter 30 | Get | See *30 FBA A/B mapping file ver* on page *129*. | UINT16 |
| 31 | Configuration Group A (Group 1) - Parameter 31 | Get | See *31 D2FBA A/B comm status* on page *129*. | UINT16 |
| 32 | Configuration Group A (Group 1) - Parameter 32 | Get | See *32 FBA A/B comm SW ver* on page *130*. | UINT16 |
| 33 | Configuration Group A (Group 1) - Parameter 33 | Get | See *33 FBA A/B appl SW ver* on page *130*. | UINT16 |

### Instance #2: FENA-01/-11/-21 configuration parameters group B (group 2)

The actual parameter group number depends on the drive type. Group B (group 2) corresponds to:

- parameter group 55 in ACS355
- parameter group 53 in ACSM1, ACS480, ACS580, ACS850 and ACQ810
- parameter group is typically 53/56 (group 153/156 in some variants) in ACS880 if the adapter is installed as fieldbus adapter A/B.

| # | Attribute name | Services | Description | Data type |
|---|---|---|---|---|
| 1 | Configuration Group B (Group 2) - Parameter 1 | Get, Set | See *01 FBA A/B data out1* on page *131*. | UINT16/ UNIT32 ACx880 /580 |
| 2 | Configuration Group B (Group 2) - Parameter 2 | Get, Set | See *01 FBA A/B data out1* on page *131*. | UINT16/ UNIT32 ACx880 /580 |
| 3 | Configuration Group B (Group 2) - Parameter 3 | Get, Set | See *01 FBA A/B data out1* on page *131*. | UINT16/ UNIT32 ACx880 /580 |
| 4 | Configuration Group B (Group 2) - Parameter 4 | Get, Set | See *01 FBA A/B data out1* on page *131*. | UINT16/ UNIT32 ACx880 /580 |
| 5 | Configuration Group B (Group 2) - Parameter 5 | Get, Set | See *01 FBA A/B data out1* on page *131*. | UINT16/ UNIT32 ACx880 /580 |
| 6 | Configuration Group B (Group 2) - Parameter 6 | Get, Set | See *01 FBA A/B data out1* on page *131*. | UINT16/ UNIT32 ACx880 /580 |

| # | Attribute name | Services | Description | Data type |
|---|---|---|---|---|
| 7 | Configuration Group B (Group 2) - Parameter 7 | Get, Set | See *01 FBA A/B data out1* on page *131*. | UINT16/ UNIT32 ACx880 /580 |
| 8 | Configuration Group B (Group 2) - Parameter 8 | Get, Set | See *01 FBA A/B data out1* on page *131*. | UINT16/ UNIT32 ACx880 /580 |
| 9 | Configuration Group B (Group 2) - Parameter 9 | Get, Set | See *01 FBA A/B data out1* on page *131*. | UINT16/ UNIT32 ACx880 /580 |
| 10 | Configuration Group B (Group 2) - Parameter 10 | Get, Set | See *01 FBA A/B data out1* on page *131*. | UINT16/ UNIT32 ACx880 /580 |

### Instance #3: FENA-01/-11/-21 configuration parameters group C (group 3)

The actual parameter group number depends on the drive type. Group C (group 3) corresponds to:

- parameter group 54 in ACS355
- parameter group 52 in ACSM1, ACS480, ACS580, ACS850 and ACQ810
- parameter group is typically 52/55 (group 152/155 in some variants) in ACS880 if the adapter is installed as fieldbus adapter A/B.

| # | Attribute name | Services | Description | Data type |
|---|---|---|---|---|
| 1 | Configuration Group C (Group 3) - Parameter 1 | Get, Set | See *01 FBA A/B data in1* on page *132*. | UINT16/ UNIT32 ACx880/ 580 |
| 2 | Configuration Group C (Group 3) - Parameter 2 | Get, Set | See *01 FBA A/B data in1* on page *132*. | UINT16/ UNIT32 ACx880/ 580 |
| 3 | Configuration Group C (Group 3) - Parameter 3 | Get, Set | See *01 FBA A/B data in1* on page *132*. | UINT16/ UNIT32 ACx880/ 580 |
| 4 | Configuration Group C (Group 3) - Parameter 4 | Get, Set | See *01 FBA A/B data in1* on page *132*. | UINT16/ UNIT32 ACx880/ 580 |
| 5 | Configuration Group C (Group 3) - Parameter 5 | Get, Set | See *01 FBA A/B data in1* on page *132*. | UINT16/ UNIT32 ACx880/ 580 |
| 6 | Configuration Group C (Group 3) - Parameter 6 | Get, Set | See *01 FBA A/B data in1* on page *132*. | UINT16/ UNIT32 ACx880/ 580 |

| # | Attribute name | Services | Description | Data type |
|---|---|---|---|---|
| 7 | Configuration Group C (Group 3) - Parameter 7 | Get, Set | See *01 FBA A/B data in1* on page *132*. | UINT16/ UNIT32 ACx880/ 580 |
| 8 | Configuration Group C (Group 3) - Parameter 8 | Get, Set | See *01 FBA A/B data in1* on page *132*. | UINT16/ UNIT32 ACx880/ 580 |
| 9 | Configuration Group C (Group 3) - Parameter 9 | Get, Set | See *01 FBA A/B data in1* on page *132*. | UINT16/ UNIT32 ACx880/ 580 |
| 10 | Configuration Group C (Group 3) - Parameter 10 | Get, Set | See *01 FBA A/B data in1* on page *132*. | UINT16/ UNIT32 ACx880/ 580 |

### Instance #10: SNTP configuration

| # | Attribute name | Services | Description | Data type |
|---|---|---|---|---|
| 1 | UTC time offset | Get, Set | SNTP time offset to UTC time. Value in minutes [-1440, 1440] to offset the UTC time received from SNTP. | SINT16 |

## TCP/IP interface object, class F5h

This object provides the mechanism to configure the TCP/IP network interface of the device.

### Class attributes (Instance #0)

| # | Attribute name | Services | Description | Data type |
|---|---|---|---|---|
| 1 | Revision | Get | Revision of the TCP/IP Interface Object Class Definition upon which the implementation is based | Array of UINT8 |

### Instance attributes (Instance #1)

| # | Attribute name | Services | Description | Data type |
|---|---|---|---|---|
| 1 | Interface Status | Get | See *Interface Status attribute (#1) bits* on page *250*. | DWORD |
| 2 | Configuration Capability | Get | See *Configuration Capability attribute (#2) bits* on page *250*. | DWORD |
| 3 | Configuration Control | Get | See *Configuration Control attribute (#3) bits* on page *251*. | DWORD |
| 4 | Physical Link Object | Get | Path to physical link object | STRUCT of: |
| | Path Size | | Path size | UINT |
| | Path | | Logical segments identifying the physical link object | Padded EPATH |

| # | Attribute name | Services | Description | Data type |
|---|---|---|---|---|
| 5 | Interface Configuration | Get | | STRUCT of: |
| | IP Address | | IP Address | UDINT |
| | Network Mask | | Network Mask | UDINT |
| | Gateway Address | | Gateway Address | UDINT |
| | Unused | | | UDINT |
| | Unused | | | UDINT |
| | Default Domain Name | | Default Domain Name for unqualified host names. | STRING |
| 6 | Host Name | Get/Set | Host name | STRING |
| 8 | TTL Value | Get/Set | TTL value for EtherNet/IP multi cast packets | USINT 1...255 |
| 13 | NV Encapsulation Inactivity | Get/Set | Encapsulation inactivity timeout | UINT 0 = disabled 1...3600 timeout in seconds |

### Attribute explanations

*Interface Status attribute (#1) bits*

| Bit | Name | Description |
|---|---|---|
| 0…3 | Interface configuration status | Indicates the status of the Interface Configuration attribute.<br>**Value** **Description**<br>0 The Interface Configuration attribute has not been configured.<br>1 The Interface Configuration attribute contains valid configuration obtained from BOOTP, DHCP or non-volatile storage.<br>2 The IP address member of the Interface Configuration attribute contains valid configuration obtained from hardware settings (e.g., push-wheel, thumb-wheel).<br>3…15 Reserved |
| 4 | Mcast pending | Indicates a pending configuration change in the TTL Value and/or Mcast Config attributes.<br>This bit is set when either the TTL Value or Mcast Config attribute is set, and cleared the next time the device starts. |
| 5…31 | | Reserved, set to 0 |

*Configuration Capability attribute (#2) bits*

| Bit | Name | Description |
|---|---|---|
| 0 | BOOTP client | 1 (True) = The device is capable of obtaining its network configuration via BOOTP. |
| 1 | DNS client | 1 (True) = The device is capable of resolving host names by querying a DNS server. |
| 2 | DHCP client | 1 (True) = The device is capable of obtaining its network configuration via DHCP. |
| 3 | DCHP-DNS update | 1 (True) = The device is capable of sending its host name in the DHCP request as documented in Internet draft <draft-ietf-dhc-dhcp-dnc-12.txt> |

| Bit | Name | Description |
|---|---|---|
| 4 | Configuration settable | 1 (True) = The Interface Configuration attribute is settable. Some devices, e.g., a PC or workstation, may not allow interface configuration to be set via the TCP/IP interface object. |
| 5 | Hardware configurable | 1 (True) = The IP address member of the Interface Configuration attribute can be obtained from hardware settings (e.g., push-wheel, thumb-wheel). |
| | | 0 (False) = The Status instance attribute (1) Interface configuration status field value shall never be 2. (The Interface configuration attribute contains valid configuration obtained from hardware settings.) |
| 6…31 | | Reserved, set to 0 |

*Configuration Control attribute (#3) bits*

| Bit | Name | Description |
|---|---|---|
| 0…3 | Start-up configuration | Determines how the device obtains its initial configuration and start-up.<br>**Value** **Description**<br>0 The device uses the interface configuration values previously stored (eg, in non-volatile memory or via hardware switches).<br>1 The device obtains its interface configuration values via BOOTP.<br>2 The device obtains its interface configuration values via DHCP upon start-up.<br>3…15 Reserved |
| 4 | DNS enable | 1 (True) = The device resolves host names by querying a DNS server. |
| 5…31 | | Reserved, set to 0. |

## Ethernet link object, class F6h

This object maintains link-specific counters and status information for the Ethernet communication interface.

### Class attributes (Instance #0)

| # | Attribute name | Services | Description | Data type |
|---|---|---|---|---|
| 1 | Revision | Get | Revision of the Ethernet Link Object Class Definition upon which the implementation is based | Array of UINT8 |

### Instance attributes (Instance #1)

| # | Attribute name | Services | Description | Data type |
|---|---|---|---|---|
| 1 | Interface Speed | Get, Set | 10 or 100 Mbps | UDINT |
| 2 | Interface Flags | Get, Set | Interface status flags:<br>**Bit** — **Description**<br>0 — Link status<br>1 — Half/Full duplex<br>2…4 — Negotiation status<br>5 — Manual setting requires reset<br>6 — Local hardware fault<br>7…31 — Reserved | DWORD |
| 3 | Physical Address | Get | Ethernet MAC address of the module | ARRAY 6XUSINT |

## Connection object, class 05h

Do not modify this object. This object is only used while establishing the connection between the adapter module and the PLC.

The connection class allocates and manages the internal resources associated with both I/O and explicit messaging connections. The specific instance generated by the connection class is referred to as connection instance or connection object. The table below shows the connection object states.

| State | Description | State | Description |
|---|---|---|---|
| 00 | Non-Existent | 03 | Established |
| 01 | Configuring | 04 | Timed Out |
| 02 | Waiting for Connection ID | 05 | Deferred Delete |

### Class attributes

| # | Attribute name | Services | Description | Data type |
|---|---|---|---|---|
| 1 | Revision | Get | Revision of the connection object | Array of UINT8 |

### Instance attributes

| Instance number | Description |
|---|---|
| 1 | Explicit messaging connection |
| 2 | Polled I/O connection |
| 4 | Change-of-State/Cyclic I/O connection |

| # | Attribute name | Services | Description | Data type |
|---|---|---|---|---|
| 1 | State | Get | State of the object.<br>See the state table on page 253. | UINT8 |
| 2 | Instance Type | Get | Indicates either I/O (1) or messaging connection (0). | UINT8 |
| 3 | Transport Class Trigger | Get | Defines the behavior of the connection. | UINT8 |
| 4 | Produced Cnxn Id | Get | Placed in CAN Identifier Field when the connection transmits. | UINT16 |
| 5 | Consumed Cnxn Id | Get | CAN Identifier Field value that denotes the message to be received | UINT16 |
| 6 | Comm Characteristics | Get | Defines the Message Group(s) across which productions and consumptions are associated in this connection. | UINT8 |
| 7 | Produced Connection Size | Get | Maximum number of bytes transmitted across this connection | UINT16 |
| 8 | Consumed Connection size | Get | Maximum number of bytes received across this connection | UINT16 |
| 9 | Expected Packet Rate | Get, Set | Defines the timing associated with this connection in milliseconds. A value of 0 deactivates the associated timers. | UINT16 |
| 12 | Watchdog Timeout Action | Get, Set | Defines how to handle Inactivity/Watchdog timeouts. | UINT8 |
| 13 | Produced Connection Path Length | Get | Number of bytes in the produced_connection_path length attribute | UINT16 |

| # | Attribute name | Services | Description | Data type |
|---|---|---|---|---|
| 14 | Produced Connection Path | Get | Application object producing data on this connection | Array of UINT8 |
| 15 | Consumed Connection Path Length | Get | Number of bytes in the consumed_connection_path length attribute | UINT16 |
| 16 | Consumed Connection Path | Get | Specifies the application object(s) that are to receive the data consumed by this connection object. | Array of UINT8 |
| 17 | Production Inhibit Time | Get | Defines the minimum time between new data production in milliseconds. | UINT16 |

## Acknowledge handler object, class 2Bh

The acknowledge handler object is used to manage the reception of message acknowledgements. This object communicates with a message producing application object within the device. The acknowledge handler object notifies the producing application of acknowledge reception, acknowledge timeouts and production retry limit.

### Class attributes (Instance #0)

| # | Attribute name | Services | Description | Data type |
|---|---|---|---|---|
| 1 | Revision | Get | Revision of the CIP Object Class Definition upon which the implementation is based | Array of UINT8 |

### Instance attributes (Instance #1)

| # | Attribute name | Services | Description | Data type |
|---|---|---|---|---|
| 1 | Acknowledge Timer | Get, Set | Time in milliseconds to wait for acknowledge before resending | UINT16 |
| 2 | Retry Limit | Get, Set | Number of Acknowledge Timeouts to wait before informing the producing application of a Retry-Limit_Reached event | UINT8 |
| 3 | COS Producing Connection Instance | Get | Connection Instance Id which contains the path of the producing I/O application object which will be notified of Acknowledge Handler events | UINT16 |

13

# EtherNet/IP – Diagnostics

## Contents of this chapter

This chapter explains how to trace faults with the status LEDs on the adapter module when the module is used for EtherNet/IP communication.

## Fault and warning messages

For the fault and warning messages concerning the adapter module, see the drive firmware manual.

## LEDs

The adapter module is equipped with three bicolor diagnostic LEDs. The LEDs are described below.




| Name | Color | Function |
|---|---|---|
| HOST | Blinking green | Establishing communication to host |
| | Green | Connection to host OK |
| | Blinking red | Communication to host lost temporarily |
| | Flashing orange, alternating with the MODULE Flashing orange | Internal file system error. The error may be cleared by cycling drive power. If the error persists, contact your local ABB representative. |




| Name | Color | Function |
|---|---|---|
| MODULE | Off | There is no power applied to the device. |
| | Green | Device is operating in a normal condition. |
| | Flashing green | Device needs commissioning due to configuration missing, incomplete or incorrect. The device may be in the Standby state. This may be caused by the adapter waiting for a response from a DHCP server or Duplicate Address Detection to complete. |
| | Flashing red | Ethernet interface is disabled. Duplicate Address Detection may have detected a duplicate address. Check the IP configuration and either initiate a Fieldbus Adapter parameter refresh or cycle power to the drive. |
| | Flashing red-green | Device is in Self Test. |
| | Flashing orange, alternating with the HOST Flashing orange | Internal file system error. The error may be cleared by cycling drive power. If the error persists, contact your local ABB representative. |




| Name | Color | Function |
|---|---|---|
| NETWORK /NET | Off | Device is not on-line.<br>• The device has not completed the Duplicate Address Detection yet.<br>• The device may not be powered; look at the MODULE status LED. |
| | Flashing green | Device is on-line but has no connections in the established state.<br>• The device has passed Duplicate Address Detection, is on-line, but has no established connections to other nodes. |
| | Green | Device is on-line and has connections in the established state. |
| | Flashing red | One or more I/O connections are in the Timed-out state. |
| | Red | Failed communication device. The device has detected an error that has rendered it incapable of communicating on the network (Duplicate MAC ID or IP address detected). |

# PROFINET IO protocol

*PROFINET IO – Start-up* . . . . . *263*
*PROFINET IO – Communication profiles* . . . . . *341*
*PROFINET IO – Communication protocol* . . . . . *361*
*PROFINET IO – Diagnostics* . . . . . *397*

P

14

# PROFINET IO – Start-up

## Contents of this chapter

This chapter contains:

- information on configuring the drive for operation with the adapter module
- drive-specific instructions on starting up the drive with the adapter module
- examples of configuring the master station for communication with the adapter module.

## Warnings



**WARNING!** Obey the safety instructions given in this manual and the drive documentation.

# Drive configuration

The information in this section applies to all drive types compatible with the adapter module, unless otherwise stated.

## PROFINET IO connection configuration

After the adapter module has been mechanically and electrically installed according to the instructions in chapters *Mechanical installation* and *Electrical installation*, you must prepare the drive for communication with the module.

The detailed procedure of activating the module for PROFINET IO communication with the drive depends on the drive type. Normally, you must activate a parameter to activate the communication. See the drive-specific start-up instructions starting on page *278*.

Once communication between the drive and the adapter module has been established, several configuration parameters are copied to the drive. These parameters are shown in the tables below and must be checked first and adjusted where necessary. You can adjust the parameters via a drive control panel, a PC tool or a web user interface. For more information on the web user interface, see *Appendix C – FENA configuration web pages*.

**Note:**

- Not all drives display descriptive names for the configuration parameters. To help you identify the parameters in different drives, the names displayed by each drive are given in gray boxes in the tables below.
- The new parameter settings take effect only when you power up the module the next time or when you activate the fieldbus adapter refresh parameter.

## FENA-01/-11/-21 configuration parameters – group A (group 1)

**Note:** The actual parameter group number depends on the drive type. Group A (group 1) corresponds to:

- parameter group 51 in ACSM1, ACS355, ACS380, ACS480, ACS580, ACS850 and ACQ810
- parameter group 51 in ACS880 and ACS880-M04 if the adapter is installed as fieldbus adapter A or group 54 if the adapter is installed as fieldbus adapter B.

| No. | Name/Value | Description | Default |
|---|---|---|---|
| 01 | FBA type | **Read-only.** Shows the fieldbus adapter type as detected by the drive. The value cannot be adjusted by the user.<br>If the value is **0** = None, the communication between the drive and the module has not been established. | **128** = ETHERNET |
| 02 | Protocol.Profile | Selects the application protocol and communication profile for the network connection.<br>The selections available for PROFINET IO communication are listed below.<br><br>1) **0** = Modbus/TCP: ABB Drives profile - Classic | **0** 1) |
| | **10** = PNIO Pdrive | PROFINET IO protocol: PROFIdrive profile | |
| | **11** = PNIO ABB Pro | PROFINET IO protocol: ABB Drives profile | |
| | **12** = PNIO T16 | PROFINET IO protocol: Transparent 16-bit profile | |
| | **13** = PNIO T32 | PROFINET IO protocol: Transparent 32-bit profile | |
| | **14** = PNIO PdriveM | PROFINET IO protocol: PROFIdrive positioning mode | |
| 03 | Commrate | Sets the bit rate for the Ethernet interface.<br>In case of FENA-21 this parameter is used for configuring port 1. | **0** = Auto |
| | **0** = Auto | Auto-negotiate | |
| | **1** = 100 Mbps FD | 100 Mbps, full duplex | |
| | **2** = 100 Mbps HD | 100 Mbps, half duplex | |
| | **3** = 10 Mbps FD | 10 Mbps, full duplex | |
| | **4** = 10 Mbps HD | 10 Mbps, half duplex | |

| No. | Name/Value | Description | Default |
|---|---|---|---|
| 04 | IP configuration | Sets the method for configuring the IP address, subnet mask and gateway address for the module.<br>In a PROFINET IO network, the master controller has a Duplicate Address Detection mechanism.<br>**Note**: It is recommended to use IP setting for PROFINET as Static IP and address 0.0.0.0. Use PLC hardware configuration to set the IP address for each device in the network. | **0** = Static IP |
| | **0** = Static IP | Configuration will be obtained from parameters *05…13* or from the PLC via DCP. The DCP protocol allows the master controller to find every PROFINET IO device on a subnet. When the adapter module is configured for the PROFINET IO protocol, the IP address is transferred to the PROFINET IO communication stack.<br>If there is a need to change the IP address configured via DCP, it should be done with a DCP tool, such as Siemens Step7. If some of the other methods are used to change the IP address, the module must be restarted to enable any changes. | |
| | **2** = Temp IP | IP address is set as Temporary through DCP by the controller.<br>Parameters 05...13 shows the set IP. After reboot this setting goes back to static IP and address 0.0.0.0 is taken to use. This setting is not allowed to be set by the user. | |
| 05 | IP address 1 | An IP address is assigned to each IP node on a network. An IP address is a 32-bit number that is typically represented in “dotted decimal” notation consisting of four decimal integers, on the range 0…255, separated by periods. Each integer represents the value of one octet (8-bits) in the IP address. Parameters *05…08* define the four octets of the IP address. | 0 |
| | 0…255 | IP address | |
| … | … | … | … |
| 08 | IP address 4 | See parameter *05 IP address 1*. | 0 |
| | 0…255 | IP address | |

| No. | Name/Value | Description | Default |
|---|---|---|---|
| 09 | Subnet CIDR | Subnet masks are used for splitting networks into smaller networks called subnets. A subnet mask is a 32-bit binary number that splits the IP address into a network address and host address.<br>Subnet masks are typically represented in either dotted decimal notation or the more compact CIDR notation, as shown in the table below. | 0 |

| Dotted decimal | CIDR | Dotted decimal | CIDR |
|---|---|---|---|
| 255.255.255.254 | 31 | 255.254.0.0 | 15 |
| 255.255.255.252 | 30 | 255.252.0.0 | 14 |
| 255.255.255.248 | 29 | 255.248.0.0 | 13 |
| 255.255.255.240 | 28 | 255.240.0.0 | 12 |
| 255.255.255.224 | 27 | 255.224.0.0 | 11 |
| 255.255.255.192 | 26 | 255.224.0.0 | 10 |
| 255.255.255.128 | 25 | 255.128.0.0 | 9 |
| 255.255.255.0 | 24 | 255.0.0.0 | 8 |
| 255.255.254.0 | 23 | 254.0.0.0 | 7 |
| 255.255.252.0 | 22 | 252.0.0.0 | 6 |
| 255.255.248.0 | 21 | 248.0.0.0 | 5 |
| 255.255.240.0 | 20 | 240.0.0.0 | 4 |
| 255.255.224.0 | 19 | 224.0.0.0 | 3 |
| 255.255.192.0 | 18 | 192.0.0.0 | 2 |
| 255.255.128.0 | 17 | 128.0.0.0 | 1 |
| 255.255.0.0 | 16 | | |

| | | | |
|---|---|---|---|
| | 1…31 | Subnet mask in CIDR notation | |
| 10 | GW address 1 | IP gateways connect individual physical IP subnets into a unified IP network. When an IP node needs to communicate with an IP node on another subnet, the IP node sends the data to the IP gateway for forwarding. Parameters *10*…*13* define the four octets of the gateway address. | 0 |
| | 0…255 | GW address | |
| … | … | … | … |
| 13 | GW address 4 | See parameter *10 GW address 1*. | 0 |
| | 0…255 | GW address | |

| No. | Name/Value | Description | Default |
|---|---|---|---|
| 14 | Commrate port 2 | Sets the bit rate for the Ethernet port 2. This parameter is used only with FENA-21. | **0** = Auto |
| | **0** = Auto | Autonegotiate | |
| | **1** = 100 Mbps FD | 100 Mbps, full duplex | |
| | **2** = 100 Mbps HD | 100 Mbps, half duplex | |
| | **3** = 10 Mbps FD | 10 Mbps, full duplex | |
| | **4** = 10 Mbps HD | 10 Mbps, half duplex | |
| 14 … 18 | Reserved | These parameters are not used by the adapter module when the module is configured for PROFINET IO. | N/A |
| 19 | T16 scale | Defines the reference multiplier/actual value divisor for the adapter module.<br>**Note**: The parameter is effective only when the following conditions are satisfied:<br>• transparent 16 profile is selected<br>• drive is using the native communication profile (e.g., DCU or FBA)<br>• drive is using a 16-bit transparent reference 1/actual value 1.<br>Reference 1 is multiplied by the value of this plus one and the actual value 1 is divided by the value of this plus one. With value 0, the reference 1/actual value 1 scale in the adapter module is 1 = 1.<br><br>With an ACS355 drive: For example, if the parameter has a value 99 and the reference of 1000 is given by the master, the reference is multiplied by 100 (i.e. 99 + 1) and forwarded to the drive as 100000.<br>According to the DCU profile, speed scale is 1000 = 1 rpm. This value is interpreted as a reference of 100 rpm in the drive.<br>With ACSM1, ACS850 and ACQ810, speed scale is approximately 65535 = 1 rpm.<br>With ACS880 and ACS580:<br>Reference 1/actual value 1 base scale in transparent mode is 100 = 1, but using this reference value depends on the application of drive. | 99 |
| | 0…65535 | Reference multiplier/actual value divisor | |

| No. | Name/Value | Description | Default |
|---|---|---|---|
| 20 | Telegram type | **Read-only.** Indicates the telegram type selected for PROFINET IO communication. The adapter module automatically detects the telegram type defined in the PLC. For more information on the supported PPO message types, see section *PPO types* on page *366*. | **0** = Unknown |
| | **0** = Unknown | Cyclical communication between the master and the module has not been established yet. | |
| | **1** = PPO1 | Not supported | |
| | **2** = PPO2 | Not supported | |
| | **3** = PPO3 | PPO3 selected | |
| | **4** = PPO4 | PPO4 selected | |
| | **5** = PPO5 | Not supported | |
| | **6** = PPO6 | PPO6 selected | |
| | **7** = PPO7 | PPO7 selected. Not supported with ACS355. | |
| | **8** = ST1 | ST1 selected | |
| | **9** = ST2 | ST2 selected. Not supported with ACS355. | |
| 21 | Alarm disable | Disables the PROFIdrive alarm mechanism which generates alarms in case of drive faults. But the standard PROFINET alarms are still sent. For more information on the diagnostics and alarm mechanism for PROFIdrive, see section *Diagnostic and alarm mechanism* on page *391*. | **0** = Enabled |
| | **0** = Enabled | PROFIdrive alarms are enabled. | |
| | **1** = Disabled | PROFIdrive alarms are disabled. | |
| 22 | Map selection | Defines the preferred data type of mapped parameters when mapping is done through PROFIdrive parameters. **Note**: Supported with ACS480, ACS580 and ACS880 drives only. | **1** = 16bit |
| | **0** = 32bit | 32 bits | |
| | **1** = 16bit | 16 bits | |
| 23 ... 24 | Reserved | These parameters are not used by the adapter module when the module is configured for PROFINET IO. | N/A |

| No. | Name/Value | Description | Default |
|---|---|---|---|
| 25 | PN Name Index | Allows defining the Profinet station name in the format: “abbdrive-xx”, where xx is the value of the parameter name index, i.e. 25 (parameter **25 PN NAME INDEX**).<br>Example: A value 12 results in the name “abbdrive-12”<br>Value 0 means rotary switch is disabled, other values mean rotary switch is active.<br><br>**Note**: During every boot FENA checks the value of PN Name Index,<br>• If the value is not Zero then the active PN Name Index overrides the Profinet station name.<br>• If the new name is set by DCP Set command as permanent, the new name is used and stored to flash. The PN Name Index parameter value is not changed, so after next boot, the name is taken according to the PN Name Index.<br>• If the new name is set by DCP Set command as temporary, the new name is used and the empty name is stored to flash. The PN Name Index parameter value is not changed, so after next boot name is taken according to the PN Name Index.<br>• The Profinet DCP factory reset also resets the PN Name Index value to default (0). | 0 |
| | 0...65535 | | |
| 26 | Reserved | This parameter is not used by the adapter module when the module is configured for PROFINET IO. | N/A |
| 27 | FBA A/B par refresh | Validates any changed adapter module configuration parameter settings. After refreshing, the value reverts automatically to **0** = Done.<br>**Note:** This parameter cannot be changed while the drive is running. | **0** = Done |
| | **0** = Done | Refreshing done | |
| | **1** = Refresh | Refreshing | |

| No. | Name/Value | Description | Default |
|---|---|---|---|
| 28 | FBA A/B par table ver | **Read-only.** Displays the parameter table revision of the fieldbus adapter module mapping file stored in the memory of the drive. In format **xyz**, where<br>**x** = major revision number<br>**y** = minor revision number<br>**z** = correction number<br>OR<br>in format **axyz**, where<br>**a** = major revision number<br>**xy** = minor revision numbers<br>**z** = correction number or letter. | N/A |
| | | Parameter table revision | |
| 29 | FBA A/B drive type code | **Read-only.** Displays the drive type code of the fieldbus adapter module mapping file stored in the memory of the drive. | N/A |
| | | Drive type code of the fieldbus adapter module mapping file | |
| 30 | FBA A/B mapping file ver | **Read-only.** Displays the fieldbus adapter module mapping file revision stored in the memory of the drive in decimal format. | N/A |
| | | Mapping file revision | |
| 31 | D2FBA A/B comm status | **Read-only.** Displays the status of the fieldbus adapter module communication.<br>**Note:**<br>• The value names may vary by drive.<br>• Only active Drive controlled channel will put comm status ONLINE. ProfiSafe alone will not change the comm status. | **0** = Idle<br>or<br>**4** = Off-line |
| | **0** = Idle | Adapter is not configured. | |
| | **1** = Exec.init | Adapter is initializing. | |
| | **2** = Time out | A timeout has occurred in the communication between the adapter and the drive. | |
| | **3** = Conf.err | Adapter configuration error: The major or minor revision code of the common program revision in the fieldbus adapter module is not the revision required by the module or mapping file upload has failed more than three times. | |
| | **4** = Off-line | Adapter is off-line. | |
| | **5** = On-line | Adapter is on-line. | |
| | **6** = Reset | Adapter is performing a hardware reset. | |

| No. | Name/Value | Description | Default |
|---|---|---|---|
| 32 | FBA A/B comm SW ver | **Read-only.** Displays the common program revision of the adapter module in format **axyz**, where:<br>**a** = major revision number<br>**xy** = minor revision numbers<br>**z** = correction number or letter. | N/A |
| | | Common program version of the adapter module | |
| 33 | FBA A/B appl SW ver | **Read-only.** Displays the application program revision of the adapter module in format **axyz**, where:<br>**a** = major revision number<br>**xy** = minor revision numbers<br>**z** = correction number or letter. | N/A |
| | | Application program revision of the adapter module | |

## FENA-01/-11/-21 configuration parameters – group B (group 2)

**Note:** The actual parameter group number depends on the drive type. Group B (group 2) corresponds to:

- parameter group 55 in ACS355
- parameter group 53 in ACSM1, ACS380, ACS480, ACS580, ACS850 and ACQ810
- parameter group 53 in ACS880 and ACS880-M04 if the adapter is installed as fieldbus adapter A or group 56 if the adapter is installed as fieldbus adapter B.

| No.[1] | Name/Value | Description | Default |
|---|---|---|---|
| 01 | FBA data out 1 (master to drive) | Selects the resolution of control word (16 bit or 32 bit) received by the drive. | 1 or 11[2] |
| | **1** = CW 16bit | Control word (16 bits) | |
| | **11** = CW 32bit | Control word (32 bits) | |
| 02 | FBA data out 2 | Selects data word 1 received by the drive over the PROFINET network. The content is defined by a decimal number in the range of 0 to 9999 as follows:<br>0 – Not used<br>1…99 – Virtual address area of drive control<br>101…9999 – Parameter area of the drive<br>See also *Virtual address area allocation with ACSM1* on page *276*. | 0 or 2[4] |
| | **0** = None | Not used | |
| | **1** = CW 16bit | Control word (16 bits)[3] | |
| | **2** = Ref1 16bit | Reference REF1 (16 bits)[3] | |
| | **3** = Ref2 16bit | Reference REF2 (16 bits)[3] | |
| | **11** = CW 32bit | Control word (32 bits) | |
| | **12** = Ref1 32bit | Reference REF1(32 bits) | |
| | **13** = Ref2 32bit | Reference REF2 (32 bits) | |
| | **21** = CW2 16bit | Control word 2 (16 bits) | |

| No.[1] | Name/Value | Description | Default |
|---|---|---|---|
| | 101…9999 | Parameter index with format **xxyy**, where<br>• **xx** is the parameter group number (1…99)<br>• **yy** is the parameter number index within that group (01…99). | |
| | Other | Path to parameter area selection. | |
| 03…10 | FBA data out 3<br>…<br>FBA data out12 | See parameter *02 FBA data out 1*. | 0 |

[1] The number of parameters in this group may vary by drive type and drive firmware.
[2] 11 (CW 32bit) is the default setting if the Transparent 32 profile is used.
[3] With an ACS355 drive, Control word and REF1 are always fixed to virtual addresses 1 and 2 respectively. If REF2 is used, its virtual address is always 3.
[4] 2 (Ref1 16bit) is a fixed setting with an ACS355 drive.



## FENA-01/-11/-21 configuration parameters – group C (group 3)

**Note:** The actual parameter group number depends on the drive type. Group C (group 3) corresponds to:

- parameter group 54 in ACS355
- parameter group 52 in ACSM1, ACS380, ACS480, ACS580, ACS850 and ACQ810
- parameter group 52 in ACS880 and ACS880-M04 if the adapter is installed as fieldbus adapter A or group 55 if the adapter is installed as fieldbus adapter B.

| No.[1] | Name/Value | Description | Default |
|---|---|---|---|
| 01 | FBA data in 1 (drive to master) | Selects the resolution of status word (16 bit or 32 bit) sent by the drive. | 4 or 14[2] |
| | **4** = SW 16bit | Status word (16 bits) | |
| | **14** = SW 32bit | Status word (32 bits) | |
| 02 | FBA data in 2 (drive to master) | Selects data word 1 sent by the drive over the PROFINET network. The content is defined by a decimal number in the range of 0 to 9999 as follows:<br>0 – Not used<br>1…99 – Virtual address area of drive control<br>101…9999 – Parameter area of the drive<br>See also *Virtual address area allocation with ACSM1* on page *276*. | 0 or 5[3] |
| | **0** = None | Not used | |
| | **4** = SW 16bit | Status word (16 bits) | |
| | **5** = Act1 16bit | Actual value ACT1 (16 bits) | |
| | **6** = Act2 16bit | Actual value ACT2 (16 bits) | |
| | **14** = SW 32bit | Status word (32 bits) | |
| | **15** = Act1 32bit | Actual value ACT1 (32 bits) | |
| | **16** = Act2 32bit | Actual value ACT2 (32 bits) | |
| | **24** = SW2 16bit | Status word 2 (16 bits) | |

| No.[1] | Name/Value | Description | Default |
|---|---|---|---|
| | 101…9999 | Parameter index with format **xxyy**, where<br>• **xx** is the parameter group number (1…99)<br>• **yy** is the parameter number index within that group (01…99). | |
| | Other | Path to parameter area selection. | |
| 03…10 | DATA IN 3…DATA IN 12 | See parameter *01 FBA data in 1*. | 0 |

[1] The number of parameters in this group may vary by drive type and drive firmware.
[2] 14 (SW 32bit) is the default setting if the Transparent 32 profile is used.
[3] 5 (Act1 16bit) is a fixed setting with an ACS355 drive.

### Virtual address area allocation with ACSM1

When the PROFIdrive profile or PROFIdrive positioning mode is used with an ACSM1 drive, the virtual addresses shown below are recommended. (FBA REFx mode is selected with drive parameter 50.04/50.05.)

The information in the table is applicable only if PPO messaging is used (see parameter *20 Telegram type*). If standard telegrams (STx) are used, virtual addresses for standard telegrams (ST1 and ST2) are updated automatically.

| Abbreviation | Description | Data length | Recommended virtual address with ACSM1 FBA REFx modes | |
|---|---|---|---|---|
| | | | Speed mode | Position mode |
| STW1 | Control word 1 | 16-bit | 1 | 1 |
| NSOLL_A | Speed set point A | 16-bit | 2 or 3 | |
| NSOLL_B | Speed set point B | 32-bit | 12 or 13 | |
| STW2 | Control word 2 | 16-bit | 21 | 21 |
| XSOLL_A | Position set point A | 32-bit | | 12 or 13 |
| VELOCITY_A | Velocity | 32-bit | | 13 |
| ZSW2 | Status word 2 | 16-bit | 24 | 24 |
| NIST_A | Speed actual value A | 16-bit | 5 or 6 | |
| NIST_B | Speed actual value B | 32-bit | 15 or 16 | |
| ZSW1 | Status word 1 | 16-bit | 4 | 4 |
| XIST_A | Position actual value A | 32-bit | | 15 or 16 |

## Control locations

ABB drives can receive control information from multiple sources including digital inputs, analog inputs, the drive control panel and a fieldbus adapter module. ABB drives allow the user to separately determine the source for each type of control information (Start, Stop, Direction, Reference, Fault reset, etc.).

To give the fieldbus master the most complete control over the drive, you must select the adapter module as the source of this information. The drive-specific parameter setting examples below contain the drive control parameters relevant in the examples. For a complete parameter list, see the drive documentation.

## Starting up fieldbus communication for ACS355 drives

1. Power up the drive.
2. Enable the communication between the adapter module and the drive with parameter **9802 COMM PROT SEL**.
3. Set the module configuration parameters in group 51.

   At the minimum, select the communication protocol and profile with parameter **5102** and configure the network settings with parameters **5103**…**5113**. See also *PROFINET network settings* on page *363*.
4. With parameter **3018 COMM FAULT FUNC**, select how the drive reacts to a fieldbus communication break.
5. With parameter **3019 COMM FAULT TIME**, define the time between communication break detection and the selected action.
6. Define the process data transferred to and from the drive in parameter groups 54 and 55.

   **Note:** The adapter module sets the Status word and actual value automatically in parameters **5401** and **5402**, and Control word and reference in parameters **5501** and **5502**.
7. Validate the settings made in parameter groups 51, 54 and 55 with parameter **5127 FBA PAR REFRESH**.
8. Set the relevant drive control parameters to control the drive according to the application.

   Examples of appropriate values are shown in the tables below.

## Parameter setting examples – ACS355

### Speed control using the PROFIdrive communication profile with PPO Type 4

This example shows how to configure a basic speed control application that uses the PROFIdrive profile. In addition, some application-specific data is added to the communication.

The start/stop commands and reference are according to the PROFIdrive profile. For more information, see the PROFIdrive state machine on page *349*.

The reference value ±16384 (4000h) corresponds to parameter **1105 REF1 MAX** in the forward and reverse directions.

| Direction | PZD1 | PZD2 | PZD3 | PZD4 | PZD5 | PZD6 |
|---|---|---|---|---|---|---|
| Out | Control word | Speed reference | Constant speed 1[1)] | Constant speed 2 | N/A | N/A |
| In | Status word | Speed actual value | Power[1)] | DC bus voltage | N/A | N/A |

[1)] Example

The table below gives the recommended drive parameter settings.

| Drive parameter | Setting for ACS355 drives | Description |
|---|---|---|
| 9802 COMM PROT SEL | **4** = EXT FBA | Enables communication between the drive and the fieldbus adapter module. |
| 5101 FBA TYPE | ETHERNET[1)] | Displays the type of the fieldbus adapter module. |
| 5102 FB PAR 2 (PROTOCOL/ PROFILE) | **10** (= PNIO Pdrive) | Selects the PROFINET IO protocol and PROFIdrive profile. |
| 5210 FB PAR 3 (COMMRATE) | **0** (= Auto)[2)] | Ethernet communication rate is negotiated automatically by the device. |
| 5104 FB PAR 4 (IP CONFIGURATION) | **0** (= Static IP)[2)] | Configuration will be obtained from parameters *05*…*13* or from the PLC via the DCP protocol. |
| 5105 FB PAR 5 (IP ADDRESS 1) | 0[2)] | First part of the IP address |

| Drive parameter | Setting for ACS355 drives | Description |
|---|---|---|
| 5106 FB PAR 6 (IP ADDRESS 2) | 0[2)] | Second part of the IP address |
| 5107 FB PAR 7 (IP ADDRESS 3) | 0[2)] | Third part of the IP address |
| 5108 FB PAR 8 (IP ADDRESS 4) | 0[2)] | Last part of the IP address |
| 5109 FB PAR 9 (SUBNET CIDR) | 24[2)] | Sets the network mask as 255.255.255.0, allowing access only to the last subnet. |
| 3018 COMM FAULT FUNC | **3** = LAST SPEED[2)] | Enables fieldbus communication fault monitoring. |
| 3019 COMM FAULT TIME | 3.0 s[2)] | Defines the fieldbus communication break supervision time. |
| 5401 FBA DATA IN 1 | **4** (= SW 16bit)[1)] | Status word |
| 5402 FBA DATA IN 2 | **5** (= Act1 16bit)[1)] | Actual value 1 (speed) |
| 5403 FBA DATA IN 3 | 106[2)] | Power |
| 5404 FBA DATA IN 4 | 107[2)] | DC bus voltage |
| 5501 FBA DATA OUT 1 | **1** (= CW 16bit)[1)] | Control word |
| 5502 FBA DATA OUT 2 | **2** (= Ref1 16bit)[1)] | Reference 1 (speed) |
| 5503 FBA DATA OUT 3 | 1202[2)] | Constant speed 1 |
| 5504 FBA DATA OUT 4 | 1203[2)] | Constant speed 2 |
| 5127 FBA PAR REFRESH | **1** = REFRESH | Validates the FENA-01/-11/-21 configuration parameter settings. |
| 1001 EXT1 COMMANDS | **10** = COMM | Selects the fieldbus interface as the source of the start and stop commands for external control location 1. |
| 1103 REF1 SELECT | **8** = COMM | Selects the fieldbus reference 1 as the source for speed reference 1. |
| 1601 RUN ENABLE | **7** = COMM | Selects the fieldbus interface as the source for the inverted Run enable signal (Run disable). |

| Drive parameter | Setting for ACS355 drives | Description |
|---|---|---|
| 1604 FAULT RESET SEL | **8** = COMM | Selects the fieldbus interface as the source for the fault reset signal. |

[1] Read-only or automatically detected/set
[2] Example

The start sequence for the parameter example above is given below.

Control word:

- Reset the fieldbus communication fault (if active).
- Enter 47Eh (1150 decimal) → READY TO SWITCH ON.
- Enter 47Fh (1151 decimal) → OPERATING (Speed mode).

### Speed and torque control using the ABB Drives communication profile with PPO Type 4

This example shows how to configure a speed and torque control application that uses the ABB Drives profile. From the PLC programming point, the ABB Drives profile is similar to the PROFIdrive profile shown in the first example.

The start/stop commands and reference are according to the ABB Drives profile. For more information, see section *ABB Drives communication profile* on page *353*.

When Reference 1 (REF1) is used, a reference value of ±20000 (decimal) corresponds to the reference set by parameter **1105 REF1 MAX** in the forward and reverse directions.

When Reference 2 (REF2) is used, a reference value of ±10000 (decimal) corresponds to the reference set by parameter **1108 REF2 MAX** in the forward and reverse directions.

The minimum and maximum 16-bit integer values that can be given through the fieldbus are -32768 and 32767 respectively.

| Direction | PZD1 | PZD2 | PZD3 | PZD4 | PZD5 | PZD6 |
|---|---|---|---|---|---|---|
| Out | Control word | Speed reference | Torque reference | N/A | N/A | N/A |
| In | Status word | Speed actual value | Torque actual | N/A | N/A | N/A |

The table below gives the recommended drive parameter settings.

| Drive parameter | Setting for ACS355 drives | Description |
|---|---|---|
| 9802 COMM PROT SEL | **4** = EXT FBA | Enables communication between the drive and the fieldbus adapter module. |
| 5101 FBA TYPE | ETHERNET[1)] | Displays the type of the fieldbus adapter module. |
| 5102 FBAPAR 2 (PROTOCOL/PROFILE) | **11** (= PNIO ABB Pro) | Selects the PROFINET IO protocol and ABB Drives profile. |
| 5103 FB PAR 3 (COMMRATE) | **0** (= Auto)[2)] | Ethernet communication rate is negotiated automatically by the device. |
| 5104 FB PAR 4 (IP CONFIGURATION) | **0** (= Static IP) | Configuration will be obtained from parameters *05…13* or from the PLC via the DCP protocol. |
| 3018 COMM FAULT FUNC | **3** = LAST SPEED[2)] | Enables fieldbus communication fault monitoring. |
| 3019 COMM FAULT TIME | 3.0 s[2)] | Defines the fieldbus communication break supervision time. |
| 5401 FBA DATA IN 1 | **4** (= SW 16bit)[1)] | Status word |
| 5402 FBA DATA IN 2 | **5** (= Act1 16bit)[1)] | Actual value 1 (speed) |
| 5403 FBA DATA IN 3 | **6** (= Act2 16bit)[2)] | Actual value 2 (torque) |
| 5501 FBA DATA OUT 1 | **1** (= CW 16bit)[1)] | Control word |
| 5502 FBA DATA OUT 2 | **2** (= Ref1 16bit)[1)] | Reference 1 (speed) |
| 5503 FBA DATA OUT 3 | **2** (= Ref2 16bit)[2)] | Reference 2 (torque) |
| 5127 FBA PAR REFRESH | **1** = REFRESH | Validates the FENA-01/-11 configuration parameter settings. |
| 9904 MOTOR CTRL MODE | **2** = VECTOR: TORQ | Selects the vector control mode as the motor control mode. |
| 1001 EXT1 COMMANDS | **10** = COMM | Selects the fieldbus interface as the source of the start and stop commands for external control location 1. |

| Drive parameter | Setting for ACS355 drives | Description |
|---|---|---|
| 1002 EXT2 COMMANDS | **10** = COMM | Selects the fieldbus interface as the source of the start and stop commands for external control location 2. |
| 1102 EXT1/EXT2 SEL | **8** = COMM | Enables external control location 1/2 selection through the fieldbus. |
| 1103 REF1 SELECT | **8** = COMM | Selects the fieldbus reference 1 as the source for speed reference 1. |
| 1106 REF2 SELECT | **8** = COMM | Selects the fieldbus reference 2 as the source for speed reference 1. |
| 1601 RUN ENABLE | **7** = COMM | Selects the fieldbus interface as the source for the inverted Run enable signal (Run disable). |
| 1604 FAULT RESET SEL | **8** = COMM | Selects the fieldbus interface as the source for the fault reset signal. |

[1] Read-only or automatically detected/set
[2] Example

The start sequence for the parameter example above is given below.

Control word:

- Reset the fieldbus communication fault (if active).
- Enter 47Eh (1150 decimal) → READY TO SWITCH ON.
- Enter 47Fh (1151 decimal) → OPERATING (Speed mode)

  or

  C7Fh (3199 decimal) → OPERATING (Torque mode).

## Starting up fieldbus communication for ACSM1 drives

1. Power up the drive.
2. Enable the communication between the adapter module and the drive with parameter **50.01 FBA ENABLE**.
3. With parameter **50.02 COMM LOSS FUNC**, select how the drive reacts to a fieldbus communication break.

   Note that this function monitors both communication between the fieldbus master and the adapter module and communication between the adapter module and the drive.
4. With parameter **50.03 COMM LOSS T OUT**, define the time between communication break detection and the selected action.
5. Select application-specific values for parameters **50.04**…**50.11**.

   Examples of appropriate values are shown in the tables below.
6. Set the module configuration parameters in group 51.

   At the minimum, select the communication protocol and profile with parameter **51.02** and configure the network settings with parameters **51.03**…**51.13**. See also *PROFINET network settings* on page *363*.
7. Define the process data transferred to and from the drive in parameter groups 52 and 53.

   **Note**: The adapter module automatically sets the communication profile-specific virtual address for the Status word in parameter **52.01** and for the Control word in parameter **53.01**.
8. Validate the settings made in parameter groups 51, 52 and 53 with parameter **51.27 FBA PAR REFRESH**.

9. Set the relevant drive control parameters to control the drive according to the application.

   Examples of appropriate values are shown in the tables below.

## Parameter setting examples – ACSM1

### Speed control using the PROFIdrive communication profile with PPO Type 4

This example shows how to configure a basic speed control application that uses the PROFIdrive profile. In addition, some application-specific data is added to the communication.

The start/stop commands and reference are according to the PROFIdrive profile, speed control mode. For more information, see the PROFIdrive state machine on page *349*.

The reference value ±16384 (4000h) corresponds to parameter **25.02 SPEED SCALING** in the forward and reverse directions.

| Direction | PZD1 | PZD2 | PZD3 | PZD4 | PZD5 | PZD6 |
|---|---|---|---|---|---|---|
| Out | Control word | Speed reference | Constant speed 1[1)] | | Speed reference for jogging function 11) | |
| In | Status word | Speed actual value | Power[1)] | | DC bus voltage[1)] | |

[1)] Example

The table below gives the recommended drive parameter settings.

| Drive parameter | Setting for ACSM1 drives | Description |
|---|---|---|
| 50.01 FBA ENABLE | Enable | Enables communication between the drive and the fieldbus adapter module. |
| 50.02 COMM LOSS FUNC | Last speed | Enables fieldbus communication fault monitoring. |
| 50.03 COMM LOSS T OUT | 3.0 s | Defines the fieldbus communication break supervision time. |
| 50.04 FBA REF1 MODESEL | Speed | Selects the fieldbus reference 1 scaling. |

| Drive parameter | Setting for ACSM1 drives | Description |
|---|---|---|
| 51.01 FBA TYPE | ETHERNET[1)] | Displays the type of the fieldbus adapter module. |
| 51.02 FBA PAR2 (PROTOCOL/PROFILE) | **10** (= PNIO Pdrive) | Selects the PROFINET IO protocol and PROFIdrive profile. |
| 51.03 FBA PAR3 (COMMRATE) | 0 (= Auto)[2)] | Ethernet communication rate is negotiated automatically by the device. |
| 51.04 FBA PAR4 (IP CONFIGURATION) | **0** (= Static IP) | Configuration will be obtained from parameters *05*…*13* or from the PLC via the DCP protocol. |

| | | |
|---|---|---|
| 52.01 FBA DATA IN1 | **4** (= SW 16bit)[1)] | Status word |
| 52.02 FBA DATA IN2 | **5** (= Act1 16bit) | Actual value 1 (speed) |
| 52.03 FBA DATA IN3 | 122[2)] | Power |
| 52.05 FBA DATA IN5 | 107[2)] | DC bus voltage |
| 53.01 FBA DATA OUT1 | **1** (= CW 16bit)[1)] | Control word |
| 53.02 FBA DATA OUT2 | **2** (= Ref1 16bit) | Reference 1 (speed) |
| 53.03 FBA DATA OUT3 | 2408[2)] | Constant speed |
| 53.05 FBA DATA OUT5 | 2410[2)] | Speed reference for jogging function 1 |

| | | |
|---|---|---|
| 51.27 FBA PAR REFRESH | REFRESH | Validates the FENA-11/-21 configuration parameter settings. |

| | | |
|---|---|---|
| 10.01 EXT1 START FUNC | FBA | Selects the fieldbus interface as the source of the start and stop commands for external control location 1. |
| 24.01 SPEED REF1 SEL | FBA REF1 | Selects the fieldbus reference 1 as the source for speed reference 1. |
| 34.03 EXT1 CTRL MODE1 | Speed | Selects speed control as the control mode 1 for external control location 1. |

1) Read-only or automatically detected/set
2) Example

The start sequence for the parameter example above is given below.

Control word:

- Reset the fieldbus communication fault (if active).
- Enter 47Eh (1150 decimal) → READY TO SWITCH ON.
- Enter 47Fh (1151 decimal) → OPERATING (Speed mode).

### Position control using the PROFIdrive communication profile with PPO Type 4

This example shows how to configure a basic positioning application. The start/stop commands and reference are according to the PROFIdrive profile, positioning mode. For more information, see the PROFIdrive state machine on page *350*.

**Note:** By default, fieldbus is not the only control source. See actual signal **02.12 FBA MAIN CW** in *ACSM1 Motion Control Program Firmware Manual* for details.

The position set point and velocity reference are defined as 32-bit integer values; both are scaled as defined in the drive parameter settings.

| Direction | PZD1 | PZD2 | PZD3 | PZD4 | PZD5 | PZD6 |
|---|---|---|---|---|---|---|
| Out | Control word (STW1) | Position set point | | Velocity reference | | N/A |
| In | Status word (ZSW1) | Position actual value | | Velocity actual value | | N/A |

The table below gives the recommended drive parameter settings.

| Drive parameter | Setting for ACSM1 drives | Description |
|---|---|---|
| 50.01 FBA ENABLE | Enable | Enables communication between the drive and the fieldbus adapter module. |
| 50.02 COMM LOSS FUNC | Fault | Enables fieldbus communication fault monitoring. |
| 50.03 COMM LOSS T OUT | 3.0 s | Defines the fieldbus communication break supervision time. |
| 50.04 FBA REF1 MODESEL | Position | Selects the fieldbus reference 1 scaling. |

| Drive parameter | Setting for ACSM1 drives | Description |
|---|---|---|
| 50.05 FBA REF2 MODESEL | Velocity | Selects the fieldbus reference 2 scaling. |

| | | |
|---|---|---|
| 51.01 FBA TYPE | ETHERNET[1)] | Displays the type of the fieldbus adapter module. |
| 51.02 FBA PAR2 (PROTOCOL/PROFILE) | **14** (= PNIO PdriveM) | Selects the PROFINET IO protocol and PROFIdrive positioning mode. |
| 51.03 FBA PAR3 (COMMRATE) | **0** (= Auto[2)]) | Ethernet communication rate is negotiated automatically by the device. |
| 51.04 FBA PAR4 (IP CONFIGURATION) | **0** (= Static IP) | Configuration will be obtained from parameters *05...13* or from the PLC via the DCP protocol. |

| | | |
|---|---|---|
| 52.01 FBA DATA IN1 | **4** (= SW 16bit)[1)] | Status word |
| 52.02 FBA DATA IN2 | **15** (= Act1 32bit) | Actual value 1 |
| 52.04 FBA DATA IN4 | **16** (= Act2 32bit) | Actual value 2 |
| 53.01 FBA DATA OUT1 | **1** (= CW 16bit)[1)] | Control word |
| 53.02 FBA DATA OUT2 | **12** (= Ref1 32bit) | Reference 1 |
| 53.04 FBA DATA OUT4 | **13** (= Ref2 32bit) | Reference 2 |

| | | |
|---|---|---|
| 51.27 FBA PAR REFRESH | REFRESH | Validates the FENA-11/-21 configuration parameter settings. |

| | | |
|---|---|---|
| 10.01 EXT1 START FUNC | FBA | Selects the fieldbus interface as the source of the start and stop commands for external control location 1. |
| 10.05 JOG ENABLE | C.FALSE | Disables the jogging functions. |
| 22.01 SPEED FB SEL | Enc1 speed[2)] | Selects the actual speed measured by encoder 1 as the speed feedback. |
| 34.02 EXT1 MODE 1/2SEL | P.FBA MAIN CW.26 | Selects the source for external 1 control mode 1/2 selection. Selection is done by bit 26 START_HOMING in the fieldbus Control word. Mode 1: Position, Mode 2: Homing |
| 34.03 EXT1 CTRL MODE1 | Position | Selects position control as the control mode 1 for external control location 1. |

| Drive parameter | Setting for ACSM1 drives | Description |
|---|---|---|
| 34.04 EXT1 CTRL MODE2 | Homing | Selects homing control as the control mode 2 for external control location 1. |
| 62.01 HOMING METHOD | CAN Method xx | Selects the homing mode. Select the appropriate CAN Method. |
| 62.03 HOMING START | C.False | Selects the fieldbus as the homing start source. |
| 65.01 POS REFSOURCE | Fieldbus | Position reference and speed are read from the fieldbus. |
| 65.03 POS START 1 | C.False | Selects the fieldbus as the position start1source. |
| 65.04 POS REF 1 SEL | FBA REF 1 | Selects the FBA reference 1 as the position reference source. |
| 65.11 POS START 2 | C.False | Selects the fieldbus as the position start2 source. |
| 65.22 PROF VEL REF SEL | FBA REF2 | Selects the FBA reference 2 as the velocity reference source. |
| 66.05 POS ENABLE | C.False | Selects the fieldbus as the source for enabling the position reference generator. |
| 70.03 POS REF ENA | C.False | Selects the fieldbus as the source for the position reference enable command. |

1) Read only or automatically detected/set
2) Example

The position set point is scaled as follows:

| Drive parameter | Setting |
|---|---|
| 60.05 POS UNIT (Position unit) | m[1)] |
| 60.08 POS2INT SCALE | 100[1)] |

1) Example

The position set point and actual values are scaled with the above example values as follows:

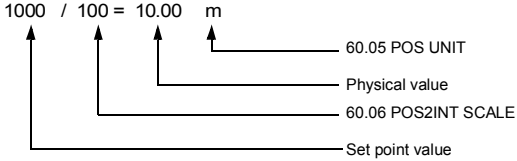


Example for velocity set point scale:

| Drive parameter | Name | Value | Description |
|---|---|---|---|
| 60.10 | POS SPEED UNIT | u/s[1)] | Unit/s (in this case m/s) |
| 60.11 | POS SPEED2INT | 100[1)] | Scales position speed values to integer values.<br>Selections:<br>1/10/100/1000/10000/100000 |

[1)] Example

The velocity set point and actual values are scaled with the above example values as follows:

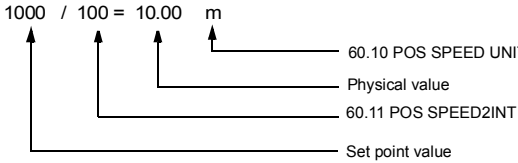


Pay attention to the following parameters:

| Group | Description |
|---|---|
| 90 | Encoder selection |
| 91/92/93 | Settings of the encoder |

The start sequence for the above parameter example is given below:

Control word:

- Reset the fieldbus communication fault (if active).
- Enter 406h (1030 decimal) → READY TO SWITCH ON.
- Enter 40Fh (1039 decimal) → OPERATING.
- Enter 43Fh (1087 decimal) → OPERATING (Do reject traversing task with no intermediate stop).
- Enter 47Fh (1151 decimal) → OPERATING (Activate traversing task).
- Enter C0Fh (3087 decimal) → OPERATING (Start Homing procedure).

### Speed and torque control using the ABB Drives communication profile with PPO Type 4

This example shows how to configure a speed and torque control application that uses the ABB Drives profile. From the PLC programming point, the ABB Drives profile is similar to the PROFIdrive profile shown in the first example.

The start/stop commands and reference are according to the ABB Drives profile. For more information, see section *ABB Drives communication profile* on page *353*.

When Reference 1 (REF1) is used, a reference value of ±20000 (4E20h) corresponds to the reference set by parameter **25.02 SPEED SCALING** in the forward and reverse directions.

When Reference 2 (REF2) is used, a reference value of ±10000 (2710h) corresponds to the reference set by parameter **32.04 TORQUE REF 1 MAX** in the forward and reverse directions.

| Direction | PZD1 | PZD2 | PZD3 | PZD4 | PZD5 | PZD6 |
|---|---|---|---|---|---|---|
| Out | Control word | Speed reference | Torque reference | N/A | N/A | N/A |
| In | Status word | Speed actual value | Torque actual | N/A | N/A | N/A |

The table below gives the recommended drive parameter settings.

| Drive parameter | Setting for ACSM1 drives | Description |
|---|---|---|
| 50.01 FBA ENABLE | Enable | Enables communication between the drive and the fieldbus adapter module. |
| 50.02 COMM LOSS FUNC | Fault | Enables fieldbus communication fault monitoring. |
| 50.03 COMM LOSS T OUT | 3.0 s | Defines the fieldbus communication break supervision time. |
| 50.04 FBA REF1 MODESEL | Speed | Selects the fieldbus reference 1 scaling. |
| 50.05 FBA REF2 MODESEL | Torque | Selects the fieldbus reference 2 scaling. |
| 51.01 FBA TYPE | ETHERNET[1)] | Displays the type of the fieldbus adapter module. |
| 51.02 FBA PAR2 (PROTOCOL/PROFILE) | **11** (= PNIO ABB Pro) | Selects the PROFINET IO protocol and the ABB Drives profile. |
| 51.03 FBA PAR3 (COMMRATE) | **0** (= Auto)[2)] | Ethernet communication rate is negotiated automatically by the device. |
| 51.04 FBA PAR4 (IP CONFIGURATION) | **0** (= Static IP) | Configuration will be obtained from parameters *05…13* or from the PLC via the DCP protocol. |
| 52.01 FBA DATA IN1 | **4** (= SW 16bit)[1)] | Status word (PZD 1) |
| 52.02 FBA DATA IN2 | **5** (= Act1 16bit) | Actual value 1 |
| 52.03 FBA DATA IN3 | **6** (= Act2 16bit) | Actual value 2 |
| 53.01 FBA DATA OUT1 | **1** (= CW 16bit)[1)] | Control word |
| 53.02 FBA DATA OUT2 | **2** (= Ref1 16bit) | Reference 1 |
| 53.03 FBA DATA OUT3 | **3** (= Ref2 16bit) | Reference 2 |
| 51.27 FBA PAR REFRESH | REFRESH | Validates the FENA-11/-21 configuration parameter settings. |

| Drive parameter | Setting for ACSM1 drives | Description |
|---|---|---|
| 10.01 EXT1 START FUNC | FBA | Selects the fieldbus interface as the source of the start and stop commands for external control location 1. |
| 10.04 EXT2 START FUNC | FBA | Selects the fieldbus interface as the source of the start and stop commands for external control location 2. |
| 24.01 SPEED REF1 SEL | FBA REF 1 | Selects the fieldbus reference 1 as the source for speed reference 1. |
| 32.02 TORQ REF ADD SEL | FBA REF 2 | Selects the fieldbus reference 2 as the source for torque reference 1. |
| 34.01 EXT1/EXT2 SEL | P.FBA MAIN CW.15 | Enables external control location 1/2 selection through the fieldbus only (bit 15 in the fieldbus Control word). |
| 34.03 EXT1 CTRL MODE1 | Speed | Selects speed control as the control mode 1 for external control location 1. |
| 34.05 EXT2 CTRL MODE1 | Torque | Selects torque control as the control mode 1 for external control location 2. |

[1] Read-only or automatically detected/set
[2] Example

The start sequence for the parameter example above is given below.

Control word:

- Reset the fieldbus communication fault (if active).
- Enter 47Eh (1150 decimal) → READY TO SWITCH ON.
- Enter 47Fh (1151 decimal) → OPERATING (Speed mode)

  or

  C7Fh (3199 decimal) → OPERATING (Torque mode).

## Starting up fieldbus communication for ACS850 and ACQ810 drives

1. Power up the drive.
2. Enable the communication between the adapter module and the drive with parameter **50.01 FBA enable**.
3. With parameter **50.02 Comm loss func**, select how the drive reacts to a fieldbus communication break.

   **Notes:**
   - This function monitors both communication between the fieldbus master and the adapter module and communication between the adapter module and the drive.
   - In ACQ810, you can select the control locations to be monitored with parameter **50.21 Comm loss enable**. By default, the monitoring is enabled in both control locations (EXT1 and EXT2).
4. With parameter **50.03 Comm loss t out**, define the time between communication break detection and the selected action.
5. Select application-specific values for parameters **50.04**…**50.11**.

   Examples of appropriate values are shown in the tables below.
6. Set the module configuration parameters in group 51.

   At the minimum, select the communication protocol and profile with parameter **51.02** and configure the network settings with parameters **51.03**…**51.13**.
7. Define the process data transferred to and from the drive in parameter groups 52 and 53.

   **Note:** The adapter module automatically sets the communication profile-specific virtual address for the Status word in parameter **52.01** and for the Control word in parameter **53.01**.

8. Validate the settings made in parameter groups 51, 52 and 53 with parameter **51.27 FBA par refresh**.
9. Set the relevant drive control parameters to control the drive according to the application.

   Examples of appropriate values are shown in the tables below.

## Parameter setting examples – ACS850 and ACQ810

### Speed control using the PROFIdrive communication profile with PPO Type 4

This example shows how to configure a basic speed control application that uses the PROFIdrive profile. In addition, some application-specific data is added to the communication.

The start/stop commands and reference are according to the PROFIdrive profile, speed control mode. For more information, see the PROFIdrive state machine on page *349*.

The reference value ±16384 (4000h) corresponds to parameter **19.01 Speed scaling** in the forward and reverse directions.

| Direction | PZD1 | PZD2 | PZD3 | PZD4 | PZD5 | PZD6 |
|---|---|---|---|---|---|---|
| Out | Control word | Speed reference | Constant speed 1[1)] | | Constant speed 2[1)] | |
| In | Status word | Speed Actual value | Power[1)] | | DC bus voltage[1)] | |

[1)] Example

The table below gives the recommended drive parameter settings.

| Drive parameter | Setting for ACS850/ACQ810 drives | Description |
|---|---|---|
| 50.01 Fba enable | Enable | Enables communication between the drive and the fieldbus adapter module. |
| 50.02 Comm loss func | Fault[2)] | Enables fieldbus communication fault monitoring. |
| 50.03 Comm loss t out | 3.0 s[2)] | Defines the fieldbus communication break supervision time. |

| Drive parameter | Setting for ACS850/ACQ810 drives | Description |
|---|---|---|
| 50.04 Fb ref1 modesel | Speed | Selects the fieldbus reference 1 scaling. |

| | | |
|---|---|---|
| 51.01 FBA type | Ethernet[1)] | Displays the type of the fieldbus adapter module. |
| 51.02 FBA par2 (PROTOCOL/PROFILE) | **10** (= PNIO Pdrive) | Selects the PROFINET IO protocol and the PROFIdrive profile. |
| 51.03 FBA par3 (COMMRATE) | **0** (= Auto[2)] | Ethernet communication rate is negotiated automatically by the device. |
| 51.04 FBA par4 (IP CONFIGURATION) | **0** (= Static IP) | Configuration will be obtained from parameters *05…13* or from the PLC via the DCP protocol. |

| | | |
|---|---|---|
| 52.01 FBA data in1 | **4** (= SW 16bit)[1)] | Status word |
| 52.02 FBA data in2 | **5** (= Act1 16bit) | Actual value 1 (speed) |
| 52.03 FBA data in3 | 122[2)] | Power |
| 52.05 FBA data in5 | 107[2)] | DC bus voltage |
| 53.01 FBA data out1 | **1** (= CW 16bit)[1)] | Control word |
| 53.02 FBA data out2 | **2** (= Ref1 16bit) | Reference 1 (speed) |
| 53.03 FBA data out3 | 2606[2)] | Constant speed 1 |
| 53.05 FBA data out5 | 2607[2)] | Constant speed 2 |

| | | |
|---|---|---|
| 51.27 FBA par refresh | Refresh | Validates the FENA-11/-21 configuration parameter settings. |

| | | |
|---|---|---|
| 10.01 Ext1 start func | FB | Selects the fieldbus interface as the source of the start and stop commands for external control location 1. |
| 21.01 Speed ref1 sel (ACS850)<br>21.01 Speed ref sel (ACQ810) | FBA ref1<br><br>FBA ref1 | Selects the fieldbus reference 1 as the source for speed reference 1. |

[1)] Read-only or automatically detected/set

[2)] Example

The start sequence for the parameter example above is given below.

Control word:

- Reset the fieldbus communication fault (if active).
- Enter 47Eh (1150 decimal) → READY TO SWITCH ON.
- Enter 47Fh (1151 decimal) → OPERATING (Speed mode).

## Starting up fieldbus communication for ACS480, ACS580 and ACS880 drives

1. Power up the drive.
2. Enable the communication between the adapter module and the drive by selecting the correct slot number in parameter **50.01 FBA A enable**.

   The selection must correspond to the slot where the adapter module is installed. For example, if the adapter module is installed in slot 1, you must select slot 1.
3. With parameter **50.02 FBA A comm loss func**, select how the drive reacts to a fieldbus communication break.

   Note that this function monitors both communication between the fieldbus master and the adapter module and communication between the adapter module and the drive.
4. With parameter **50.03 FBA A comm loss t out**, define the time between communication break detection and the selected action.
5. Select application-specific values for the rest of the parameters in group 50, starting from **50.04**.

   Examples of appropriate values are shown in the tables below.
6. Set the module configuration parameters in group 51.

   At the minimum, select the communication protocol and profile with parameter **51.02 Protocol/Profile** and configure the network settings with parameters **51.03**…**51.13**.

7. Define the process data transferred to and from the drive in parameter groups 52 and 53.

   **Note:** The adapter module automatically sets the communication profile-specific virtual address for the Status word in parameter **52.01** and for the Control word in parameter **53.01**.

8. Save the valid parameter values to permanent memory with parameter **96.07 Parameter save manually**.

9. Validate the settings made in parameter groups 51, 52 and 53 with parameter **51.27 FBA A par refresh**.

10. Set the relevant drive control parameters to control the drive according to the application.

    Examples of appropriate values are shown in the tables below.

## Parameter setting examples – ACS480 and ACS580

### Frequency control using PROFIdrive communication profile with PPO Type 4

This example shows how to configure a basic frequency control application that uses the PROFIdrive profile. In addition, some application-specific data is added to the communication.

The start/stop commands and reference are according to the PROFIdrive profile, speed control mode. For more information, see the PROFIdrive state machine on page *349*.

The reference value ±16384 (4000h) corresponds to parameter **46.02 Frequency scaling** in the forward and reverse directions.

| Direction | PZD1 | PZD2 | PZD3 | PZD4 | PZD5 | PZD6 |
|---|---|---|---|---|---|---|
| Out | Control word | Frequency reference | Constant frequency 1[1)] | | Constant frequency 2[1)] | |
| In | Status word | Frequency actual value | Power[1)] | | DC bus voltage[1)] | |

[1)] Example

The table below gives the recommended drive parameter settings.

| Drive parameter | Setting for ACS580 drives | Description |
|---|---|---|
| 50.01 FBA A enable | **1** = Option slot 1[2)] | Enables communication between the drive and the fieldbus adapter module. |
| 50.04 FBA A ref1 type | **0** = Speed or frequency | Selects the fieldbus A reference 1 type and scaling. |
| 50.07 FBA A act1 type | **0** = Auto | Selects the actual value type and scaling according to the currently active Ref1 mode defined in parameter 50.04. |
| 51.01 FBA A type | **128** = ETHERNET[1)] | Displays the type of the fieldbus adapter module. |
| 51.02 Protocol/Profile | **10** = PNIO Pdrive | Selects the PROFINET IO protocol and the PROFIdrive profile. |
| 51.03 Commrate | **0** = Auto[2)] | Ethernet communication rate is negotiated automatically by the device. |
| 51.04 IP configuration | **0** = Static IP | Configuration will be obtained from parameters *05…13* or from the PLC via the DCP protocol. |
| 52.01 FBA data in1 | **4** = SW 16bit[1)] | Status word |
| 52.02 FBA data in2 | **5** = Act1 16bit | Actual value 1 |
| 52.03 FBA data in3 | 01.14 | Output power |
| 52.05 FBA data in5 | 01.11 | DC voltage |
| 53.01 FBA data out1 | **1** = CW 16bit[1)] | Control word |
| 53.02 FBA data out2 | **2** = Ref1 16bit | Reference 1 (frequency) |
| 53.03 FBA data out3 | 28.26 | Constant frequency 1 |
| 53.05 FBA data out5 | 28.27 | Constant frequency 2 |
| 51.27 FBA A par refresh | **1** = Refresh | Validates the FENA-11/-21 configuration parameter settings. |
| 19.12 Ext1 control mode | **2** = Speed | Selects speed control as the control mode 1 for external control location 1. |

| Drive parameter | Setting for ACS580 drives | Description |
|---|---|---|
| 20.01 Ext1 commands | **12** = Fieldbus A | Selects the fieldbus A interface as the source of the start and stop commands for external control location 1. |
| 22.11 Speed ref1 source | **4** = FB A ref1 | Selects the fieldbus A reference 1 as the source for speed reference 1. |

1) Read-only or automatically detected/set
2) Example

The start sequence for the parameter example above is given below.

Control word:
- Reset the fieldbus communication fault (if active).
- Enter 47Eh (1150 decimal) → READY TO SWITCH ON.
  Enter 47Fh (1151 decimal) → OPERATING (Scalar motor control mode).

## Parameter setting examples – ACS880

### Speed control using PROFIdrive communication profile with PPO Type 4

This example shows how to configure a basic speed control application that uses the PROFIdrive profile. In addition, some application-specific data is added to the communication.

The start/stop commands and reference are according to the PROFIdrive profile, speed control mode. For more information, see the PROFIdrive state machine on page *349*.

The reference value ±16384 (4000h) corresponds to parameter **46.01 Speed scaling** in the forward and reverse directions.

| Direction | PZD1 | PZD2 | PZD3 | PZD4 | PZD5 | PZD6 |
|---|---|---|---|---|---|---|
| Out | Control word | Speed reference | Constant speed 1[1)] | | Constant speed 2[1)] | |
| In | Status word | Speed actual value | Power[1)] | | DC bus voltage[1)] | |

1) Example

The table below gives the recommended drive parameter settings.

| Drive parameter | Setting for ACS880 drives | Description |
|---|---|---|
| 50.01 FBA A enable | **1** = Option slot 1[2)] | Enables communication between the drive and the fieldbus adapter module. |
| 50.04 FBA A ref1 type | **4** = Speed | Selects the fieldbus A reference 1 type and scaling. |
| 50.07 FBA A act1 type | **0** = Auto | Selects the actual value type and scaling according to the currently active Ref1 mode defined in parameter 50.04. |
| 51.01 FBA A type | **128** = ETHERNET[1)] | Displays the type of the fieldbus adapter module. |
| 51.02 Protocol/Profile | **10** = PNIO Pdrive | Selects the PROFINET IO protocol and the PROFIdrive profile. |
| 51.03 Commrate | **0** = Auto[2)] | Ethernet communication rate is negotiated automatically by the device. |
| 51.04 IP configuration | **0** = Static IP | Configuration will be obtained from parameters *05…13* or from the PLC via the DCP protocol. |
| 52.01 FBA data in1 | **4** = SW 16bit[1)] | Status word |
| 52.02 FBA data in2 | **5** = Act1 16bit | Actual value 1 |
| 52.03 FBA data in3 | 01.14 | Output power |
| 52.05 FBA data in5 | 01.11 | DC voltage |
| 53.01 FBA data out1 | **1** = CW 16bit[1)] | Control word |
| 53.02 FBA data out2 | **2** = Ref1 16bit | Reference 1 (speed) |
| 53.03 FBA data out3 | 22.26 | Constant speed 1 |
| 53.05 FBA data out5 | 22.27 | Constant speed 2 |
| 51.27 FBA A par refresh | **1** = Refresh | Validates the FENA-11/-21 configuration parameter settings. |
| 19.12 Ext1 control mode | **2** = Speed | Selects speed control as the control mode 1 for external control location 1. |

| Drive parameter | Setting for ACS880 drives | Description |
|---|---|---|
| 20.01 Ext1 commands | **12** = Fieldbus A | Selects the fieldbus A interface as the source of the start and stop commands for external control location 1. |
| 22.11 Speed ref1 source | **4** = FB A ref1 | Selects the fieldbus A reference 1 as the source for speed reference 1. |

[1] Read-only or automatically detected/set
[2] Example

The start sequence for the parameter example above is given below.

Control word:

- Reset the fieldbus communication fault (if active).
- Enter 47Eh (1150 decimal) → READY TO SWITCH ON.
- Enter 47Fh (1151 decimal) → OPERATING (Speed mode).

## Configuring the master station

After the adapter module has been initialized by the drive, you must prepare the master station for communication with the module. Examples of an ABB AC500 PLC and Siemens SIMATIC S7 PLC are given below. If you are using another master system, refer to its documentation for more information.

The examples apply to all drive types compatible with the module.

### Downloading the GSD file

Configuration of the master station requires a type definition (GSD) file. In PROFINET IO, the GSD file is written in XML-based language called GSDML.

Download the FENA GSD file from the Document library (*http://new.abb.com/drives/connectivity/fieldbus-connectivity/profinet*). The file name format is **GSDML-Vx.x-ABB-FENA-yyyymmdd.xml**.

The GSD file describes the vendor-specific and PROFIdrive-specific features of the adapter module. Vendor-specific features can be used, for example, in the ABB Drives communication profile. The PROFIdrive profile supports a set of services described in the PROFIdrive specification.

### Configuring an ABB AC500 PLC

This example shows how to configure communication between an ABB AC500 PLC and the adapter module using Control Builder Plus PS501, software version 2.1.0 and later.

Before you start, make sure that you have downloaded the FENA GSD file from the Document library.

1. Start the ABB Control Builder software.
2. On the **Tools** menu, select **Device Repository**.

3. In the window that opens, click **Install...** and browse for the GSD file.

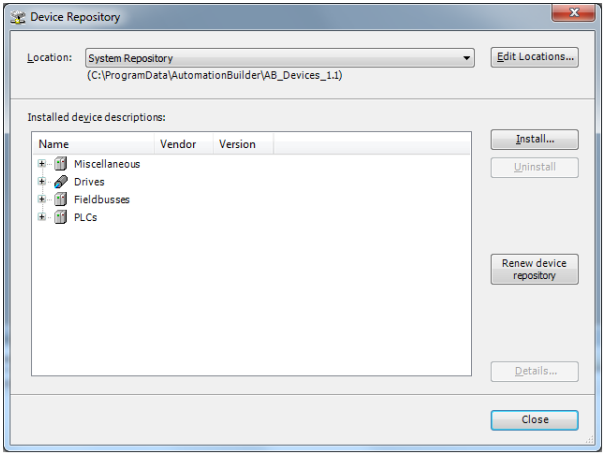


4. Open or create the PLC project that is used to control the drive.
5. Add the CM579-PNIO PROFINET master device to the PLC project, if necessary.
6. Add the adapter module to the PROFINET IO network.
7. Add the I/O module, for example, PPO Type 4 to the adapter module to define cyclical communication between the module and the PLC.

8. Define the CM579-PNIO master properties, such as the IP address and address settings for slaves.

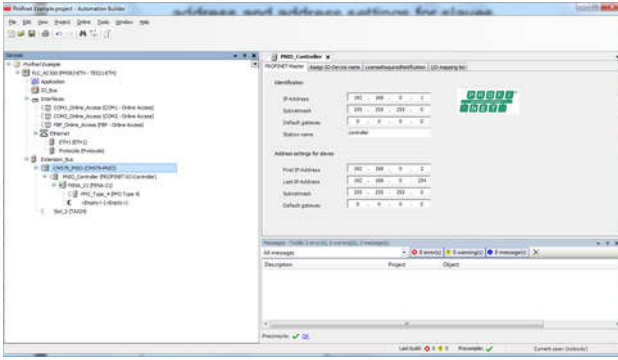

9. Define the adapter module properties:

   On the **PNIO identification** tab, select the IP address and Subnet mask, and type the Station name. **Note:** Use only small letters for the Station name.

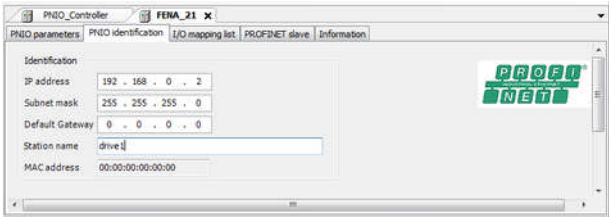


10. Open the PLC program.

11. Compile the project and download it to the PLC.

    This is necessary for you to be able to configure the CM579-PNIO master device and allow it to scan the network.

12. Return to the CM579-PNIO master properties. On the **Assign station name** tab, do the following tasks:
    - Click **Connect to PLC (Login)** and select the communication link used between Control Builder and the PLC. Then, click **Scan slaves** to find all PROFINET slaves connected to the network.

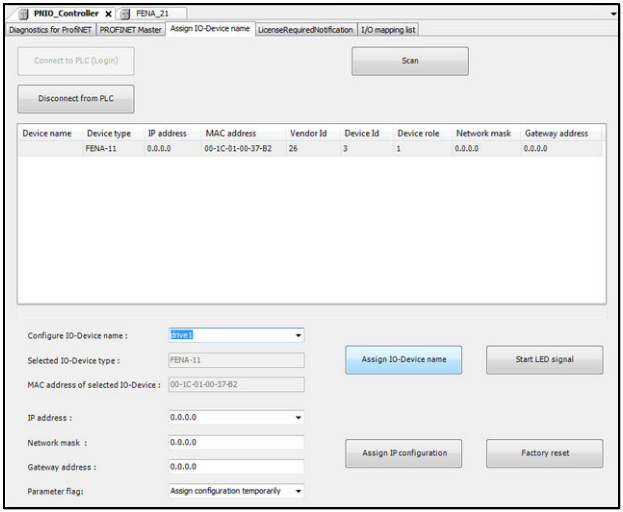


    - In the **Configure station name** box, select the station name defined for the module in step 9, and then click **Assign station name.**
    - In the **IP address** and **Network mask** boxes, select/type the IP address and subnet mask defined in step 9, and then click **Assign IP configuration**.

13. Define the I/O module properties:
    - On the **PNIO parameters** tab, configure the Stop mode and Control-zero mode functionalities, and define fail safe values for the PLC output process data (PZDs).

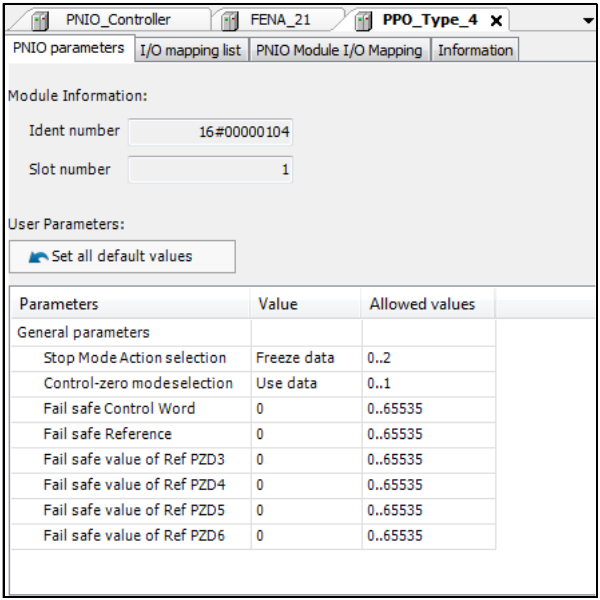

- On the **PNIO Module I/O Mapping** tab, type names for the variables that refer to the drive's signals in the PLC program.

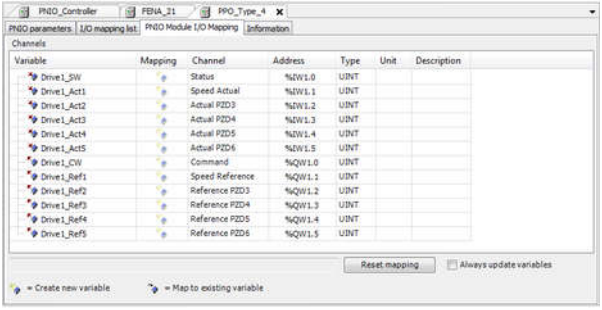


14. Open the PLC program and create a program that controls the drive.

15. Compile the project and download it to the PLC.

    **Note:** Make sure that the variable names defined for the drive's signals are used in the PLC program. Otherwise the communication will not work.

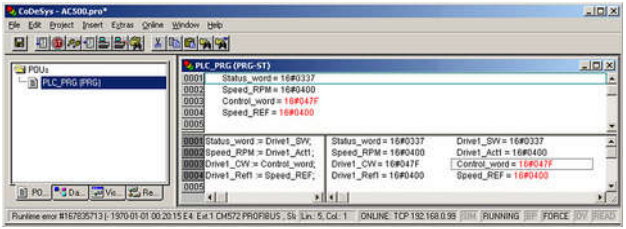

## Configuring a Siemens SIMATIC S7 PLC

This example shows how to configure communication between a Siemens SIMATIC S7 PLC and the adapter module using SIMATIC Manager Step 7.

Before you start, make sure that you have downloaded the FENA GSD file from the Document library.

1. Start the SIMATIC manager and open/create a SIMATIC program.
2. Open the hardware configuration of the project.

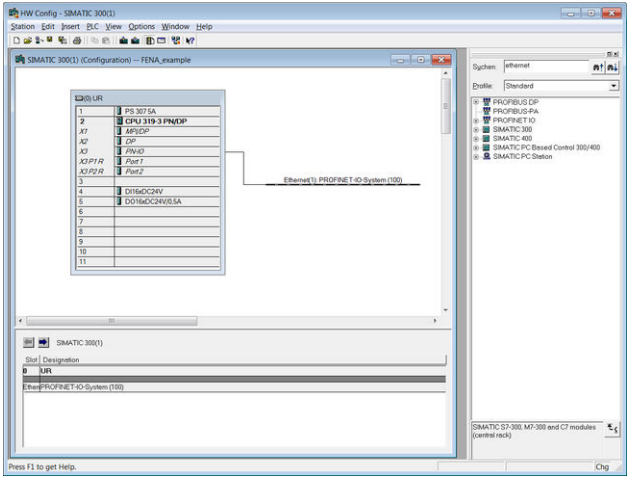

3. Install the FENA GSD file:
   - On the **Options** menu, select **Install GSD Files.**
   - Browse for the GSD file downloaded from the Document library and click **Install**.

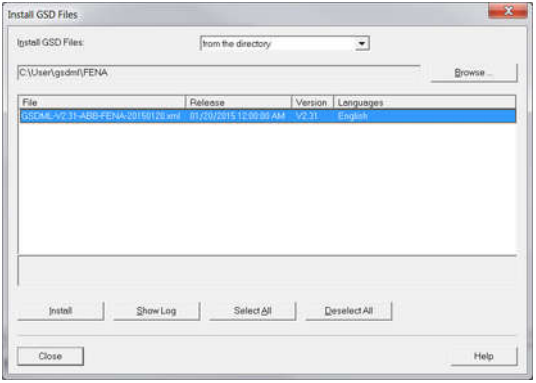

4. Click and drag the FENA object from the device catalog to the Ethernet (1): PROFINET-IO-System.

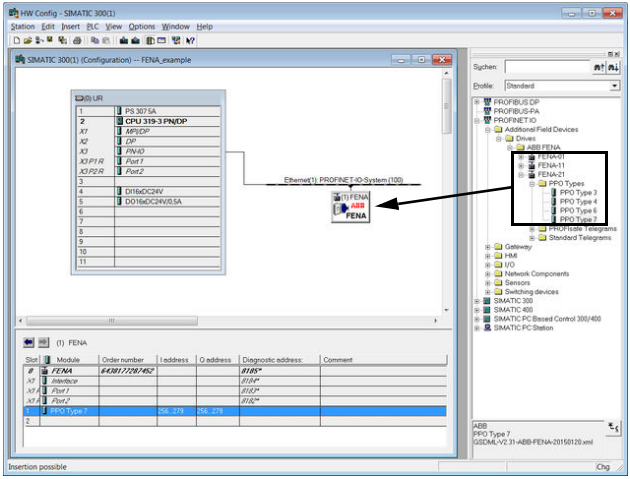

5. Click and drag the PP0 Type 7 object to Slot 1.
   Then, double-click FENA to open the **Properties** window.

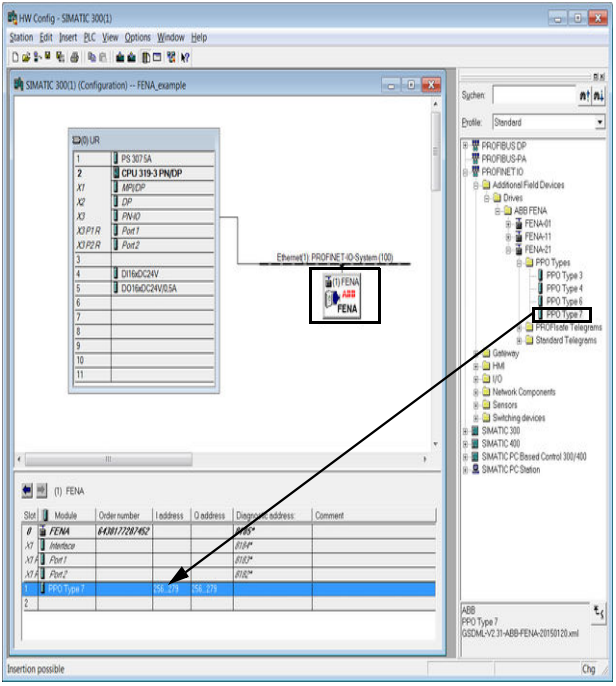

6. On the **General** tab, type a name for the adapter module in the **Device name** box.

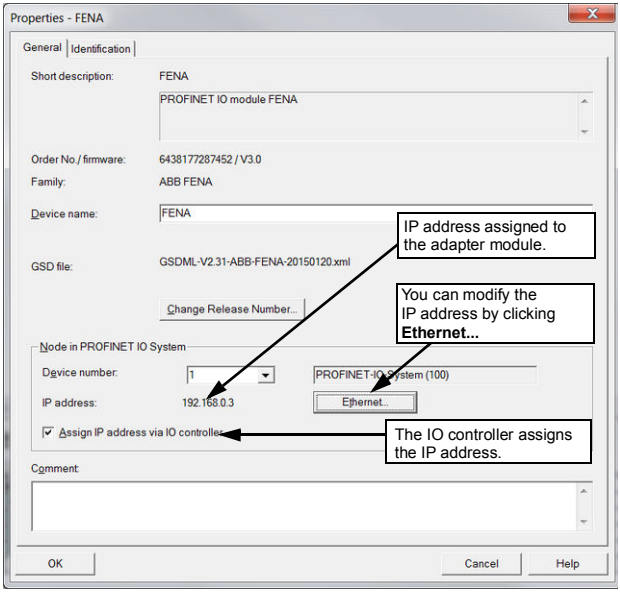

7. In the hardware configuration, double-click PPO Type 7 in Slot 1 to open the **Properties** window.

8. On the **Parameters** tab, configure the stop mode and control-zero mode functionality, and define fail safe values for the PLC output process data (PZDs).

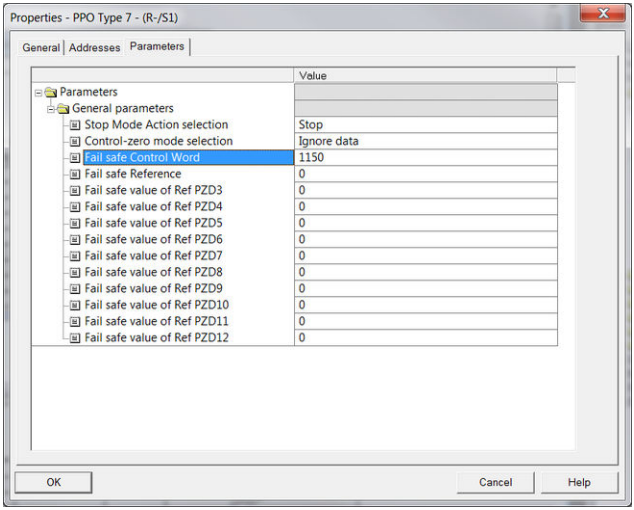

9. Assign the device name (defined in step 6) to the adapter module:
   - In the hardware configuration, click FENA.
   - On the **PLC** menu, select **Ethernet**, and then select **Assign Device Name**.

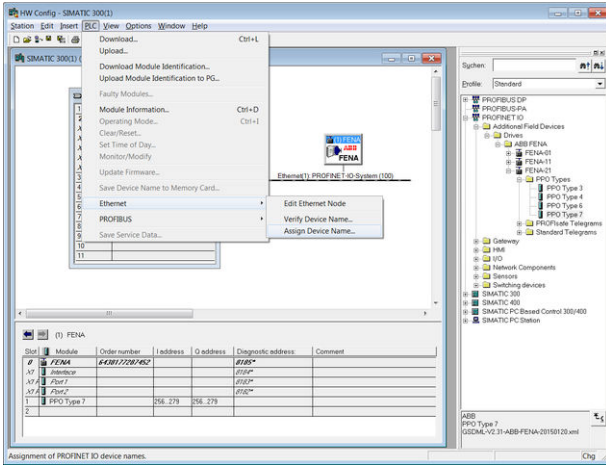

- Click the available device with the correct MAC address to which the device name is to be assigned. This will assign the name to the FENA adapter module. Then click **Assign name**.

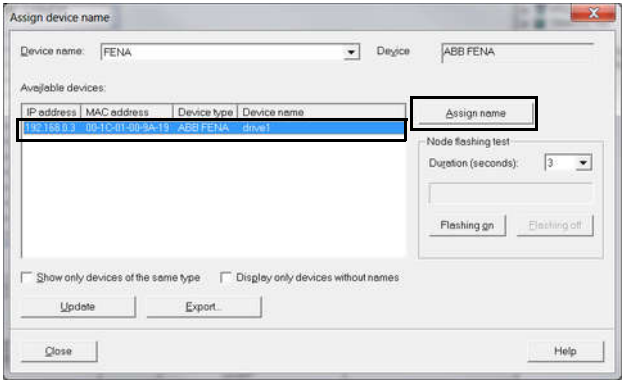

10. Download the hardware configuration to the PLC.

    The PLC is now ready for communication with the adapter module.

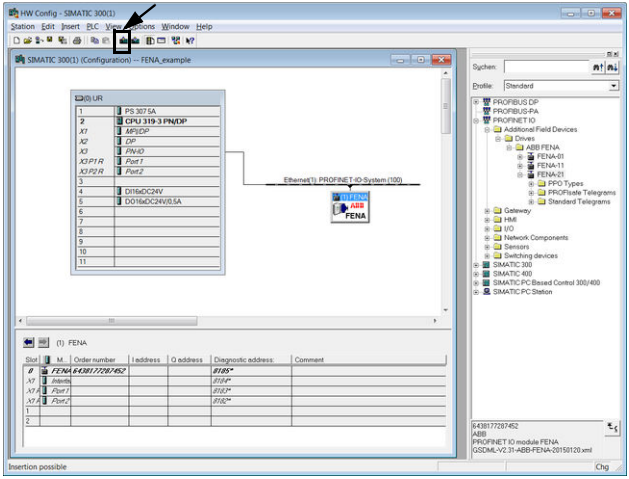

## Configuring a Siemens PLC with TIA14

The example below shows how to configure communication between a Siemens SIMATIC S7 PLC and the adapter module using SIMATIC Manager Step 7.

Before you start, make sure that you have downloaded the FENA-21 GSD file from the Document library.

1. Start TIA14 and create a new project.
2. Change to project view.
3. Install the FENA-21 GSD file.
   - On the **Options** menu, select **Manage general station description files**.
   - Browse for the GSDML file downloaded from the Document library.
   - Select the check box and click **Install**.

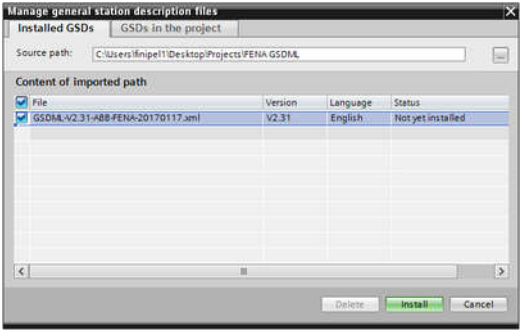

4. Add new device and select CPU from list.

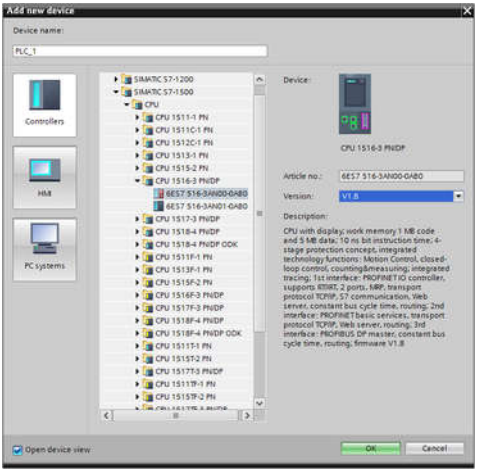


5. Add FENA-21 to device configuration.

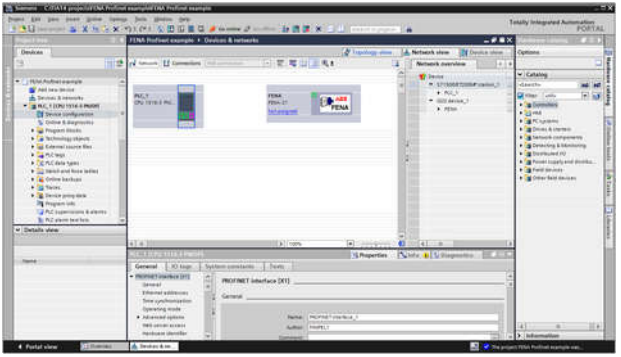

6. Open FENA-21 device view and add desired telegram to slot 1.

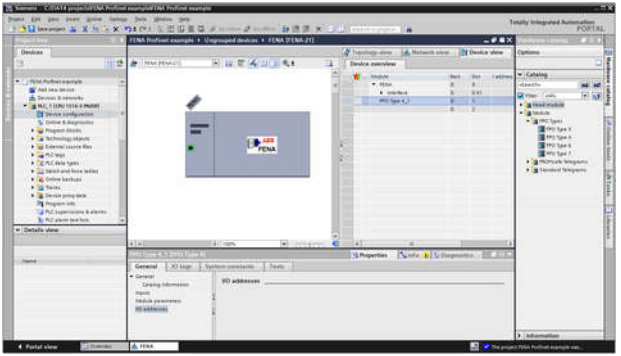

7. Assign FENA-21 to PROFINET controller.

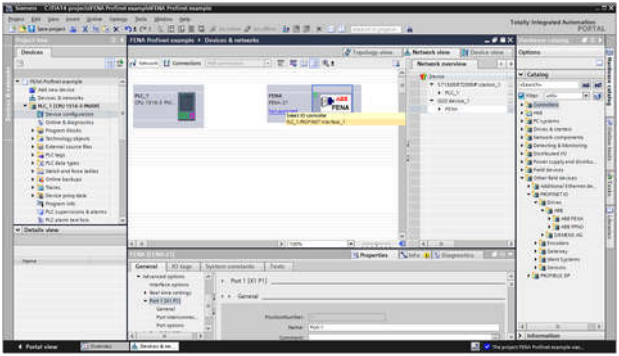

8. In PLC properties, go to **General** tab and select **Ethernet addresses** and then set PLC IP address.

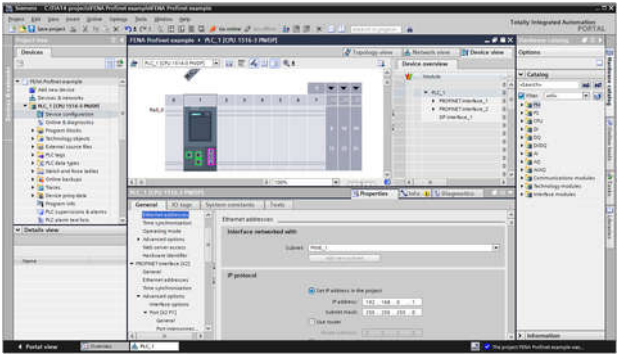

9. In FENA properties, go to **General** tab and select **Ethernet addresses** and then set FENA-21 IP address and PROFINET device name.

- Device name will be used as identification. After successful identification PLC will assign IP address to FENA.

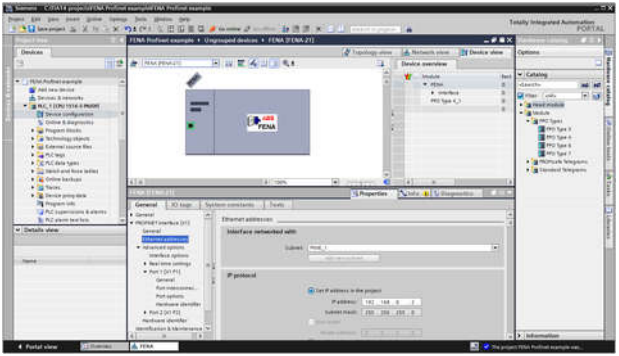

10. Add new function block to the Program blocks ABB_Drive.

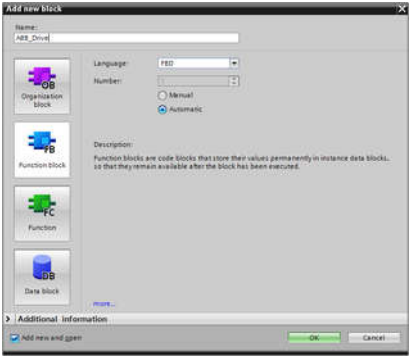

11. Add variables to ABB_Drive FB.

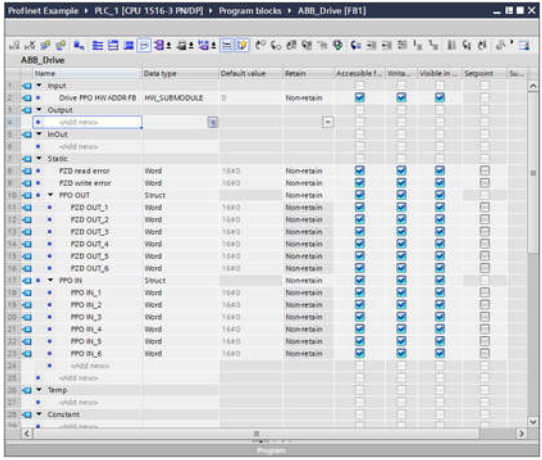


12. Add ABB_Drive to OB1. Assign new instance Data Block for ABB_Drive FB.

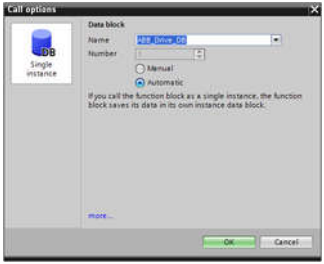

13. Add FPNO PPO HW address to Drive PPO HW ADDR FB input.

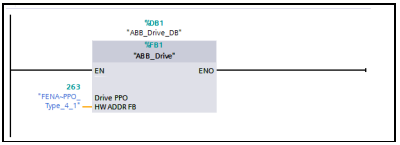


14. Add blocks DPRD_DAT and DPWR_DAT to ABB_Drive FB. Map inputs and outputs.

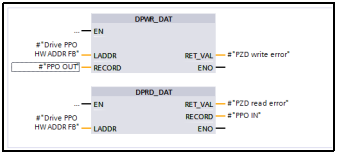


15. Save and download project to PLC.

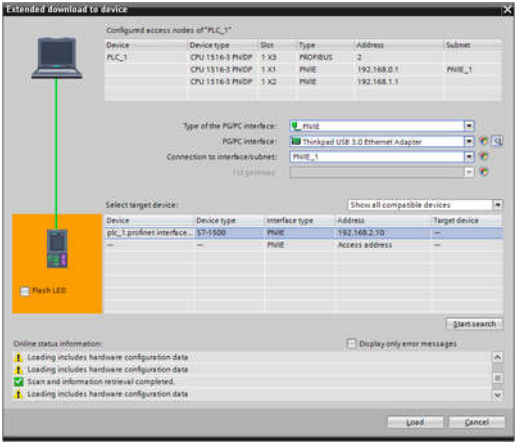

16. In Device configuration, right-click FENA icon and select Assign device name.

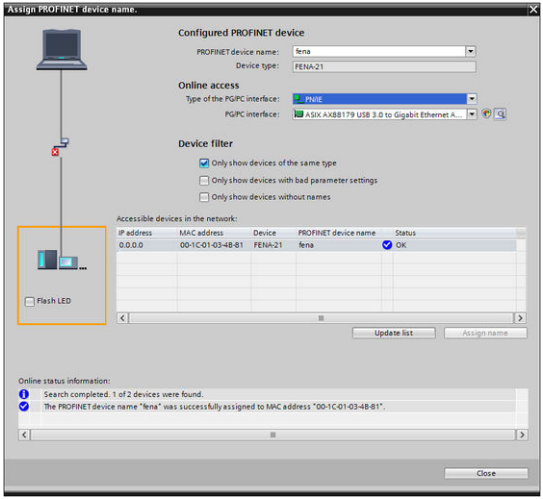


17. Values can now be monitored when online.

## Resetting PROFINET IO device to factory default via S7

You can reset the PROFINET IO device to factory default.

1. In HW configuration go to **PLC** → **Ethernet** → **Edit Ethernet Node**.

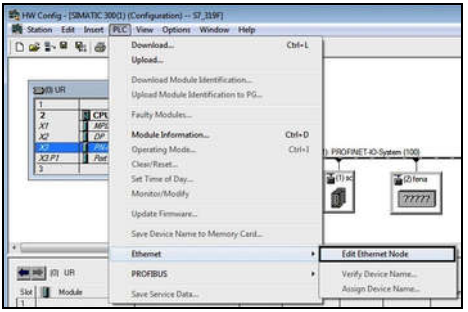


2. In the Edit Ethernet Node window, click **Browse...**.




The list of available devices appear.

3. Select the device that needs to be reset to default. Click **OK**.

4. Click **Reset** to clear configuration.

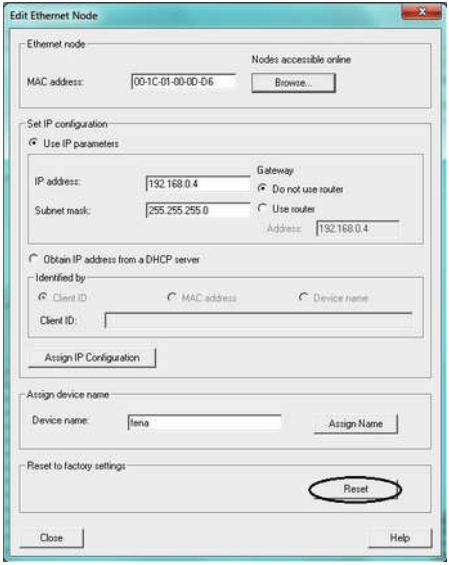


5. A pop-up window appears when reset started. Click **OK**.




The configuration is now reset to default (Profinet IO station name, Ethernet services configuration).

## Media Redundancy Protocol (MRP)

The Media Redundancy Protocol (MRP) network uses the ring topology that includes multiple nodes as shown in the below connection diagram. One of the nodes does the Media Redundancy Manager (MRM) role and the nodes with FENA-21 adapter module(s) does the role of Media Redundancy Clients (MRC). Each node, that is MRM or MRC, consists a pair of ports for connecting in the ring.

For FENA-21 adapter module, the link speed of both the ports are 100 Mbit/s, full duplex.

**Note:** The number of nodes in the ring should not exceed 50 nodes.

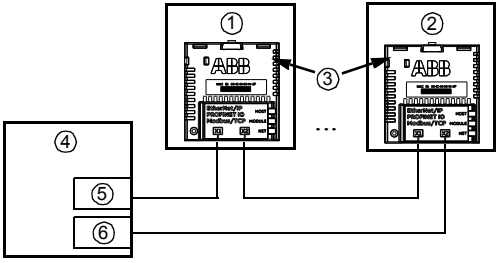


| No. | Description |
|---|---|
| 1 | ABB drive |
| 2 | ABB drive |
| 3 | FENA-21 adapter module |
| 4 | PLC MRM |
| 5 | Port 1 |
| 6 | Port 2 |

## Configuring Media Redundancy Protocol (MRP) with Siemens PLC

You can configure Siemens SIMATIC S7 PLC after setting the basic configuration. For instructions of basic configuration, see section *Configuring the master station* on page *304*.

1. Double-click **PN-IO** in the station window.

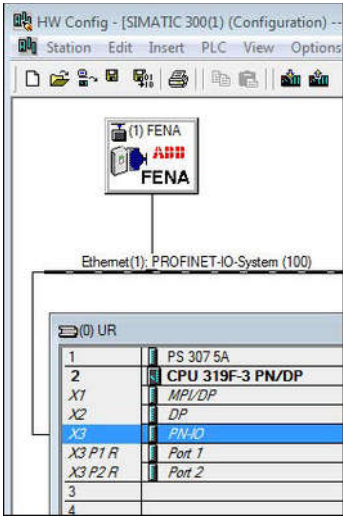


PN-IO properties window is displayed.

2. In the Properties PN-IO window, select **Media Redundancy** tab.

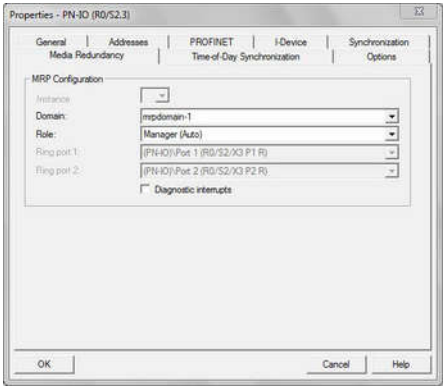


3. From the Role drop-down list, select **Manager (Auto)** role for the PLC and then click **OK**.

4. In the master station window, click **FENA** and then double-click **Interface**.

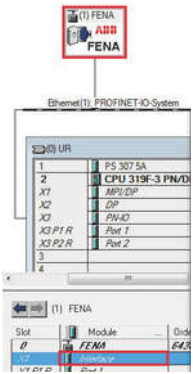

Properties-Interface window is displayed.

5. In the Properties-Interface window, select **Media Redundancy** tab.

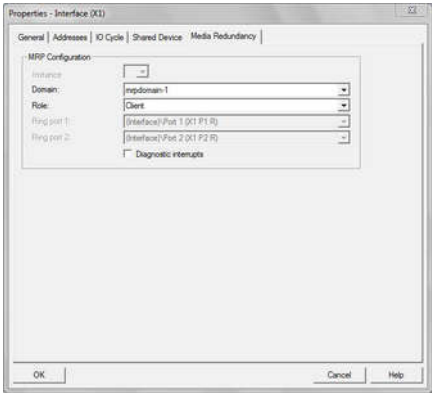


6. From the Role drop-down list, select **Client** role for the FENA adapter module.
7. In the Properties-Interface window, select **IO Cycle** and set watchdog time.

A recommended value for the watchdog time is 200 ms. Make sure that the connection is maintained during the ring break.

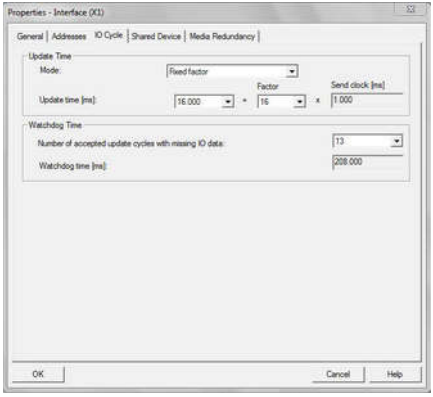


8. In the master station window, right-click on PROFINET IO System and select **PROFINET IO Domain Management**.

The configured devices (PN-IO and FENA) are shown in the Domain management window.

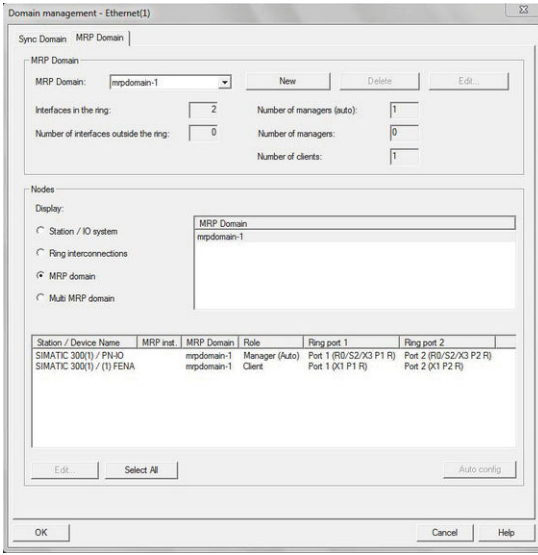

## Configuring a PLC with TIA Portal

To configure a PLC with TIA portal, proceed as follows:

1. In TIA portal Device overview, expand PLC and select the desired **PROFINET interface**.

   PROFINET interface view is displayed.

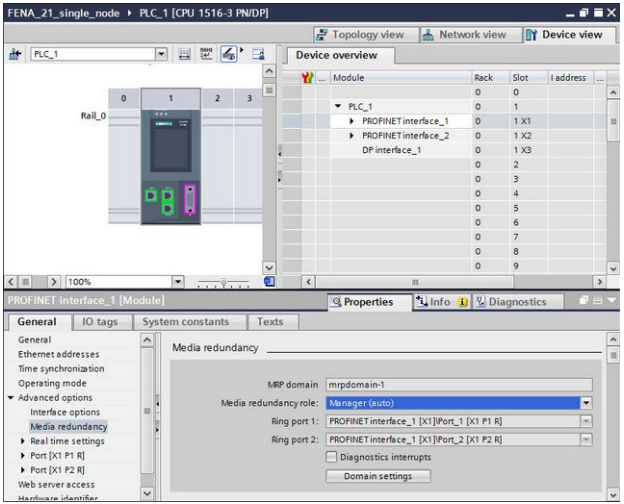


2. In PROFINET interface view, click General tab and select **Media Redundancy** and then select **Manager (auto)** role for the PLC.

3. In the Device overview, expand FENA and select **Interface**.

   PROFINET interface view is displayed.

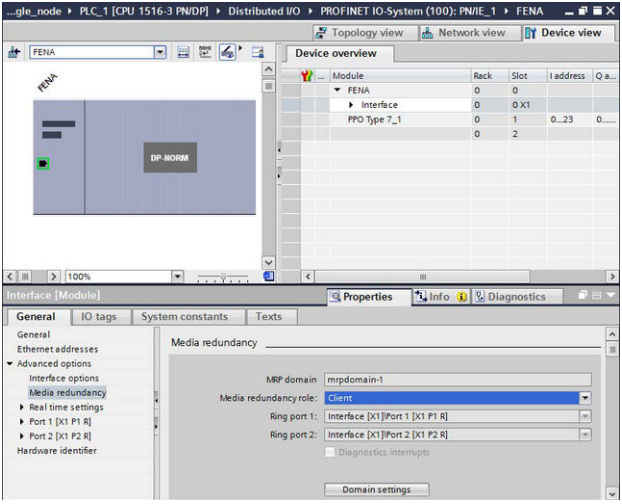


4. In Profinet interface view, click General tab and select **Media Redundancy** and then select **Client** role for the PLC.
5. In the General tab, select **IO cycle** and set watchdog time.

   The recommended value for the watchdog time is 200 ms. Make sure that the connection is maintained during the ring break.

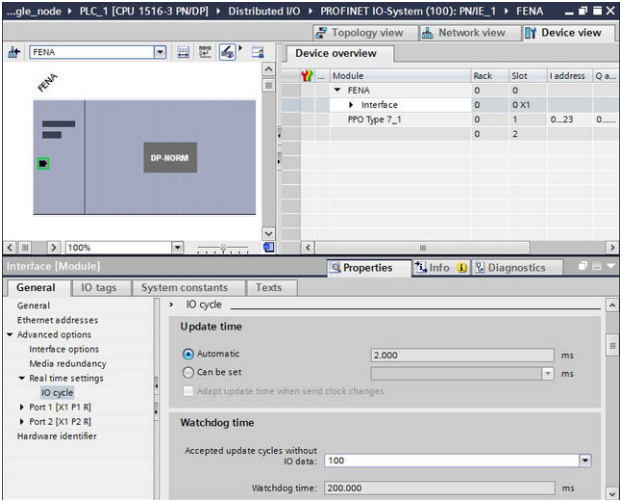


For MRP domain management, go to Media Redundancy view and click **Domain settings** button.

## Shared device

Using Shared Device enable option, you can access one drive from two controllers through one FENA-21 adapter module.

For example, one PLC to control the drive, other Safety PLC for safety communication. The PROFINET drive control and PROFIsafe can be used by separate PLCs.

### Example of shared device configuration for AC500 with Automation Builder

#### Configuring drive control PLC

1. Select PPO telegram to use on slot 1. Leave slot 2 empty.
2. Define PROFINET station name and IP address based on the network.

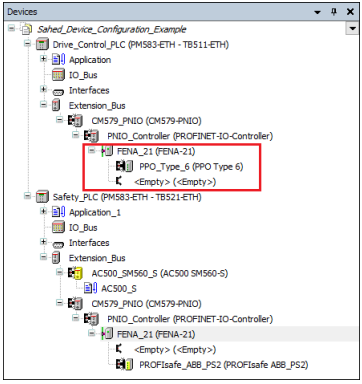

## Configuring safety PLC

1. Select safety telegram to use on slot 2. Leave slot 1 empty.

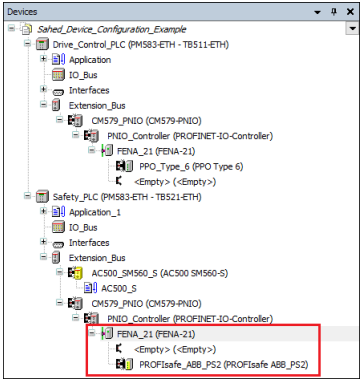


2. Use same PROFINET station name as in drive control PLC configuration.

3. Under **Option** tab, activate **Shared Device** check box.

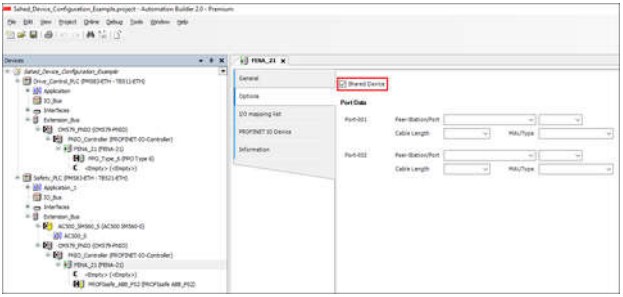

## Example of shared device configuration for TIA

### Configuring drive control PLC

1. Select PPO telegram to use on slot 1. Leave slot 2 empty.
2. Define PROFINET station name and IP address.

### Configuring safety PLC

1. Select safety telegram to use on slot 2. Leave slot 1 empty.
2. Use same PROFINET station name as in drive control PLC configuration.
3. Choose the master from the shared Shared Device tab by changing the master in the Access column.

PPO frame is located in port 1 and safety telegrams are located in port 2.

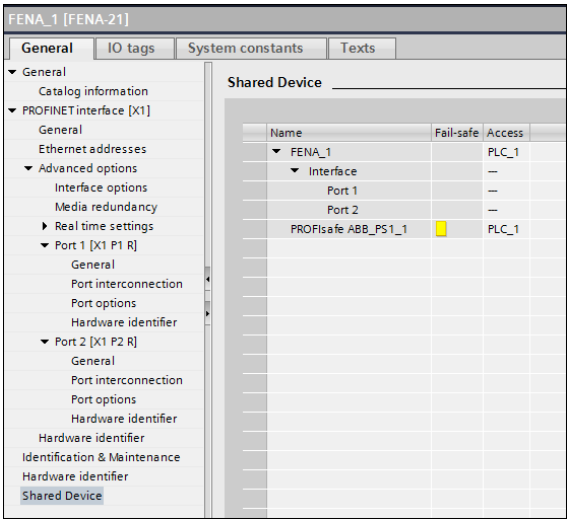

15

# PROFINET IO – Communication profiles

## Contents of this chapter

This chapter describes the communication profiles used in the communication between the PROFINET IO master, the adapter module and the drive.

## Communication profiles

Communication profiles are ways of conveying control commands (Control word, Status word, references and actual values) between the master station and the drive.

With the FENA adapter module, the PROFINET network may employ either the PROFIdrive profile or the ABB Drives profile. Both are converted to the native profile (e.g., DCU or FBA) by the adapter module. In addition, two Transparent modes – for 16-bit and 32-bit words respectively – are available. With the Transparent modes, no data conversion takes place.

The figure below illustrates the profile selection:

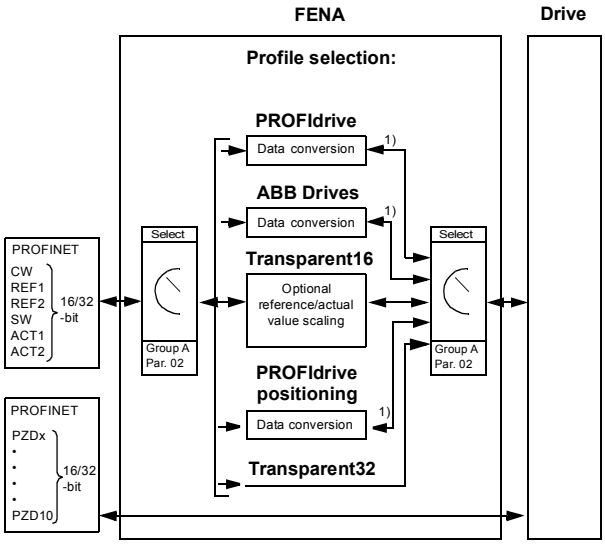


1) Native profile (eg, DCU or FBA)

**Note:** The diagram is applicable only when PPO messaging is used. If Standard Telegrams (ST) are used, the communication profile is selected automatically.

P

The following sections describe the Control word, the Status word, references and actual values for the PROFIdrive and ABB Drives communication profiles. Refer to the drive manuals for details on the native profiles.

# PROFIdrive communication profile

## Control word and Status word

The Control word (PROFIdrive parameter 967) is the principal means for controlling the drive from a fieldbus system. It is sent by the fieldbus master station to the drive through the adapter module. The drive switches between its states according to the bit-coded instructions in the Control word and returns status information to the master in the Status word (PROFIdrive parameter 968).

The contents of the Control word and the Status word are detailed below. See the drive documentation for information on the drive-specific bits. The drive states are presented on page *349*. The drive states for the positioning mode are presented on page *350*.

### Control word contents

The table below shows the contents of the Control word for the PROFIdrive communication profile (PROFIdrive parameter 967). The upper case boldface text refers to the states shown in the state machine on page *349*.

| Bit | Name | Value | STATE/Description | |
|---|---|---|---|---|
| | | | Speed control mode | Positioning mode |
| 0 | ON | 1 | Proceed to **READY TO OPERATE**. | |
| | OFF1 | 0 | Emergency OFF, stop by the selected deceleration ramp. Proceed to **OFF1 ACTIVE;** proceed further to **READY TO SWITCH ON** unless other interlocks (OFF2, OFF3) are active. | |
| 1 | OFF2 | 1 | Continue operation (OFF2 inactive). | |
| | | 0 | Emergency OFF, coast to stop. Proceed to **OFF2 ACTIVE**; proceed further to **SWITCH-ON INHIBIT**. | |

| Bit | Name | Value | STATE/Description | |
|---|---|---|---|---|
| | | | Speed control mode | Positioning mode |
| 2 | OFF3 | 1 | Continue operation (OFF3 inactive). | |
| | | 0 | Emergency stop, stop according to fastest possible deceleration mode. Proceed to **OFF3 ACTIVE**; proceed further to **SWITCH-ON INHIBIT.**<br>**Warning:** Ensure motor and driven machine can be stopped using this stop mode. | |
| 3 | OPERATION_ ENABLE | 1 | Proceed to **ENABLE OPERATION**. | |
| | | 0 | Inhibit operation. Proceed to **OPERATION INHIBIT**. | |
| 4 | ENABLE_ RAMP_ GENERATOR or TRAVERSING _TASK | 1 | Normal operation. Proceed to **RAMP FUNCTION GENERATOR: ENABLE OUTPUT**. | Normal operation. Do not reject traversing task. |
| | | 0 | Stop according to selected stop type. | Reject traversing task. |
| 5 | | 1 | Normal operation. Proceed to **RAMP FUNCTION GENERATOR: ENABLE ACCELERATION**. | Normal operation. No intermediate stop. |
| | | 0 | Halt ramping (Ramp Function Generator output held). | Intermediate stop |

P

| Bit | Name | Value | STATE/Description | |
|---|---|---|---|---|
| | | | Speed control mode | Positioning mode |
| 6 | | 1 | Normal operation. Proceed to **OPERATING**. **Note:** This bit is effective only if the fieldbus interface is set as the source for this signal by drive parameters. | Activate traversing task (0 → 1). This is a toggle bit; each rising edge of signal enables a traversing task or a new set point. |
| | | 0 | Force Ramp Function Generator input to zero. | |
| 7 | RESET | 0 → 1 | Fault reset if an active fault exists. Proceed to **SWITCH-ON INHIBIT.** **Note:** This bit is effective only if the fieldbus interface is set as the source for this signal by drive parameters. | |
| | | 0 | (Continue normal operation) | |
| 8 | JOGGING_1 | | Jogging 1 (Not supported by all drive types) | |
| 9 | JOGGING_2 | | Jogging 2 (Not supported by all drive types) | |
| 10 | REMOTE_ CMD | 1 | Fieldbus control enabled | |
| | | 0 | Control word <> 0 or reference <> 0: Retain last Control word and reference. Control word = 0 and reference = 0: Fieldbus control enabled. | |
| 11 | | 1 | Vendor-specific bit as defined by PROFIdrive parameter 933 | Start homing procedure. |
| | | 0 | | Stop homing procedure. |
| 12 | | | Vendor-specific bit as defined by PROFIdrive parameter 934. As default mapped to Drive Main CW bit 12. | |
| 13 | | | Vendor-specific bit as defined by PROFIdrive parameter 935. As default mapped to Drive Main CW bit 13. | |

| Bit | Name | Value | STATE/Description | |
|---|---|---|---|---|
| | | | Speed control mode | Positioning mode |
| 14 | | | Vendor-specific bit as defined by PROFIdrive parameter 936.<br>As default mapped to Drive Main CW bit 14. | |
| 15 | | | Vendor-specific bit as defined by PROFIdrive parameter 937.<br>As default mapped to Drive Main CW bit 15. | |

### Status word contents

The table below shows the contents of the Status word for the PROFIdrive communication profile (PROFIdrive parameter 968). The upper case boldface text refers to the states shown in the state machine on page *349*.

| Bit | Name | Value | STATE/Description | |
|---|---|---|---|---|
| | | | Speed control mode | Positioning mode |
| 0 | RDY_ON | 1 | **READY TO SWITCH ON** | |
| | | 0 | **NOT READY TO SWITCH ON** | |
| 1 | RDY_RUN | 1 | **READY TO OPERATE** | |
| | | 0 | **OFF1 ACTIVE** | |
| 2 | RDY_REF | 1 | **ENABLE OPERATION** | |
| | | 0 | **OPERATION INHIBIT** | |
| 3 | TRIPPED | 1 | **FAULT** | |
| | | 0 | No fault | |
| 4 | OFF_2_STA | 1 | OFF2 inactive | |
| | | 0 | **OFF2 ACTIVE** | |
| 5 | OFF_3_STA | 1 | OFF3 inactive | |
| | | 0 | **OFF3 ACTIVE** | |
| 6 | SWC_ON_ INHIB | 1 | **SWITCH-ON INHIBIT ACTIVE** | |
| | | 0 | **SWITCH-ON INHIBIT NOT ACTIVE** | |

P

| Bit | Name | Value | STATE/Description | |
|---|---|---|---|---|
| | | | Speed control mode | Positioning mode |
| 7 | ALARM | 1 | Warning/Alarm | |
| | | 0 | No Warning/Alarm | |
| 8 | AT_SETPOINT | 1 | **OPERATING.** Actual value equals reference value (= is within tolerance limits). | |
| | | 0 | Actual value differs from reference value (= is outside tolerance limits). | |
| 9 | REMOTE | 1 | Automation system is requested to assume control. | |
| | | 0 | Control by automation system is not possible. Control is possible only at the device or by another interface. | |
| 10 | | 1 | Actual frequency or speed value equals or is greater than supervision limit. | Target position reached. |
| | | 0 | Actual frequency or speed value is within supervision limit. | Not at target position |
| 11 | | 1 | Mapped to PROFIdrive SW bit 11. | Homing procedure was executed and is valid. |
| | | 0 | Vendor-specific bit as defined by PROFIdrive parameter 939. As default mapped to PROFIdrive SW bit 11. | No valid home position available. |

| Bit | Name | Value | STATE/Description | |
|---|---|---|---|---|
| | | | Speed control mode | Positioning mode |
| 12 | | 1 | Mapped to PROFIdrive SW bit 11.<br>Vendor-specific bit as defined by PROFIdrive parameter 940.<br>As default mapped to PROFIdrive SW bit 12. | Traversing task acknowledgement (0 → 1) |
| | | 0 | | |
| 13 | | 1 | Mapped to PROFIdrive SW bit 11.<br>Vendor-specific bit as defined by PROFIdrive parameter 941.<br>As default mapped to PROFIdrive SW bit 13. | Drive stopped. |
| | | 0 | | Drive moving. Traversing task is executed (n <> 0). |
| 14 | | | Vendor-specific bit as defined by PROFIdrive parameter 942.<br>As default mapped to PROFIdrive SW bit 14. | |
| 15 | | | Vendor-specific bit as defined by PROFIdrive parameter 943 | |

P

## State machine for all operating modes

The general PROFIdrive state machine for all operating modes is shown below.

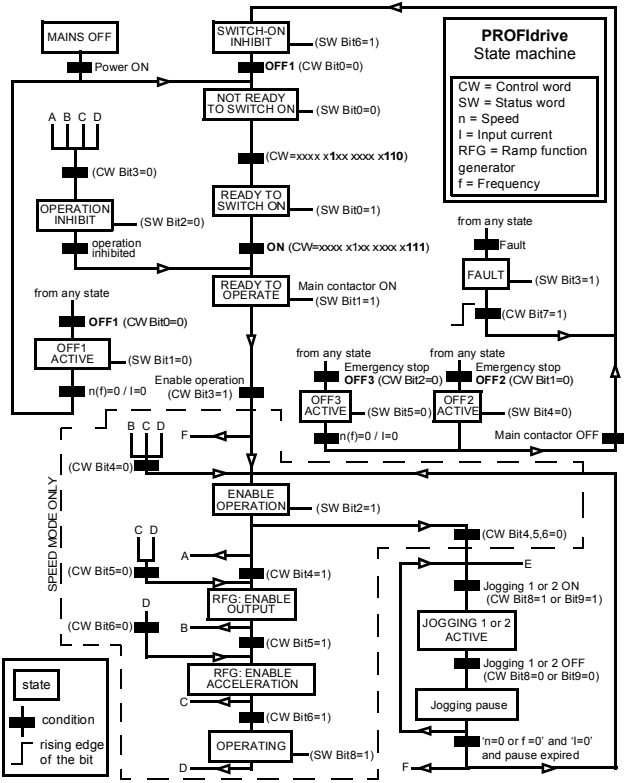

### State machine for the positioning mode

The PROFIdrive state machine for the positioning mode is shown below.

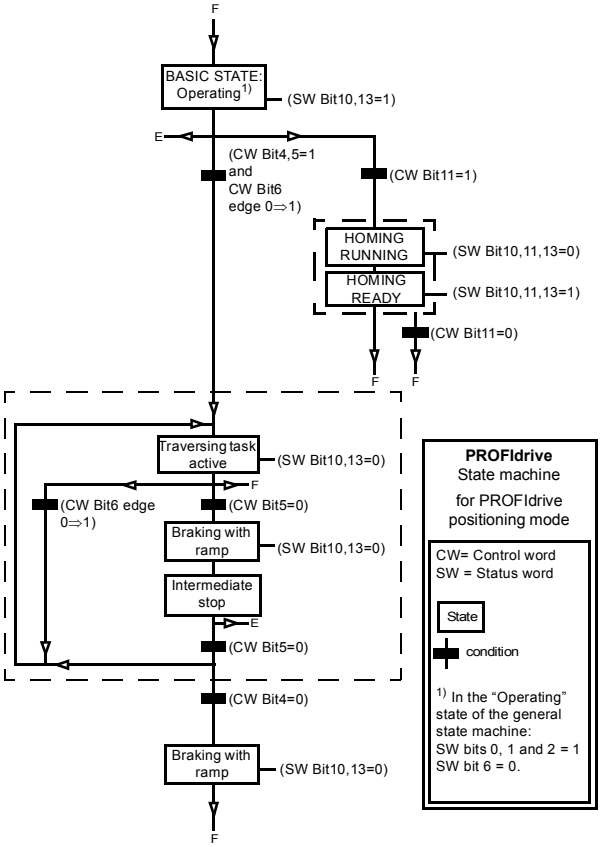

## References

ABB drives can receive control information from multiple sources including analog and digital inputs, the drive control panel and a fieldbus adapter module (for example, FENA). To have the drive controlled through PROFINET, you must select the module as the source for control information, for example, reference.

### References in speed control mode

In the speed control mode, references are 16-bit or 32-bit words containing a sign bit and a 15-bit or 31-bit integer. A negative reference (indicating reversed direction of rotation) is formed by calculating the two's complement from the corresponding positive reference.

A 16-bit speed reference (REF or NSOLL_A) in hexadecimal (0…4000h) corresponds to 0…100% of Maximum Reference (as defined with a drive parameter).

A 32-bit speed reference (NSOLL_B) in hexadecimal (0…4000 0000h) corresponds to 0…100% of Maximum Reference (as defined with a drive parameter).

### References in positioning mode (ACSM1 only)

In the positioning mode, references are 16-bit or 32-bit words. A 32-bit reference contains a sign bit and a 31-bit integer. A negative reference (indicating reversed direction of rotation) is formed by calculating the two's complement from the corresponding positive reference.

For a 32-bit position reference (XSOLL_A), the unit and scaling are defined with drive parameters (for example, POS UNIT, POS2INT SCALE and FEED CONST).

For a 32-bit velocity reference (VELOCITY_A), the unit and scaling are defined with drive parameters (for example, POS SPEED UNIT and POS SPEED2INT).

## Actual values

Actual values are 16-bit or 32-bit words containing information on the operation of the drive. The functions to be monitored are selected with a drive parameter.

### Actual values in speed control mode

The scaling of 16-bit actual speed values (ACT or NIST_A) in hexadecimal (0…4000h) corresponds to 0…100% of the maximum reference (as defined with a drive parameter, for example, speed scaling in ACSM1, ACS850, ACQ810, ACS480, ACS580 and ACS880, and external reference in ACS355).

The scaling of 32-bit actual speed values (NIST_B) in hexadecimal (0…4000 0000h) corresponds to 0…100% of the maximum reference (as defined with a drive parameter, for example, speed scaling in ACSM1, ACS850, ACQ810, ACS480, ACS580 and ACS880, and external reference in ACS355).

### Actual values in positioning mode (ACSM1 only)

For a 32-bit actual position value (XIST_A), the unit and scaling are defined with drive parameters (for example, POS UNIT, POS2INT SCALE and FEED CONST).

# ABB Drives communication profile

## Control word and Status word

The Control word is the principal means for controlling the drive from a fieldbus system. It is sent by the fieldbus master station to the drive through the adapter module. The drive switches between its states according to the bit-coded instructions in the Control word and returns status information to the master in the Status word.

The contents of the Control word and the Status word are detailed below. The drive states are presented on page *357*.

### Control word contents

The table below shows the contents of the Control word for the ABB Drives communication profile. The upper case boldface text refers to the states shown on page *357*.

| Bit | Name | Value | STATE/Description |
|---|---|---|---|
| 0 | OFF1_ CONTROL | 1 | Proceed to **READY TO OPERATE**. |
| | | 0 | Stop along currently active deceleration ramp. Proceed to **OFF1 ACTIVE**; proceed to **READY TO SWITCH ON** unless other interlocks (OFF2, OFF3) are active. |
| 1 | OFF2_ CONTROL | 1 | Continue operation (OFF2 inactive). |
| | | 0 | Emergency OFF, coast to stop. Proceed to **OFF2 ACTIVE**, proceed to **SWITCH-ON INHIBITED**. |
| 2 | OFF3_ CONTROL | 1 | Continue operation (OFF3 inactive). |
| | | 0 | Emergency stop, stop within time defined by drive parameter. Proceed to **OFF3 ACTIVE**; proceed to **SWITCH-ON INHIBITED**. **Warning:** Ensure that motor and driven machine can be stopped using this stop mode. |

| Bit | Name | Value | STATE/Description |
|---|---|---|---|
| 3 | INHIBIT_ OPERATION | 1 | Proceed to **OPERATION ENABLED**.<br>**Note:** Run enable signal must be active; see drive documentation. If the drive is set to receive the Run enable signal from the fieldbus, this bit activates the signal. |
| | | 0 | Inhibit operation. Proceed to **OPERATION INHIBITED**. |
| 4 | RAMP_OUT_ ZERO | 1 | Normal operation. Proceed to **RAMP FUNCTION GENERATOR: OUTPUT ENABLED**. |
| | | 0 | Force Ramp Function Generator output to zero. Drive ramps to stop (current and DC voltage limits in force). |
| 5 | RAMP_HOLD | 1 | Enable ramp function.<br>Proceed to **RAMP FUNCTION GENERATOR: ACCELERATOR ENABLED**. |
| | | 0 | Halt ramping (Ramp Function Generator output held). |
| 6 | RAMP_IN_ ZERO | 1 | Normal operation. Proceed to **OPERATION**.<br>**Note:** This bit is effective only if the fieldbus interface is set as the source for this signal by drive parameters. |
| | | 0 | Force Ramp Function Generator input to zero. |
| 7 | RESET | 0 → 1 | Fault reset if an active fault exists. Proceed to **SWITCH-ON INHIBITED**.<br>**Note:** This bit is effective only if the fieldbus interface is set as the source for this signal by drive parameters. |
| | | 0 | Continue normal operation. |
| 8…9 | Reserved | | |

P

| Bit | Name | Value | STATE/Description |
|---|---|---|---|
| 10 | REMOTE_CMD | 1 | Fieldbus control enabled |
| | | 0 | Control word and reference not getting through to the drive, except for CW bits OFF1, OFF2 and OFF3. |
| 11 | EXT_CTRL_LOC | 1 | Select External Control Location EXT2. Effective if control location parameterized to be selected from fieldbus. |
| | | 0 | Select External Control Location EXT1. Effective if control location parameterized to be selected from fieldbus. |
| 12… 15 | Drive-specific (For information, see the drive documentation.) | | |

### Status word contents

The table below shows the contents of the Status word for the ABB Drives communication profile. The upper case boldface text refers to the states shown on page *357*.

| Bit | Name | Value | STATE/Description |
|---|---|---|---|
| 0 | RDY_ON | 1 | **READY TO SWITCH ON** |
| | | 0 | **NOT READY TO SWITCH ON** |
| 1 | RDY_RUN | 1 | **READY TO OPERATE** |
| | | 0 | **OFF1 ACTIVE** |
| 2 | RDY_REF | 1 | **OPERATION ENABLED** |
| | | 0 | **OPERATION INHIBITED** |
| 3 | TRIPPED | 1 | **FAULT** |
| | | 0 | No fault |
| 4 | OFF_2_STA | 1 | OFF2 inactive |
| | | 0 | **OFF2 ACTIVE** |
| 5 | OFF_3_STA | 1 | OFF3 inactive |
| | | 0 | **OFF3 ACTIVE** |
| 6 | SWC_ON_INHIB | 1 | **SWITCH-ON INHIBITED** |
| | | 0 | – |

| Bit | Name | Value | STATE/Description |
|---|---|---|---|
| 7 | ALARM | 1 | Warning/Alarm |
| | | 0 | No warning/alarm |
| 8 | AT_SETPOINT | 1 | **OPERATION.** Actual value equals reference (= is within tolerance limits, i.e., in speed control, speed error is 10% max. of nominal motor speed). |
| | | 0 | Actual value differs from reference (= is outside tolerance limits). |
| 9 | REMOTE | 1 | Drive control location: REMOTE (EXT1 or EXT2) |
| | | 0 | Drive control location: LOCAL |
| 10 | ABOVE_ LIMIT | 1 | Actual frequency or speed equals or exceeds supervision limit (set by drive parameter). Valid in both directions of rotation. |
| | | 0 | Actual frequency or speed within supervision limit |
| 11 | EXT_CTRL_ LOC | 1 | External Control Location EXT2 selected. **Note concerning ACS880:** This bit is effective only if the fieldbus interface is set as the target for this signal by drive parameters. User bit 0 selection (06.33) |
| | | 0 | External Control Location EXT1 selected |
| 12 | EXT_RUN_ ENABLE | 1 | External Run Enable signal received. **Note concerning ACS880:** This bit is effective only if the fieldbus interface is set as the target for this signal by drive parameters. User bit 1 selection (06.34) |
| | | 0 | No External Run Enable signal received |
| 13… 14 | Drive-specific (For information, see the drive documentation.) | | |
| 15 | FBA_ERROR | 1 | Communication error detected by fieldbus adapter module |
| | | 0 | Fieldbus adapter communication OK |

P

## State machine

The state machine for the ABB Drives communication profile is shown below.

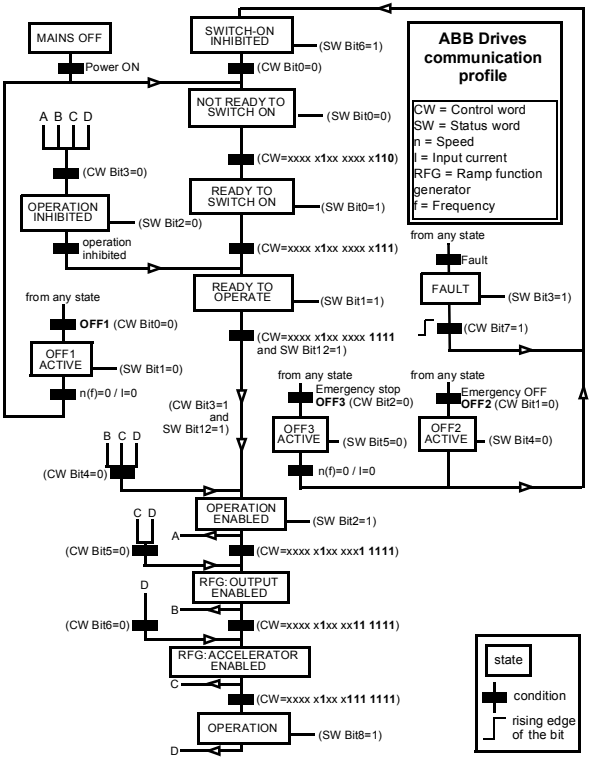


P

## References

References are 16-bit words containing a sign bit and a 15-bit integer. A negative reference (indicating reversed direction of rotation) is formed by calculating the two's complement from the corresponding positive reference.

ABB drives can receive control information from multiple sources including analog and digital inputs, the drive control panel and a fieldbus adapter module (for example, FENA). To have the drive controlled through the fieldbus, you must select the module as the source for control information, for example, reference.

### Scaling

References are scaled as shown below.

**Note:** The values of REF1 MAX and REF2 MAX are set with drive parameters. See the drive manuals for further information.

In ACSM1, ACS850, ACQ810, ACS480, ACS580 and ACS880, the speed reference (REFx) in decimal (0…20000) corresponds to 0…100% of the speed scaling value (as defined with a drive parameter).

In ACS355, drive parameter REFx MIN may limit the actual minimum reference.

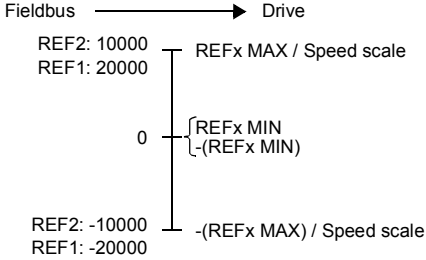


P

## Actual values

Actual values are 16-bit words containing information on the operation of the drive. The functions to be monitored are selected with a drive parameter.

### Scaling

Actual values are scaled as shown below.

**Note:** The values of REF1 MAX and REF2 MAX are set with drive parameters. See the drive manuals for further information.

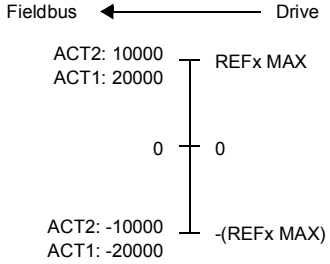

16

# PROFINET IO – Communication protocol

## Contents of this chapter

This chapter describes the PROFINET IO communication protocol for the adapter module. For detailed information on PROFINET IO communication, refer to *PROFINET specification Application Layer protocol for decentralized periphery and distributed automation v2.0*.

## PROFINET IO

PROFINET IO is a fieldbus protocol that enables communication between programmable controllers and distributed field devices in an Ethernet network. The protocol classifies devices into I/O controllers, I/O supervisors and I/O devices, which have a specific collection of services.

PROFINET IO uses three different communication channels to exchange data:

- The standard UDP/IP and TCP/IP channel is used for parameterization and configuration of devices and for acyclic operations.
- The real time (RT) channel is used for cyclic data transfer and alarms.
- The isochronous real time (IRT) channel is used, for example, in motion control applications (not implemented in FENA).

PROFINET IO devices are structured in slots and sub-slots, which can contain modules and sub-modules correspondingly. A device can have almost any number of slots and sub-slots, and they can be virtual or real. Device-specific data is represented in slot 0; module-specific and sub-module-specific data in subsequent slots and sub-slots.

One of the benefits of PROFINET IO is the diagnostics and alarm mechanism. Every module and sub-module provide alarm data to the I/O controller using the cyclic channel. Diagnostic data can be read non-cyclically from the device by using record data.

The properties and services of a PROFINET IO device are described in a GSD file written in GSDML (General Station Description Markup Language). The GSD file describes the device-specific modules and the method of assigning modules and sub-modules to predefined slots and sub-slots. For more information, see section *Downloading the GSD file* on page *304*.

## PROFINET network settings

In PROFINET, network devices are identified with station names. The controller uses DCP (Discovery and Configuration protocol) to find devices with configured names from the network. Device with the given name responds with an Identity response which also contains the current IP address of the device.

If the current IP address differs from the address in the hardware configuration of the controller, the controller sets the device with a new IP address according to the configuration. This IP is set as temporary, which means that after reboot of the device, the IP address will be 0.0.0.0 as specified in the PROFINET standard.

The recommended IP setting for PROFINET is Static IP and address is 0.0.0.0. With this setting, there is need to configure the IP in only one place (hardware configuration) and this avoids any IP conflicts among the devices.

## PROFINET IO in FENA

When PROFINET IO is selected as the communication protocol, the FENA adapter module can employ the ABB Drives, Transparent 16 and Transparent 32 communication profiles or the PROFIdrive profile. You can select the profile via FPNO-21 configuration parameter *02 Protocol/Profile*. You can select the appropriate device access point (DAP) and functional module with the tool as well.

Slot 0 has a sub-slots, and the DAP module attached to it represents the device itself. The following sub-slots are available:

- sub-slot 0x0001 is DAP
- sub-slot 0x8000 is interface sub module
- sub-slot 0x8001 is port 1
- sub-slot 0x8002 is port 2

Slot 1 and its sub-slots support other functional modules and sub-modules described in the GSD file. The following sub-slots are available.

1. For PPO types
   - sub-slot 0x0001 is the telegram
2. For Standard telegrams
   - sub-slot 0x0001 is the Module Access point
   - sub-slot 0x0002 is the telegram

Slot 2 is used for ProfiSafe

- sub-slot 0x0001 is ProfiSafe telegram

The adapter module provides the following services:

- Cyclic messaging.
- Acyclic parameter access mechanism.
- Identification & Maintenance functions (I&M).
- PROFIdrive parameters (limited in the ABB Drives and Transparent profiles).
- Diagnostic and alarm mechanism (only with the PROFIdrive profile).
- Fault buffer mechanism (limited in the ABB Drives and Transparent profiles).
- Media Redundancy Protocol (MRP).
- Shared Device.
- Network Diagnostic (SNMP).
- Topology information (LLDP) with LLDP-MIB.

# Cyclic message types

## PPO types

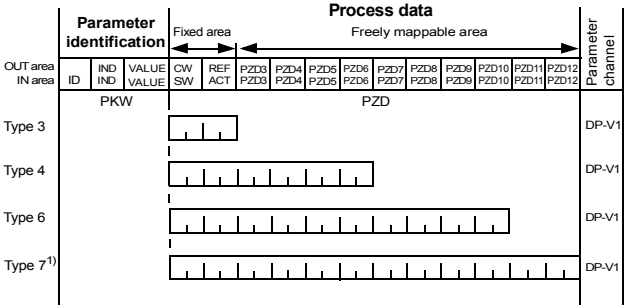


**OUT area** – Data sent from master to slave (control data)
**IN area** – Data sent from slave to master (actual data)
**Parameter identification:**
ID – Parameter identification
IND – Index for arrays
VALUE – Parameter value (Max. 4 bytes)
PKW – Parameter ID/value
**Process data:**
CW – Control word
SW – Status word
REF – Reference
ACT – Actual value
PZD – Process data (application-specific)
DW – Data word

1) Not supported by ACS355 drives

P

## Standard telegram (ST) types (DP-V1)

**ST1**

| | PZD1 | PZD2 |
|---|---|---|
| **OUT area** | STW1<br>Control word 1 | NSOLL_A<br>Speed set point A |
| **IN area** | ZSW1<br>Status word 1 | NIST_A<br>Speed actual value A |

**ST2**

| | PZD1 | PZD2…3 | PZD4 |
|---|---|---|---|
| **OUT area** | STW1<br>Control word 1 | NSOLL_B<br>Speed set point B | STW2<br>Control word 2 |
| **IN area** | ZSW1<br>Status word 1 | NIST_B<br>Speed actual value B | ZSW2<br>Status word 2 |

**Note:** For the contents of the Control word, the Status word, references and actual values, see chapter *PROFINET IO – Communication profiles*.

## Parameter handling using acyclic parameter access mechanism (DP-V1)

PROFINET IO offers record read and write services for the acyclic parameter access mechanism. When the drive parameters or FENA parameters are accessed, the corresponding slot, sub-slot and index are set, and a PROFIdrive DP-V1 message is placed on the data block of the record read or write frame.

## Header and frame structures

PROFINET IO uses the DCE RPC (Distributed Computing Environment Remote Procedure Call) protocol for acyclic read and write services. I/O controllers and supervisors take care of formulating most of the request frames. However, it is possible that handling the PROFIdrive request and response headers must be performed in the application logic. The acyclic frame structure, headers and error codes are described further below.

| Frames | Dest addr. | Src addr. | Ether type | IP UDP | RPC | NDR | Read or Write | Data |
|---|---|---|---|---|---|---|---|---|
| Bytes | 6 | 6 | 2 | 28 | 80 | 20 | 64 | … |

**Dest addr.** and **Src addr.** are the destination and the source of the communication relationship. The addresses are in hexadecimal format, for example, 00-30-11-02-57-AD.

**Ether type** is 0x800 for non-real-time communication.

**IP** and **UDP** fields contain the IP address of the source and the destination as well as the communication ports and length of the message.

**RPC** contains, for example, the read or write service ID, interface description and selected objects.

**NDR** request block describes the length of the following data block. The response block also contains bytes ErrorCode, ErrorDecode, ErrorCode1 and ErrorCode2 for presenting the status of the request. The response error codes are listed in the table below.

| Byte | Value and meaning |
|---|---|
| ErrorCode | 0xDF (Error Write) |
| | 0xDE (Error Read) |
| ErrorDecode | 0x80 (PNIORW) ErrorCode1 decoded as shown in section *ErrorCode1* on page *369*. ErrorCode2 is 0. |
| | 0x81 (PNIO) ErrorCode1 and ErrorCode2 decoded as shown in section *ErrorCode1* on page *369*. |
| ErrorCode1 | Error class and error code. See section *ErrorCode1* on page *369*. |
| ErrorCode2 | Not described here |

**ErrorCode1**

The table below lists the ErrorCode1 with PNIORW decoding.




| Error class | Meaning | Error code |
|---|---|---|
| 0…9 | (Reserved) | |
| 10 (0x0A) | Application | 0 = Read error<br>1 = Write error<br>2 = Module failure<br>3…7 = Reserved<br>8 = Version conflict<br>9 = Feature not supported<br>10…15 = User-specific |
| 11 (0x0B) | Access | 0 = Invalid index<br>1 = Write length error<br>2 = Invalid slot<br>3 = Type conflict<br>4 = Invalid area<br>5 = State conflict<br>6 = Access denied<br>7 = Invalid range<br>8 = Invalid parameter<br>9 = Invalid type<br>10…15 = User-specific |
| 12 (0x0C) | Resource | 0 = Read constraint conflict<br>1 = Write constraint conflict<br>2 = Resource busy<br>3 = Resource unavailable<br>4…7 = Reserved<br>8…15 = User-specific |
| 13…15 | User-specific | |

## DP-V1 read/write request sequence

A read/write service on a drive parameter is illustrated below.

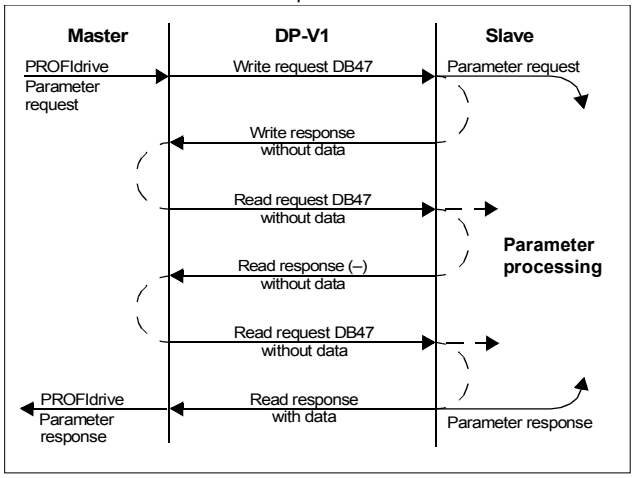


The messaging employs DP-V1 data units. The PROFIdrive parameter request is included within the DP-V1 request as data. Likewise, the DP-V1 response contains the PROFIdrive parameter response as data.

A write request is first sent containing the parameter request. If the write request is valid, the adapter module acknowledges it with a DP-V1 write response with no data. The master will then send a read request. If the adapter module is still busy performing the internal parameter request, it will return a negative response with the DP-V1 error code B5h (State conflict). In this case, the master will repeat the read request until the adapter module has the PROFIdrive response data ready.

If the write request is invalid, a negative response is returned with a DP-V1 error code (see section *ErrorCode1* on page *369*).

### Read and write blocks

A read block is used in read requests and responses, while a write block is used in write requests and responses. A request consists of unique identifiers for the connection, addressing information and the length of the record data. A response also contains two additional fields for transferring information.

The table below shows the structure of the read and write blocks in detail.

| Field(s) | Description | Range | Type |
|---|---|---|---|
| Service | Request or Response service | Request (0x00)<br>Response (0x80) | UI8 |
| Operation | Read or Write operation | Write (0x08)<br>Read (0x09) | UI8 |
| Block length | Length of the block | 0…0xFFFF | UI16 |
| ARUUID | Identifier<br>• time low<br>• time mid<br>• time high and version<br>• clock<br>• node | | <br>UI32<br>UI16<br>UI16<br>Octet[2]<br>Octet[6] |
| API | Application process identifier | Device access point (0x0000)<br>PROFIdrive (0x3A00) | UI32 |
| Slot | Slot of the module access point (MAP/PAP) | 0x01 | UI16 |
| Subslot | Subslot of the module access point (MAP/PAP) | 0x01 | UI16 |
| Padding | 2 bytes | | |
| Index | Index of the record data object | 0x2F<br>0xB02E<br>0xB02F | UI16 |
| Data length | Length of the data block | 0…0xFFFFFFFF | UI32 |

| Field(s) | Description | Range | Type |
|---|---|---|---|
| Additional value 1 **(response only)** | Field for transferring additional data | | UI16 |
| Additional value 2 **(response only)** | Field for transferring additional data | | UI16 |
| Padding | 24 bytes for request, 20 bytes for response. | | |
| Data block | Used only with write request and read response. | | |

### Data block

The data block contains a PROFIdrive-specific request or response header.

The table below shows the contents of the PROFIdrive request.

| Field(s) | Description | Range | Byte/ Word |
|---|---|---|---|
| Request Reference | Unique identification set by the master. Changed for each new request. | 1…255 | Byte |
| Request ID | Request type for the issued block | Request Parameter (01h) Change Parameter (02h) | Byte |
| Drive Object ID | To be set to 0 or 1. | 0…255 | Byte |
| No. of Parameters | Number of the parameters that are present in the request | 1…37 | Byte |
| Attribute | Type of the object being accessed. **Note:** “Description” and “Text” are not supported. | Value (10h) Description (20h) Text (30h) | Byte |
| No. of Elements | Number of the array elements accessed or length of the string accessed. Set to 0 if non-array parameters are used. | 0, 1…234 | Byte |

P

| Field(s) | Description | Range | Byte/ Word |
|---|---|---|---|
| Parameter Index | Address of the parameter that is being accessed. “0” is allowed by FENA. | 1…65535 | Word |
| Subindex | Addresses<br>• the first array element of the parameter or<br>• the beginning of a string access or<br>• the text array or<br>• the description element that is being accessed | 0…65535 | Word |
| Format[1)] | See the table on page *375*. | See the table on page *375*. | Byte |
| Number of Values[1)] | Number of the values following | 0…234 | Byte |
| Values[1)] | The values of the request. In case of an odd number of bytes, a zero byte is appended to ensure the word structure of the telegram. | – | See the *Format* field. |

[1)] Only if Request ID is 02h (Change Parameter). The Format, Number of Values and Values fields are repeated for other parameters.

The table below shows the contents of the PROFIdrive response.

| Field(s) | Description | Range |
|---|---|---|
| Request Reference (mirrored) | Mirrored from the request. | 1…255 |
| Response ID | Response from the slave. In case any requested services fail, a “not acknowledged” (NAK) response will be indicated. | Request Param OK (01h)<br>Request Param NAK (81h)<br>Change Param OK (02h)<br>Change Param NAK (82h) |
| Drive Object ID | To be set to 1. | 0…255 |
| No. of Parameters | Number of the parameters that are present in the response | 1…37 |
| Format[1)] | See the table on page 375. | See the table on page 375. |
| Number of Values[1)] | Number of the values following | 0…234 |
| Values[1)] | The values of the request. In case of an odd number of bytes, a zero byte is appended to ensure the word structure of the telegram. | – |

[1)] Only if Response ID is 01h (Request Parameter OK). The Format, Number of Values and Values fields are repeated for other parameters.

The table below shows the data types for the *Format* field in the PROFIdrive response.

| Code | Type |
|---|---|
| 0x00 | (Reserved) |
| 0x01…0x36 | Standard data types<br>1 Boolean (not supported)<br>2 Integer8 (not supported)<br>3 Integer16<br>4 Integer32<br>5 Unsigned8 (not supported)<br>6 Unsigned16<br>7 Unsigned32<br>8 Floating point (not supported)<br>9 Visible string (not supported)<br>• • • |
| 0x37…0x3F | (Reserved) |
| 0x40 | Zero |
| 0x41 | Byte |
| 0x42 | Word |
| 0x43 | Double word |
| 0x44 | Error |
| 0x45…0xFF | (Reserved) |

The table below shows the PROFIdrive parameter request error codes.

| Error # | Meaning | Used at |
|---|---|---|
| 00h | Impermissible parameter number | Access to an unavailable parameter |
| 01h | Parameter value cannot be changed | Change access to a parameter value that cannot be changed |
| 02h | Low or high limit exceeded | Change access with a value outside the limits |
| 03h | Invalid subindex | Access to an unavailable subindex |
| 04h | No array | Access with a subindex to a non-indexed parameter |
| 05h | Incorrect data type | Change access with a value that does not match the data type of the parameter |
| 06h | Setting not permitted (can only be reset) | Change access with a value unequal to 0 when this is not permitted |
| 07h | Description element cannot be changed | Change access to a description element that cannot be changed |
| 09h | No description data available | Access to an unavailable description (parameter value is available) |
| 0Bh | No operation priority | Change access rights without rights to change parameters |
| 0Fh | No text array available | Access to a text array that is not available (Parameter value is available.) |
| 11h | Request cannot be executed because of operating mode | Access is temporarily not possible for reasons that are not specified in detail. |
| 14h | Value impermissible | Change access with a value that is within limits but is not permissible for other long-term reasons (parameter with defined single values) |
| 15h | Response too long | The length of the current response exceeds the maximum transmittable length. |

| Error # | Meaning | Used at |
|---|---|---|
| 16h | Parameter address impermissible | Illegal value or value that is not supported for the attribute, number of elements, parameter number or sub-index, or a combination |
| 17h | Illegal format | Write request: Illegal format or format of parameter data that is not supported |
| 18h | Number of values inconsistent | Write request: Number of values of the parameter data does not match the number of elements at the parameter address. |
| 65h…FF | Manufacturer-specific error area | – |
| 65h | Vendor-specific error | Vendor-specific error |
| 66h | Request not supported | Request not supported |
| 67h | Communication error | Request cannot be completed because of a communication error. |
| 6Eh | Non-volatile error | Failure during write to non-volatile memory |
| 6Fh | Time-out error | Request aborted because of a timeout. |
| 78h | PZD map failure | Parameter cannot be mapped to PZD (size mismatch or non-existent). |
| 79h | PZD memory failure | Parameter cannot be mapped to PZD (out of memory). |
| 7Ah | Multiple PZD map | Parameter cannot be mapped to PZD (multiple PZD write). |
| 82h | Control word bit map | Cannot map Control word bit (parameter 933…937, e.g., double mapping of bits). |
| 8Ch | Set torque mode error | Cannot change mode to TORQUE (frequency is used). |
| 90h | Illegal Request ID | The request ID of the response is illegal. |

| Error # | Meaning | Used at |
|---|---|---|
| 96h | Internal buffer | Buffer overflow |
| A0h | Internal communication | Communication error between the module and the drive |

## Function blocks for sending DP-V1 messages (Siemens S7)

In IEC 61131-3 compatible systems, function blocks are available for accessing data non-cyclically. In Siemens S7, SFB 52 "RDREC" can be used for reading and SFB53 "WRREC" for writing data records as follows:

- On INDEX: Connect the value 0xB02F, 0xB02E or 0x2F.
- On Write record: Set the length of the DP-V1 write request to MLEN.
- On Read record: Set the maximum length of the DP-V1 read response.
- Connect the DP-V1 message to RECORD.

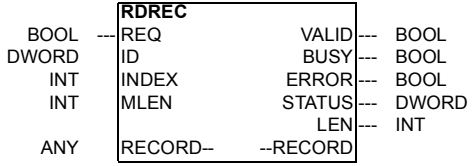


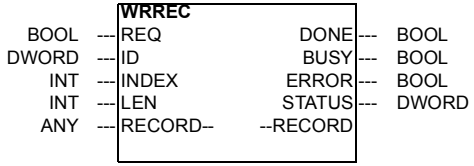


P

**Note**: The function block names for Siemens 12xx and 15xx series PLCs are RD_REC and WR_REC, and this naming convention is also applicable for other blocks.

For more information on the above function blocks, see document *Communication Function Blocks for PROFIBUS DP and PROFINET IO v2.0* available at www.profibus.com.

## Parameter data transfer examples

The following examples show how parameter data is transferred using the DP-V1 mechanisms READ and WRITE.

**Note:** Only the data block part of the request is presented in the examples. See section *Read and write blocks* on page *371*.

### Example 1a: Reading a drive parameter (array element)

Drive parameters are addressed so that the drive parameter group corresponds to the *Parameter index* (PNU), and the drive parameter number within the group corresponds to the *Subindex* (IND). In the following example, a value is read from drive parameter 12.04 (0C.04h).

- DP-V1 Write request (Read parameter value):

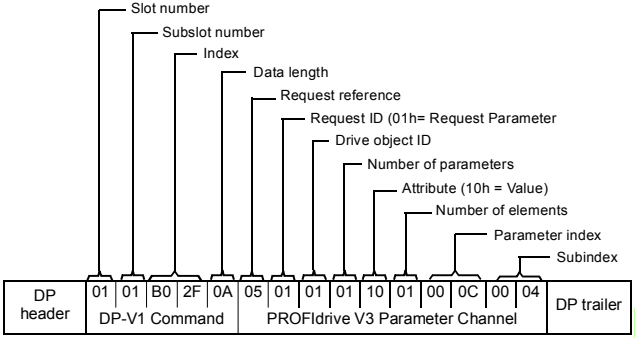


P

- Positive Read response to DP-V1 Read request:

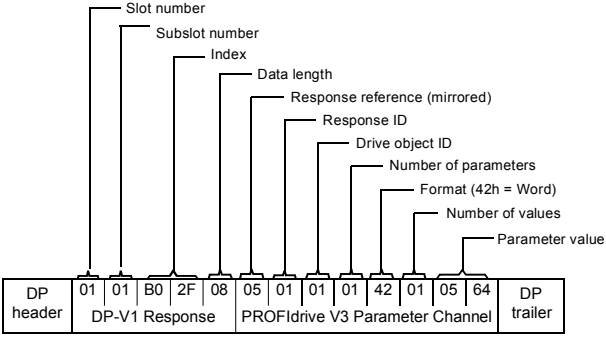


- Negative response to PROFIdrive Read request:

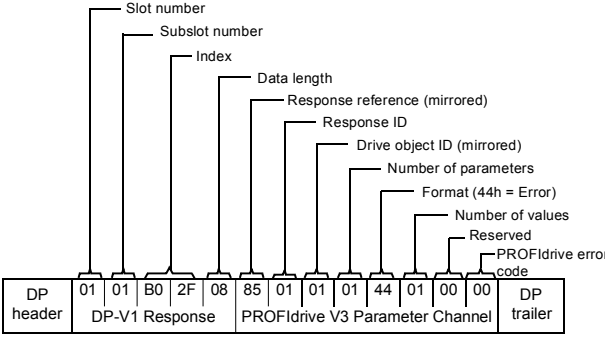


P

### Example 1b: Reading 3 drive parameters (multi-parameter)

In this example, three parameters (12.04, 20.08 and 30.19) are read using one telegram.

- DP-V1 Write request (Read parameter value):

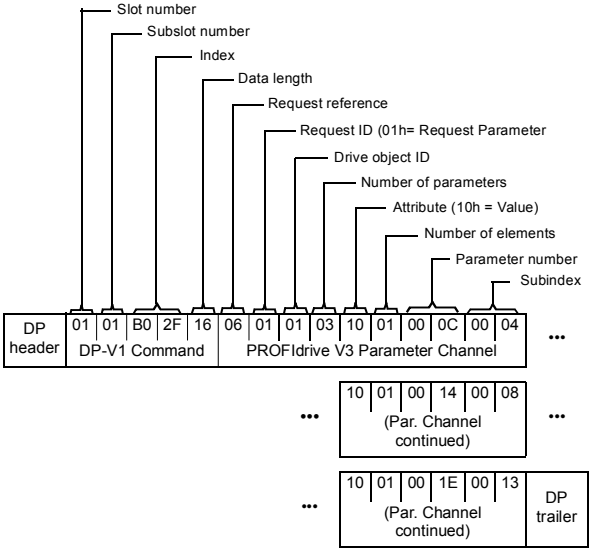


P

- Positive Read response to DP-V1 Read request:

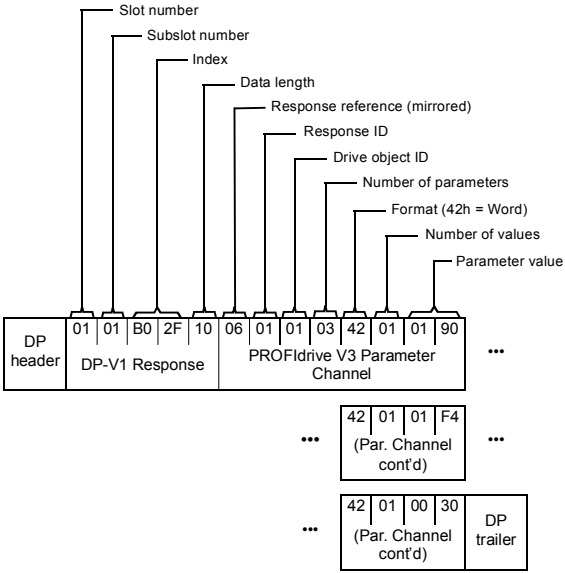


The values 190h (400), 1F4h (500) and 1Eh (30) are returned.

P

### Example 2a: Writing a drive parameter (one array element)

Drive parameters are addressed so that the drive parameter group corresponds to the *Parameter index* (PNU), and the drive parameter number within that group corresponds to the *Subindex* (IND). In the following example, a value is written to drive parameter 12.02 (0C.02h).

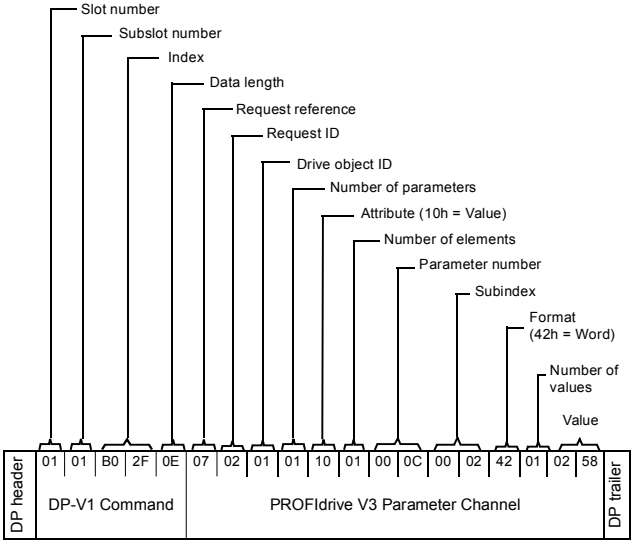


P

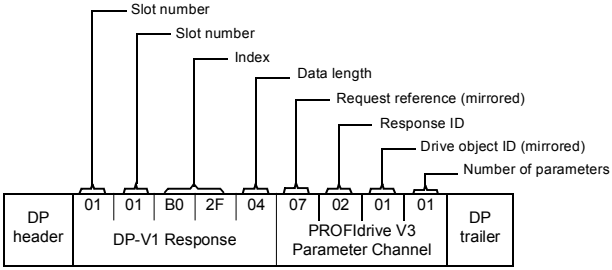
Slot number
Slot number
Index
Data length
Request reference (mirrored)
Response ID
Drive object ID (mirrored)
Number of parameters
DP header
01
01
B0
2F
04
07
02
01
01
DP-V1 Response
PROFIdrive V3 Parameter Channel
DP trailer

### Example 2b: Writing 2 drive parameters (multi-parameter)

In this example, the values 300 (12Ch) and 500 (1F4h) are written to drive parameters 12.02 (0C.02h) and 20.08 (14.08h) respectively using one telegram.

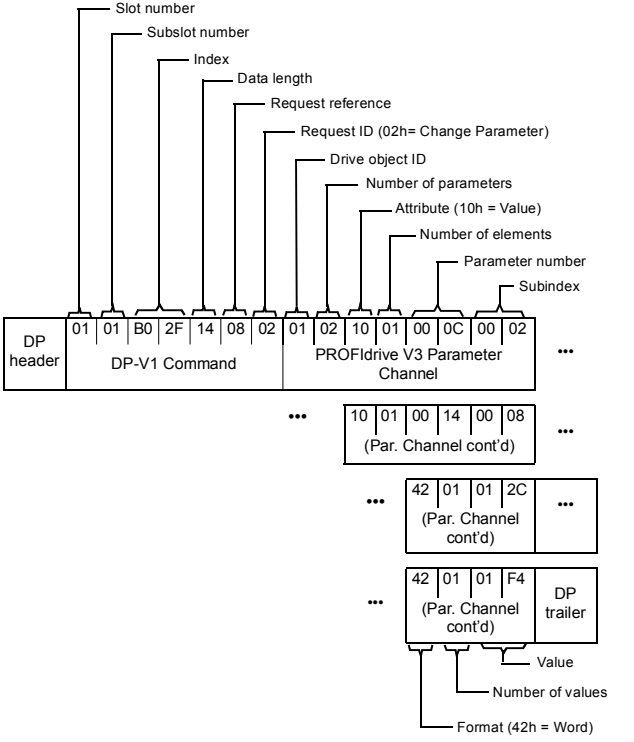


P

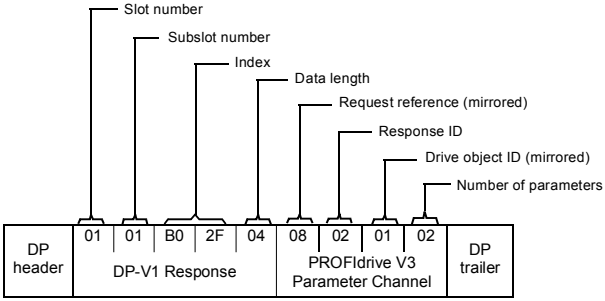
Slot number
Subslot number
Index
Data length
Request reference (mirrored)
Response ID
Drive object ID (mirrored)
Number of parameters
DP header
01
01
B0
2F
04
08
02
01
02
DP-V1 Response
PROFIdrive V3 Parameter Channel
DP trailer

### Example 3: Reading a PROFIdrive parameter

In this example, PROFIdrive parameter 919 (397h) is used to read the device system number of the slave, which is the product code of the drive.

- DP-V1 Write request (Reading a PROFIdrive parameter):

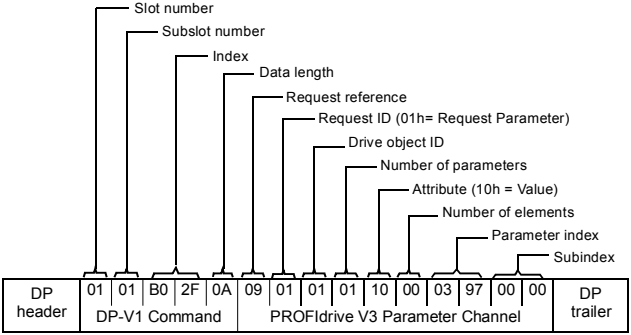


- DP-V1 Read response:

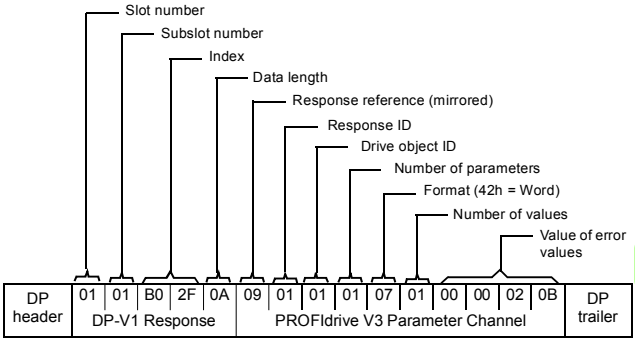


The slave returns the product code of the drive (20Bh in this example).

P

### Example 4: Configuring the process data written to the drive

PROFIdrive parameter 915 (393h) can be used to define which data is written cyclically to a drive parameter as application-specific process data.

In the example below, the value of drive parameter 12.06 (0C.06h) is selected to be taken from PZD3. The parameter will continue to be updated with the contents of PZD3 in each Request frame until a different selection is made.

*Subindex* (IND) defines which process data word the required data is taken from. *Value* selects the drive parameter to which that word is mapped.

- DP-V1 Write request:

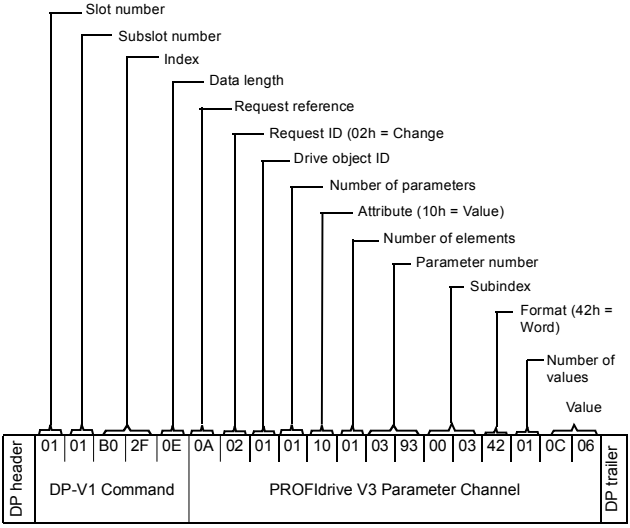

- DP-V1 Read response:

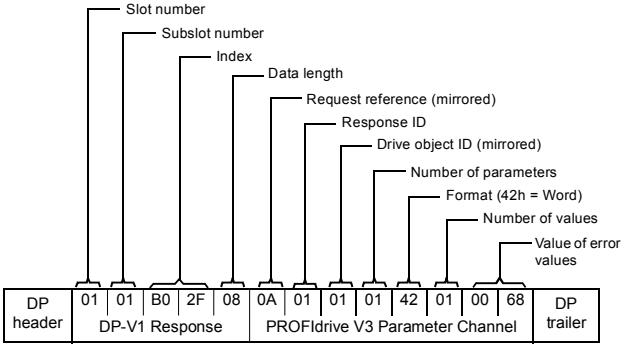


Subsequently, the contents of PZD3 in each Request frame are written to drive parameter 12.06 until a different selection is made.

### Example 5: Determining the source of the process data read from the drive

PROFIdrive parameter 916 (394h) can be used to define which data is read cyclically from the drive as application-specific process data. In the example below, the parameter is used to determine which drive parameter the contents of PZD3 are taken from. *Subindex* (IND) defines which process data word the required data is transmitted in.

- DP-V1 Write request:

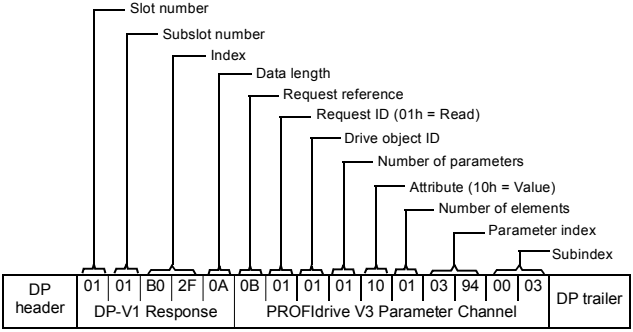


P

- DP-V1 Read response:

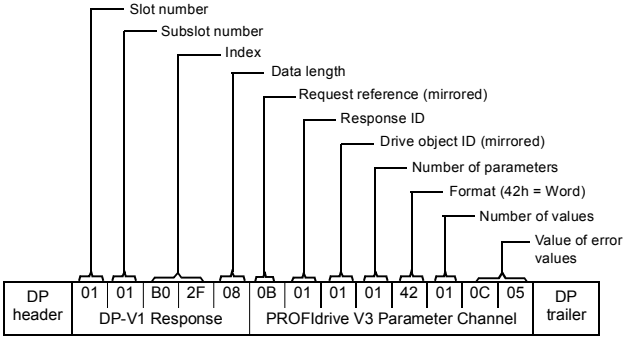


*Value* indicates the source of PZD3 as drive parameter 12.05 (0C.05h).

## Diagnostic and alarm mechanism

The FENA adapter module has mechanisms for sending alarms and saving diagnostics data to a fault buffer. An alarm is triggered if the host or drive has faults in communication or operation. The alarm and fault buffer mechanisms are enabled by default and can be disabled with a configuration parameter (*21 Alarm disable* on page *269*).

## Alarm mechanism

When a fault situation occurs, the adapter module sends an alarm notification, which the master station has to acknowledge. Alarm notifications can be acknowledged, viewed and handled, for example, with Siemens S7 blocks OB82, OB83, OB86 and OB122.

- Block OB82 is used to make sure that the drive does not go to the stop mode during a diagnostic alarm.
- Block OB83 is called if a module is inserted or removed from the system or if the module is modified.
- Block OB86 indicates if there is a failure or event in the distributed periphery.
- Block OB122 is called if the CPU calls a device that is not accessible.

### Fault code mapping

An alarm notification contains a fault code, which is called ChannelErrorType. For PROFIdrive API, the drive internal DRIVECOM fault numbers are mapped to PROFIdrive ChannelErrorTypes according to the table below. The fault numbers that are not listed are mapped to ChannelErrorType *Other*.

| ChannelErrorType | Description | DRIVECOM fault numbers |
|---|---|---|
| 0x9000 | Microcontroller hardware or software | 4211, 5000, 5401, 5402, 5403, 5484, 5691, 5693, 6100, 6180, 6300, 6306, 6306, 6320, 6481, 6487, 630D, 630F, 64A1, 64A2, 64A3, 64E1, 6581, 65A1, 6682, 6683, 6684, 6881, FF55 |
| 0x9001 | Mains supply | 3291 |
| 0x9002 | Low voltage supply | 3130, 3220 |
| 0x9003 | DC link overvoltage | 3210 |

| ChannelErrorType | Description | DRIVECOM fault numbers |
|---|---|---|
| 0x9004 | Power electronics | 2211, 2281, 2310, 2312, 2340, 2381, 3180, 3181, 3182, 3183, 3184, 3185, 3186, 3187, 3381, 3385, 5400, 5482, 5682, 5692, FF56 |
| 0x9005 | Overtemperature electronic device | 4110, 4210, 4212, 4290, 4310, 4313, 4981, 7182, 42F1, 4380 |
| 0x9006 | Earth/ground fault | 2330 |
| 0x9007 | Motor overload | 7121 |
| 0x9008 | Fieldbus system | |
| 0x9009 | Safety channel | 8182, 8183, 5090, 5091, FA81, FA82, FF7A, FFA0, FFA1, FFA2 |
| 0x900A | Feedback | 7301, 7310, 7380, 7381, 7389, 7391, 8480, 8584, 738A, 738B, 738C, 73A0, 73A1 |
| 0x900B | Internal communication | 5480, 5681, 5690, 7000, 7080, 7081, 7510, 7520, 7540, 7584 |
| 0x900C | Infeed | |
| 0x900D | Brake resistor | 7111, 7112, 7113, 7181, 7183, 7184, 7185, 7186, 7187, 7191, 71A2, 71A3, 71A5 |
| 0x900E | Line filter | |

| ChannelErrorType | Description | DRIVECOM fault numbers |
|---|---|---|
| 0x900F | External | 9000, 9001, 9081, FF81, FF82, FF8E, FF90 |
| 0x9010 | Technology | 6382 |
| 0x9011 | Engineering | |
| 0x9012 | Other | 5080, 5093, 5210, 5300, 6200, 7583, 8110, 8500, 8582, 8583, FF61, FF69, FF6A, FF83, FF84, FF95 |

## Fault buffer mechanism

The PROFIdrive profile has a mechanism that can store eight fault situations to PROFIdrive parameters. Fault and diagnostic data, like fault number and fault code, can be accessed simultaneously with only one subindex. The mechanism consists of four PROFIdrive parameters:

- PNU944: Fault message counter.
  - Incremented each time the fault buffer changes.
- PNU945: PROFIdrive fault codes presented in section *Fault code mapping* on page *392*.
- PNU946: Fault code list that converts fault numbers to fault codes.
  - Read using the fault number as a subindex to get the corresponding fault code.
- PNU947: Fault numbers according to the DRIVECOM profile.

The table below illustrates the structure of a fault buffer. The fault buffer consists of two parameters: fault number (PNU 947) and fault code (PNU 945). The rows of the fault buffer are represented by the parameter subindices. Fault messages are entered into the buffer in the sequence they are detected. Each line in the fault buffer represents a fault message, which is a part of a fault situation. A fault situation lasts from a detection of a fault to its acknowledgement.

| Fault situation | PNU947 | PNU945 | |
|---|---|---|---|
| | Fault number | Fault code | Subindex |
| Actual fault situation n | 0x4210 | 0x9005 | 0 |
| | 0 | 0 | 1 |
| | 0 | 0 | 2 |
| | 0 | 0 | 3 |
| | 0 | 0 | 4 |
| | 0 | 0 | 5 |
| | 0 | 0 | 6 |
| | 0 | 0 | 7 |
| Fault situation n-1 | 0x7510 | 0x900B | 8 |
| | 0 | 0 | 9 |
| | 0 | 0 | 10 |
| | 0 | 0 | 11 |
| | 0 | 0 | 12 |
| | 0 | 0 | 13 |
| | 0 | 0 | 14 |
| | 0 | 0 | 15 |
| … | … | … | … |

| Fault situation | PNU947 | PNU945 | |
|---|---|---|---|
| | Fault number | Fault code | Subindex |
| Fault situation n-7 | 0 | 0 | 56 |
| | 0 | 0 | 57 |
| | 0 | 0 | 58 |
| | 0 | 0 | 59 |
| | 0 | 0 | 60 |
| | 0 | 0 | 61 |
| | 0 | 0 | 62 |
| | 0 | 0 | 63 |

17

# PROFINET IO – Diagnostics

## Contents of this chapter

This chapter explains how to trace faults with the status LEDs on the adapter module when the module is used for PROFINET IO communication.

## Fault and warning messages

For the fault and warning messages concerning the adapter module, see the drive firmware manual.

## LEDs

The adapter module is equipped with three bicolor diagnostic LEDs. The LEDs are described below.




| Name | Color | Function |
|---|---|---|
| HOST | Blinking green | Establishing communication to host |
| | Green | Connection to host OK |
| | Blinking red | Communication to host lost temporarily |
| | Flashing orange, alternating with the MODULE flashing orange | Internal file system error. The error may be cleared by cycling drive power. If the error persists, contact your local ABB representative. |
| MODULE | Off | There is no power applied to the device. |
| | Flashing orange | Device is blinking. Used for identification. The blinking is started by the PROFINET master and also the network LED is flashing green. |




| Name | Color | Function |
|---|---|---|
| MODULE | Flashing green | Device waiting for PROFINET connection. This may be caused by missing PROFINET station name configuration or PLC is not running. |
| | Green | Device is operating in a normal condition. |
| | Flashing red | Recoverable fault |
| | Red | Ethernet interface is disabled. Duplicate Address Detection may have detected a duplicate address. Check the IP configuration and either initiate a Fieldbus Adapter parameter refresh or cycle power to the drive. |
| | Flashing red-green | Device is in Self Test. |
| | Flashing orange, alternating with the HOST flashing orange | Internal file system error. The error may be cleared by cycling drive power. If the error persists, contact your local ABB representative. |
| NETWORK /NET | Off | Device is not on-line.<br>• The device has not completed the Duplicate Address Detection yet.<br>• The device may not be powered; look at the MODULE status LED. |
| | Flashing green | Device is receiving/transmitting on the Ethernet. |

# NONE protocol selection

*NONE – Start-up* . . . . . *403*
*NONE - Diagnostics* . . . . . *411*

N

18

# NONE – Start-up

## Contents of this chapter

This chapter contains:

- information on configuring the drive for operation with the adapter module
- drive-specific instructions on starting up the drive with the adapter module
- information on configuring the client for communication with the adapter module.

## Warnings



**WARNING!** Obey the safety instructions given in this manual and the drive documentation.

# Drive configuration

The information in this section applies to all drive types compatible with the adapter module, unless otherwise stated.

## Connection configuration using NONE protocol

After the adapter module is mechanically and electrically installed according to the instructions in chapters *Mechanical installation* and *Electrical installation*, you must prepare the drive for communication with the module.

The detailed procedure of activating the module using the NONE protocol with the drive depends on the drive type. Normally, you must adjust a parameter to activate the communication. See the drive-specific start-up sections starting on page *410*.

Once communication between the drive and the adapter module is established, several configuration parameters are copied to the drive. These parameters are shown in the tables below and must be checked first and adjusted where necessary. You can adjust the parameters via a drive control panel, a PC tool or a web user interface. For more information on the web user interface, see *Appendix C – FENA configuration web pages*.

**Note:**

- Not all drives will display the descriptive names for the configuration parameters.
- The new parameter settings take effect only when you power up the module the next time or when you activate the fieldbus adapter refresh parameter.
- Use the NONE protocol selection when no fieldbus protocol is required. For example, when only the Ethernet tool network is used or for synchronizing time.

## FENA-01/-11-/21 configuration parameters – group A (group 1)

**Note:** The actual parameter group number depends on the drive type. Group A (group 1) corresponds to:

- parameter group 51 in ACSM1, ACS355, ACS380, ACS480, ACS580, ACS850 and ACQ810.
- parameter group 51 in ACS880 and ACS880-M04 if the adapter is installed as fieldbus adapter A or group 54 if the adapter is installed as fieldbus adapter B.

| No. | Name/Value | Description | Default |
|---|---|---|---|
| 01 | FBA TYPE | **Read-only.** Shows the fieldbus adapter type as detected by the drive. The value cannot be adjusted by the user.<br>If the value is **0** = None, the communication between the drive and the module has not been established. | **128** = ETHER-NET |
| 02 | Protocol/Profile | Selects the application protocol and communication profile for the network connection.<br>The selections available for NONE protocol are listed below. | **0** = Modbus/ TCP |
| | **0** = Modbus/TCP | ABB Drives profile - Classic | |
| | **200** = NONE | NONE protocol | |
| 03 | Commrate | Sets the bit rate for the Ethernet interface. | **0** = Auto |
| | **0** = Auto | Autonegotiate | |
| | **1** = 100 Mbps FD | 100 Mbps, full duplex | |
| | **2** = 100 Mbps HD | 100 Mbps, half duplex | |
| | **3** = 10 Mbps FD | 10 Mbps, full duplex | |
| | **4** = 10 Mbps HD | 10 Mbps, half duplex | |
| 04 | IP configuration | Sets the method for configuring the IP address, subnet mask and gateway address for the module. | **1** = Dyn IP DHCP |
| | **0** = Static IP | Configuration is obtained from parameters *05…13*. | |
| | **1** = Dyn IP DHCP | Configuration is obtained via DHCP. | |

| No. | Name/Value | Description | Default |
|---|---|---|---|
| 05 | IP address 1 | An IP address is assigned to each IP node on a network. An IP address is a 32-bit number that is typically represented in “dotted decimal” notation consisting of four decimal integers, on the range 0…255, separated by periods. Each integer represents the value of one octet (8-bits) in the IP address. Parameters *05...08* define the four octets of the IP address. | 0 |
| | 0…255 | IP address | |
| … | … | … | … |
| 08 | IP address 4 | See parameter *05 IP address 1*. | 0 |
| | 0…255 | IP address | |
| 09 | Subnet CIDR | Subnet masks are used for splitting networks into smaller networks called subnets. A subnet mask is a 32-bit binary number that splits the IP address into a network address and host address.<br>Subnet masks are typically represented in either dotted decimal notation or the more compact CIDR notation, as shown in the table below. | 0 |

| Dotted decimal | CIDR | Dotted decimal | CIDR |
|---|---|---|---|
| 255.255.255.254 | 31 | 255.254.0.0 | 15 |
| 255.255.255.252 | 30 | 255.252.0.0 | 14 |
| 255.255.255.248 | 29 | 255.248.0.0 | 13 |
| 255.255.255.240 | 28 | 255.240.0.0 | 12 |
| 255.255.255.224 | 27 | 255.224.0.0 | 11 |
| 255.255.255.192 | 26 | 255.224.0.0 | 10 |
| 255.255.255.128 | 25 | 255.128.0.0 | 9 |
| 255.255.255.0 | 24 | 255.0.0.0 | 8 |
| 255.255.254.0 | 23 | 254.0.0.0 | 7 |
| 255.255.252.0 | 22 | 252.0.0.0 | 6 |
| 255.255.248.0 | 21 | 248.0.0.0 | 5 |
| 255.255.240.0 | 20 | 240.0.0.0 | 4 |
| 255.255.224.0 | 19 | 224.0.0.0 | 3 |
| 255.255.192.0 | 18 | 192.0.0.0 | 2 |
| 255.255.128.0 | 17 | 128.0.0.0 | 1 |
| 255.255.0.0 | 16 | | |

| | | |
|---|---|---|
| 1…31 | Subnet mask in CIDR notation | |

| No. | Name/Value | Description | Default |
|---|---|---|---|
| 10 | GW address 1 | IP gateways connect individual physical IP subnets into a unified IP network. When an IP node needs to communicate with an IP node on another subnet, the IP node sends the data to the IP gateway for forwarding. Parameters *10…13* define the four octets of the gateway address. | 0 |
| | 0…255 | GW address | |
| … | … | … | … |
| 13 | GW address 4 | See parameter *10 GW address 1*. | 0 |
| | 0…255 | GW address | |
| 14 | Commrate port 2 | Sets the bit rate for the Ethernet port 2. This parameter is used only with FENA-21. | **0** = Auto |
| | **0** = Auto | Autonegotiate | |
| | **1** = 100 Mbps FD | 100 Mbps, full duplex | |
| | **2** = 100 Mbps HD | 100 Mbps, half duplex | |
| | **3** = 10 Mbps FD | 10 Mbps, full duplex | |
| | **4** = 10 Mbps HD | 10 Mbps, half duplex | |
| 15 … 25 | Reserved | These parameters are not used by the adapter module when using the NONE protocol. | N/A |
| 26 | Reserved for web page functionality. For more information, see *Appendix C – FENA configuration web pages*. | These parameters are not used by the adapter module when using the NONE protocol. | N/A |
| 27 | FBA A/B par refresh | Validates any changed adapter module configuration parameter settings. After refreshing, the value reverts automatically to **0** = Done. **Note:** This parameter cannot be changed while the drive is running. | **0** = Done |
| | **0** = Done | Refreshing done | |
| | **1** = Refresh | Refreshing | |

| No. | Name/Value | Description | Default |
|---|---|---|---|
| 28 | FBA A/B par table ver | **Read-only.** Displays the parameter table revision of the fieldbus adapter module mapping file stored in the memory of the drive. In format **xyz**, where<br>**x** = major revision number<br>**y** = minor revision number<br>**z** = correction number<br>OR<br>in format **axyz**, where<br>**a** = major revision number<br>**xy** = minor revision numbers<br>**z** = correction number or letter. | N/A |
| | | Parameter table revision | |
| 29 | FBA A/B drive type code | **Read-only.** Displays the drive type code of the fieldbus adapter module mapping file stored in the memory of the drive. | N/A |
| | | Drive type code of the fieldbus adapter module mapping file | |
| 30 | FBA A/B mapping file ver | **Read-only.** Displays the fieldbus adapter module mapping file revision stored in the memory of the drive in decimal format. | N/A |
| | | Mapping file revision | |
| 31 | D2FBA A/B comm status | **Read-only.** Displays the status of the fieldbus adapter module communication.<br>**Note:** The value names may vary by drive. | **0** = Idle<br>or<br>**4** = Off-line<br>or<br>**2** = Time out |
| | **0** = Idle | Adapter is not configured. | |
| | **1** = Exec.init | Adapter is initializing. | |
| | **2** = Time out | A timeout has occurred in the communication between the adapter and the drive. | |
| | **3** = Conf.err | Adapter configuration error: The major or minor revision code of the common program revision in the fieldbus adapter module is not the revision required by the module or mapping file upload has failed more than three times. | |
| | **4** = Off-line | Adapter is off-line. | |
| | **5** = On-line | Adapter is on-line. | |
| | **6** = Reset | Adapter is performing a hardware reset. | |

| No. | Name/Value | Description | Default |
|---|---|---|---|
| 32 | FBA A/B comm SW ver | **Read-only.** Displays firmware patch and build number of the adapter module in the **xxyy** format, where:<br>**xx** = patch number<br>**yy** = build number<br>Example: C80D ≥ 200.13<br>or 0 ≥ 0.0 | N/A |
| | | Common program version of the adapter module | |
| 33 | FBA A/B appl SW ver | **Read-only.** Displays firmware version of the adapter module in xxyy format, where:<br>**xx = major revision number**<br>**yy = minor revision number**<br>Example: 310 = 3.10<br>Version number is the form:<br><major>.<minor>.<patch>.<build><br>Example: 3.10.200.13<br>or 3.10.0.0 | N/A |
| | | Application program revision of the adapter module | |

## Starting up fieldbus communication

1. Power up the drive.
2. Enable communication between the adapter module and the drive by selecting the correct slot number in parameter 50.01 FBA A enable.

   The selection must correspond to the slot where the adapter module is installed. For example, if the adapter module is installed in slot 1, you must select slot 1.
3. Set the module configuration parameters in group 51.
   - select the communication protocol and profile with parameter 51.02, and
   - configure the network settings with parameters 51.03…51.13.
4. Save the valid parameter values to permanent memory with parameter 96.07 Parameter save manually.
5. Validate the settings made in parameter groups 51 with parameter 51.27 FBA A par refresh.



19

# NONE - Diagnostics

## Contents of this chapter

This chapter explains how to trace faults with the status LEDs on the adapter module using the NONE protocol.

## Fault and warning messages

For the fault and warning messages concerning the adapter module, see the drive firmware manual.

## LEDs

The adapter module is equipped with three bicolor diagnostic LEDs. The LEDs are described below.




| Name | Color | Function |
|---|---|---|
| HOST | Blinking green | Establishing communication to host |
| | Green | Connection to host OK |
| | Blinking red | Communication to host lost temporarily |
| | Blinking orange, alternating with the MODULE blinking orange | Internal file system error. The error may be cleared by cycling drive power. If the error persists, contact your local ABB representative. |




| Name | Color | Function |
|---|---|---|
| MODULE | Off | There is no PC tool connected to the device. |
| | Flashing orange | Device is attempting to obtain IP configuration from the DHCP server. |
| | Orange | Device is executing Duplicate Address Detection. |
| | Green | PC tool is connected to the device. |
| | Flashing red | Ethernet link is down. |
| | Red | Ethernet interface is disabled. Duplicate Address Detection may have detected a duplicate address. Check the IP configuration and either initiate a Fieldbus Adapter parameter refresh or cycle power to the drive. |
| | Flashing orange, alternating with the HOST flashing orange | Internal file system error. The error may be cleared by cycling drive power. If the error persists, contact your local ABB representative. |
| NETWORK /NET | Off | Ethernet link is down. |
| | Flashing green | Ethernet link is up at 100 Mbps.<br>Flashing indicates activity on interface. |
| | Flashing orange | Ethernet link is up at 10 Mbps.<br>Flashing indicates activity on interface. |

P

20

# Technical data

## Contents of this chapter

This chapter contains the technical specifications of the adapter module and the Ethernet link.

## FENA-01/-11/-21

The figure below shows the enclosure of the adapter module from the front and side.

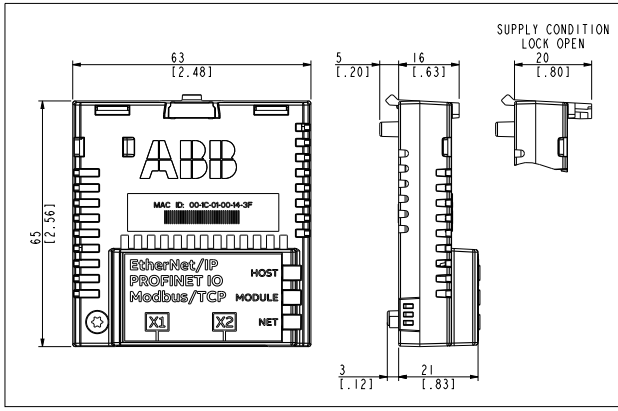

| | |
|---|---|
| **Installation** | Into an option slot on the drive control unit |
| **Degree of protection** | IP20 |
| **Ambient conditions** | The applicable ambient conditions specified for the drive in its manuals are in effect. |
| **Package** | Cardboard. Plastic wrapping: Antistatic air bubble sheet (PE). |
| **Indicators** | Three bicolor LEDs (HOST, MODULE, NETWORK/NET) |
| **Connectors** | A 20-pin connector to the drive<br>RJ-45 connector to Ethernet (X1)<br>FENA-21 only: RJ-45 connector for chaining another adapter module (X2) |
| **Power supply** | +3.3 V ±5% max. 400 mA (supplied by the drive) |
| **General** | Complies with EMC standard EN 61800-3:2004<br>Printed circuit board conformal coated |

## Ethernet link

| | |
|---|---|
| **Compatible devices** | Ethernet Standard IEEE 802.3 and IEEE 802.3u devices |
| **Medium** | 10BASE-TX or 100Base-TX with Auto-negotiation and Auto-MDIX (Auto-crossover)<br>• Wiring: CAT5/6 UTP, CAT5/6 FTP, CAT5/6 STP<br>• Connector: RJ-45<br>• Termination: Internal<br>• Maximum segment length: 100 m / 328 ft |
| **Topology** | Bus or star.<br>Max. 50 nodes allowed for FENA-21 in a daisy chain topology. |
| **Transfer rate** | 10 Mbps or 100 Mbps |
| **Serial communication type** | Half or full duplex |
| **Protocol** | Modbus/TCP, EtherNet/IP, PROFINET IO |

## TCP and UDP service ports

There are multiple in-bound and out-bound network services running on the FENA-01/-11/-21. Some ports are protocol specific and are not used when other protocols are selected.

| Port | Service | Purpose |
|---|---|---|
| 502 (TCP/UDP) | Modbus/TCP | Communication between the drive and a PLC.<br>**Note**: Used only when Modbus/TCP protocol is selected |
| 44818 (TCP) | Ethernet/IP | Ethernet/IP, explicit messaging.<br>**Note**: Used only when Ethernet/IP protocol is selected |
| 2222 (UDP) | Ethernet/IP | Ethernet/IP, implicit messaging.<br>**Note**: Used only when Ethernet/IP protocol is selected |
| 34962 (TCP/UDP) | PROFINET | PROFINET RT Unicast.<br>**Note**: Used only when PROFINET IO protocol is selected |
| 34963 (TCP/UDP) | PROFINET | PROFINET RT Multicast.<br>**Note:** Used only when PROFINET IO protocol is selected |
| 34964 (TCP/UDP) | PROFINET | PROFINET Context Manager.<br>**Note:** Used only when PROFINET IO protocol is selected |
| 80 (TCP) | HTTP | Web server, provides the UI over the HTTP protocol.<br>Used for Ethernet tool communication. To disable go to Service Configuration page via web interface (see page *444*). |
| 68 (UDP) | DHCP | DHCP client<br>**Note**: Used only when IP configuration method is selected as "Dyn IP HFCP" |

| Port | Service | Purpose |
|---|---|---|
| 24576 (UDP) | ABB Netconfig | • Auto discovery protocol<br>• Used by ControlBuilder plus (IP Configuration tool) and Drive composer pro and DriveWindow 2.40 PC tools<br>• Discovers ABB specific Ethernet devices in a local network segment, by listening to and responding to UDP broadcasts.<br>To disable go to Service Configuration page via web interface (see page *444*). |
| 123 (UDP) | SNTP | Simple Network Time protocol. This service is switched off, by default. To enable this service, go to Service Configuration page via web interface (see page *444*). |
| 161 (UDP) | SNMP | Simple Network Management Protocol.<br>**Note:** Used only when PROFINET IO protocol is selected.<br>To disable go to Service Configuration page via web interface (see page *444*). |

21

# Appendix A – PROFIdrive parameters and I&M records of PROFINET IO

## Contents of this chapter

This chapter contains:

- PROFIdrive parameters of the PROFINET IO communication protocol
- telegram and response structures for the I&M (Identification & Maintenance) records of the PROFINET IO communication protocol.

## PROFIdrive parameters

| Par. no. | R/W[1)] | Data type | Description |
|---|---|---|---|
| 915 | R/W | Array [12] Unsigned16 | Assignment PZD1 to PZD12 in PPO-write |
| 916 | R/W | Array [12] Unsigned16 | Assignment PZD1 to PZD12 in PPO-read |
| 919 | R | Octet String4 | Device system number |
| 922 | R | Unsigned16 | Telegram selection |

<table>
<tr><th>Par. no.</th><th>R/W[1)]</th><th>Data type</th><th>Description</th></tr>
<tr><td>923</td><td>R</td><td>Array [n]<br>Unsigned16</td><td>List of all parameters for signals. Mandatory if process data normalization is used and/or parameters 915 and 916 are implemented.
<table>
<tr><th>Signal no. and name</th><th>Type</th></tr>
<tr><td>1 – Control word 1 (STW1)</td><td>Unsigned16</td></tr>
<tr><td>2 – Status word 1 (ZSW1)</td><td>Unsigned16</td></tr>
<tr><td>3 – Control word 2 (STW2)</td><td>Unsigned16</td></tr>
<tr><td>4 – Status word 2 (ZSW2)</td><td>Unsigned16</td></tr>
<tr><td>5 – Speed set point A (NSOLL_A)</td><td>Signed16</td></tr>
<tr><td>6 – Speed actual value A (NIST_A)</td><td>Signed16</td></tr>
<tr><td>7 – Speed set point B (NSOLL_B)</td><td>Signed32</td></tr>
<tr><td>8 – Speed actual value B (NIST_B)</td><td>Signed32</td></tr>
<tr><td>27 – Position set point A (XSOLL_A)</td><td>Signed32</td></tr>
<tr><td>28 – Position actual value A (XIST_A)</td><td>Signed32</td></tr>
<tr><td>32 – Traversing block selection (SATZANW) (not supported)</td><td>Unsigned16</td></tr>
<tr><td>33 – Actual traversing block (AKTSATZ) (not supported)</td><td>Unsigned16</td></tr>
<tr><td>34 – Target position (TARPOS_A) (not supported)</td><td>Signed32</td></tr>
<tr><td>35 – Velocity (VELOCITY_A)</td><td>Unsigned32</td></tr>
<tr><td>101…9999 – Drive-specific</td><td>–</td></tr>
</table>
</td></tr>
</table>

<table>
<tr><th>Par. no.</th><th>R/W[1)]</th><th>Data type</th><th>Description</th></tr>
<tr><td>927</td><td>R/W</td><td>Unsigned16</td><td>Operator control rights (parameter identification, PKW)<br><table><tr><th>Value</th><th>Mode</th></tr><tr><td>0</td><td>Parameters cannot be written, only read (927 can be written).</td></tr><tr><td>1</td><td>Parameters can be written and read (default).</td></tr></table></td></tr>
<tr><td>928</td><td>R/W</td><td>Unsigned16</td><td>Control rights (process data, PZD).<br><table><tr><th>Value</th><th>Mode</th></tr><tr><td>0</td><td>PZD part is disabled, i.e., Receipt of new PZD data is ignored.</td></tr><tr><td>1</td><td>PZD part is enabled (default).</td></tr></table></td></tr>
<tr><td>929</td><td>R</td><td>Unsigned16</td><td>Selected PPO type<br><table><tr><th>Value</th><th>PPO type</th></tr><tr><td>1</td><td>PPO1</td></tr><tr><td>2</td><td>PPO2</td></tr><tr><td>3</td><td>PPO3</td></tr><tr><td>4</td><td>PPO4</td></tr><tr><td>5</td><td>PPO5</td></tr><tr><td>6</td><td>PPO6</td></tr><tr><td>7</td><td>PPO7</td></tr></table><br>Note: This parameter is not available if Standard telegram ST1 or ST2 is selected.</td></tr>
</table>

<table>
<tr><th>Par. no.</th><th>R/W[1)]</th><th>Data type</th><th>Description</th></tr>
<tr><td>930</td><td>R/W</td><td>Unsigned16</td><td>Selection switch for communication profile.<br><table><tr><th>Value</th><th>Mode</th></tr><tr><td>1</td><td>PROFIdrive</td></tr><tr><td>8001h</td><td>ABB Drives</td></tr><tr><td>8002h</td><td>Transparent 16</td></tr><tr><td>8003h</td><td>Transparent 32</td></tr><tr><td>8004h</td><td>PROFIdrive positioning mode</td></tr></table></td></tr>
<tr><td>933</td><td>R/W</td><td>Unsigned16</td><td>Selection switch for Control word, bit 11.<br><table><tr><th>Value</th><th>Module Control word bit</th></tr><tr><td>0</td><td>None</td></tr><tr><td>1 to 5</td><td>Vendor specific 1 to 5[2)]</td></tr></table></td></tr>
<tr><td>934</td><td>R/W</td><td>Unsigned16</td><td>Selection switch for Control word, bit 12. (See parameter 933 for coding.)</td></tr>
<tr><td>935</td><td>R/W</td><td>Unsigned16</td><td>Selection switch for Control word, bit 13. (See parameter 933 for coding.)</td></tr>
<tr><td>936</td><td>R/W</td><td>Unsigned16</td><td>Selection switch for Control word, bit 14. (See parameter 933 for coding.)</td></tr>
<tr><td>937</td><td>R/W</td><td>Unsigned16</td><td>Selection switch for Control word, bit 15. (See parameter 933 for coding.)</td></tr>
<tr><td>939</td><td>R/W</td><td>Unsigned16</td><td>Selection switch for Status word, bit 11.<br><table><tr><th>Value</th><th>Module Status word bit</th></tr><tr><td>0</td><td>None</td></tr><tr><td>1 to 4</td><td>Vendor specific 1 to 4[2)]</td></tr></table></td></tr>
<tr><td>940</td><td>R/W</td><td>Unsigned16</td><td>Selection switch for Status word, bit 12. (See parameter 939 for coding.)</td></tr>
<tr><td>941</td><td>R/W</td><td>Unsigned16</td><td>Selection switch for Status word, bit 13. (See parameter 939 for coding.)</td></tr>
<tr><td>942</td><td>R/W</td><td>Unsigned16</td><td>Selection switch for Status word, bit 14. (See parameter 939 for coding)</td></tr>
</table>

<table>
<tr><th>Par. no.</th><th>R/W[1)]</th><th>Data type</th><th>Description</th></tr>
<tr><td>943</td><td>R/W</td><td>Unsigned16</td><td>Selection switch for Status word, bit 15. (See parameter 939 for coding.)</td></tr>
<tr><td>944</td><td>R</td><td>Unsigned16</td><td>Fault message counter</td></tr>
<tr><td>945</td><td>R</td><td>Array[64]<br>Unsigned16</td><td>Fault code (Channel Error Type)<table><tr><th>Subindex</th><th>Contents</th></tr><tr><td>0</td><td>Last fault</td></tr><tr><td>8</td><td>Second last ackn. fault</td></tr><tr><td>16</td><td>Third last ackn. fault</td></tr><tr><td>24</td><td>Fourth last ackn. fault</td></tr><tr><td>32</td><td>Fifth last ackn. fault</td></tr><tr><td>40</td><td>Sixth last ackn. fault</td></tr><tr><td>48</td><td>Seventh last ackn. fault</td></tr><tr><td>56</td><td>Eighth last ackn. fault</td></tr></table></td></tr>
<tr><td>946</td><td>R</td><td>Array [n]<br>Unsigned16</td><td>Fault code list. Contains the mapping between DRIVECOM fault codes and Channel Error Types.<br>If you use a DRIVECOM fault code as an index when reading PNU946, the corresponding Channel Error Type is returned.</td></tr>
<tr><td>947</td><td>R</td><td>Array [64]<br>Unsigned16</td><td>Fault number (coded according to the DRIVECOM profile).<table><tr><th>Subindex</th><th>Contents</th></tr><tr><td colspan="2">See parameter 945.</td></tr></table></td></tr>
<tr><td>953</td><td>R</td><td>Unsigned16</td><td>Last alarm[3)]</td></tr>
<tr><td>954</td><td>R</td><td>Unsigned16</td><td>Second last alarm[3)]</td></tr>
<tr><td>955</td><td>R</td><td>Unsigned16</td><td>Third last alarm[3)]</td></tr>
<tr><td>956</td><td>R</td><td>Unsigned16</td><td>Fourth last alarm[3)]</td></tr>
<tr><td>957</td><td>R</td><td>Unsigned16</td><td>Fifth last alarm[3)]</td></tr>
</table>

<table>
<tr><th>Par. no.</th><th>R/W[1)]</th><th>Data type</th><th>Description</th></tr>
<tr><td>964</td><td>R</td><td>Array [7]<br>Unsigned16</td><td>
<table>
<tr><th>Subindex</th><th>Contents</th></tr>
<tr><td>0</td><td>Manufacturer</td></tr>
<tr><td>1</td><td>Device type</td></tr>
<tr><td>2</td><td>Version</td></tr>
<tr><td>3</td><td>Firmware date (year)</td></tr>
<tr><td>4</td><td>Firmware date (day/month)</td></tr>
<tr><td>5</td><td>Number of Axes</td></tr>
</table>
</td></tr>
<tr><td>965</td><td>R</td><td>Octet String2</td><td>Profile number of this device.<br>Eg: 0302h = Profile 3, Version 2</td></tr>
<tr><td>967</td><td>R</td><td>Unsigned16</td><td>Control word (CW)</td></tr>
<tr><td>968</td><td>R</td><td>Unsigned16</td><td>Status word (SW)</td></tr>
<tr><td>970</td><td>R/W</td><td>Unsigned16</td><td>Load parameter record
<table>
<tr><th>Value</th><th>Description</th></tr>
<tr><td>0</td><td>No action</td></tr>
<tr><td>1</td><td>Restore factory settings</td></tr>
</table>
The parameter must do a zero-to-one transition and the motor must be stopped.</td></tr>
<tr><td>971</td><td>R/W</td><td>Unsigned16</td><td>Save parameter record
<table>
<tr><th>Value</th><th>Description</th></tr>
<tr><td>0</td><td>No action</td></tr>
<tr><td>1</td><td>Save the drive parameters to non-volatile memory</td></tr>
</table>
The parameter must do a zero-to-one transition and the motor must be stopped.</td></tr>
</table>

<table>
<tr><th>Par. no.</th><th>R/W[1)]</th><th>Data type</th><th>Description</th></tr>
<tr><td>972</td><td>R/W</td><td>Unsigned16</td><td>Software reset<br><table><tr><th>Value</th><th>Description</th></tr><tr><td>0</td><td>No action</td></tr><tr><td>1</td><td>Re-boot PROFIBUS module</td></tr></table><br>The parameter must do a zero-to-one transition and the motor must be stopped.</td></tr>
<tr><td>975</td><td>R</td><td>Array[n] Unsigned16</td><td>DO identification. For subindexes 0…4, see parameter 964.<br><table><tr><th>Subindex</th><th>Meaning</th></tr><tr><td>5</td><td>Value 2 = Axis</td></tr></table></td></tr>
<tr><td>980<br>981</td><td>R</td><td>Array[n] Unsigned16</td><td>Number list of defined parameters. If the subindex is 0, the end of the list has been reached. If the subindex is the number of the next list parameter, the list is continued there.</td></tr>
<tr><td>1000</td><td>R/W</td><td>Unsigned16</td><td>Map 16-bit selection[3)]. Used to request the data type for mapped parameters if mapping is done with parameter 915 or 916.<br><table><tr><th>Value</th><th>Description</th></tr><tr><td>1</td><td>User 16-bit mapping, if available.</td></tr></table></td></tr>
<tr><td>1001</td><td>R/W</td><td>Integer16</td><td>SNTP time offset to UTC time.<br><table><tr><th>Value</th><th>Description</th></tr><tr><td>-1440, 1440</td><td>Time in minutes to offset the UTC time received from SNTP</td></tr></table></td></tr>
<tr><td>50000</td><td>R/W</td><td>Unsigned16</td><td>Disable alarms.<br><table><tr><th>Value</th><th>Description</th></tr><tr><td>0</td><td>PNIO alarms enabled.</td></tr><tr><td>1</td><td>PNIO alarms disabled.</td></tr></table></td></tr>
</table>

| Par. no. | R/W[1)] | Data type | Description |
|---|---|---|---|
| 61000 | R | VisibleString24 | Name of station |
| 61001 | R | Unsigned32 | IP of station |
| 61002 | R | OctetString[6] | MAC address of station |
| 61003 | R | Unsigned32 | Default gateway of station |
| 61004 | R | Unsigned32 | Subnet mask of station |

1) Read and/or Write

2) The meaning of vendor-specific bits is defined by the drive control program.

3) Support depends on the drive type.

## I&M records

I&M (Identification & Maintenance) records can be read, for example, with the DTM tool. The FENA adapter module supports the mandatory I&M0 record as well as the optional I&M1, I&M2, I&M3 and I&M4 records.

### Call-REQ-PDU telegram for read/write access to I&M records

| Function | Record Data Index |
|---|---|
| I&M0 | 0xAFF0 |
| I&M1 | 0xAFF1 |
| I&M2 | 0xAFF2 |
| I&M3 | 0xAFF3 |
| I&M4 | 0xAFF4 |

## Response structure for I&M0 (Read-only)

| | Contents | Size | Coding |
|---|---|---|---|
| Header | | 10 Octets | – |
| I&M block | MANUFACTURER_ID | 2 Octets | 0x1A = ABB Automation |
| | ORDER_ID | 20 Octets | For instance, “68469422” for FENA-01 kit) |
| | SERIAL_NUMBER | 16 Octets | Serial number of FENA module |
| | HARDWARE_REVISION | 2 Octets | Hardware version of FENA module |
| | SOFTWARE_REVISION | 4 Octets | Format: **V255.255.255** E.g., V1.0.0 = software version 100 |
| | REVISION_COUNTER | 2 Octets | (Marks a change of hardware or its parameters) |
| | PROFILE_ID | 2 Octets | 3A00 (…3AFF) PROFIdrive |
| | PROFILE_SPECIFIC_ TYPE | 2 Octets | 0 = no specific type |
| | IM_VERSION | 2 Octets | 0x0101 = version 1.1 |
| | IM_SUPPORTED | 2 Octets | 30 = I&M0, I&M1, I&M2, I&M3 and I&M4 supported |

## Response structure for I&M1 (Read/Write)

| | Contents | Size | Coding |
|---|---|---|---|
| Header | | 10 Octets | – |
| I&M block | TAG_FUNCTION | 32 Octets | Device function or task |
| | TAG_LOCATION | 22 Octets | Device location |

## Response structure for I&M2 (Read/Write)

| | Contents | Size | Coding |
|---|---|---|---|
| Header | | 10 Octets | – |
| I&M block | INSTALLATION_DATE | 16 Octets | Installation date. E.g., **2011-01-01 16:23** |
| | RESERVED | 38 Octets | Reserved |

**Note:** I&M1, I&M2 and I&M3 are blank (0x20) by default.

## Response structure for I&M3 (Read/Write)

| | Contents | Size | Coding |
|---|---|---|---|
| Header | | 10 Octets | – |
| I&M block | DESCRIPTOR | 54 Octets | Description of the device set by the user |

## Response structure for I&M4 (Read/Write)

I&M4 is read/write only in FENA-01. In FENA-11 and FENA-21, it is read-only and shows the FSO configuration CRC.

| | Contents | Size | Coding |
|---|---|---|---|
| Header | | 10 Octets | – |
| I&M block | SIGNATURE | 54 Octets | Security code for identifying sessions and changes |

**Note:** I&M4 is filled with zeros (0x0) by default.

22

# Appendix B – ABB IP configuration tool for FENA

## Contents of this chapter

This chapter shows how to use the ABB IP configuration tool to:

- find configured and unconfigured FENA adapter modules in the network
- rewrite the IP configuration of the adapter modules.

## Installation

The ABB IP configuration tool is part of the Control Builder Plus software. No separate installation is needed.

## Finding adapter modules in the network

1. Open the ABB IP configuration tool.
2. Click the **Scan** button.

   The FENA adapter modules present in the network appear on the results list.

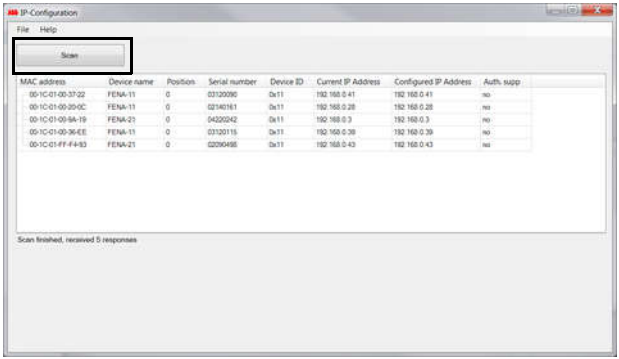

## Rewriting the IP configuration of adapter modules

1. Scan the network for adapter modules.

   For instructions, see section *Finding adapter modules in the network* on page *432*.

2. On the results list, click to select the adapter module whose IP configuration you want to modify.

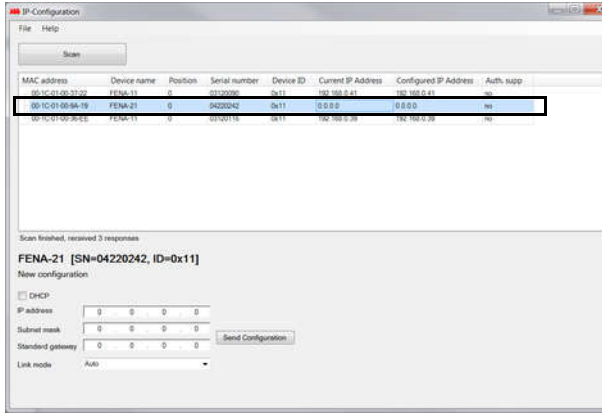


3. Below **New configuration**, define the IP configuration settings according to your network configuration.

4. If you want the adapter module to use a static IP address instead of DHCP, clear the **DHCP** check box.

5. To apply the new settings, click the **Send Configuration** button.

   The new current IP address and configured IP address appear on the results list.

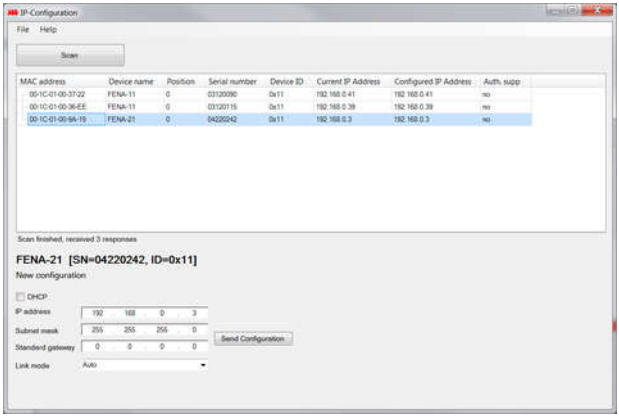

23

# Appendix C – FENA configuration web pages

## Contents of this chapter

This chapter presents the FENA configuration web pages.

**Note**: The web pages are meant only for configuring the device during commissioning. For security reasons, it is recommended to disable the web pages after commissioning.

## Browser requirements

Any web browser can be used.

## Compatibility

The web pages work with all drives compatible with the FENA adapter module. For a compatibility table, see section *Drives* on page *24*.

## Logging in

1. Open a web browser and type the IP address of the adapter module in the address field. The IP address is visible in group A, parameter 5...8.

   **Example:** *http://192.168.0.24/*

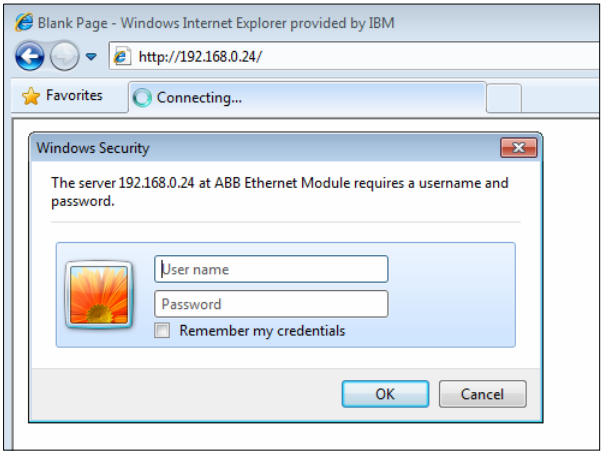


2. Log in with a user name and a password.

   **Default user name**: admin

   **Password**: The last six digits of the MAC address of the adapter module, in upper case, without hyphens.

   The MAC ID is visible on the cover of the adapter module and in the ABB IP configuration tool (see *Appendix B – ABB IP configuration tool for FENA*).

   - **Example**: If the MAC address of the adapter module is 00-1C-01-00-2F-73, the password is 002F73.

   The user interface is loaded.

3. After successful login, you will be prompted to change the password for security reasons.

   It is recommended to change the default password.

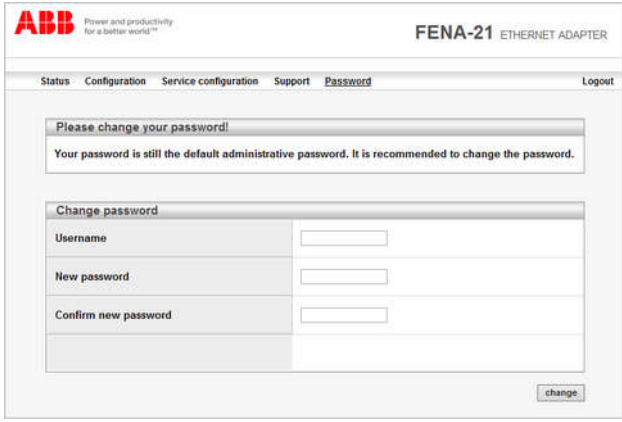

## Menu overview

To navigate on the web pages, use the menu items available:

- **Status** (page *439*)
- **Configuration** (page *440*)
- **Service configuration** (page *444*)
- **Support** (page *447*)
- **Password** (page *448*)

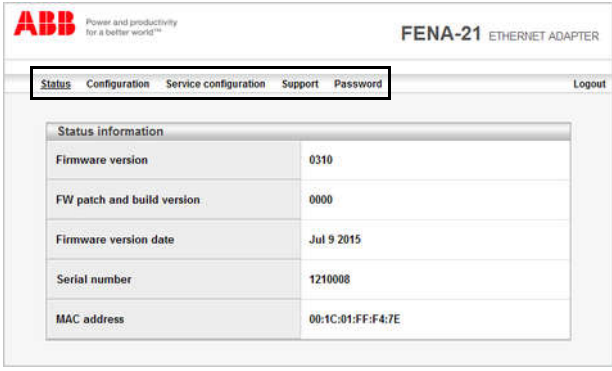

## Status page

The Status page shows various version information, as well as the serial number and MAC address (MAC ID) of the adapter module.

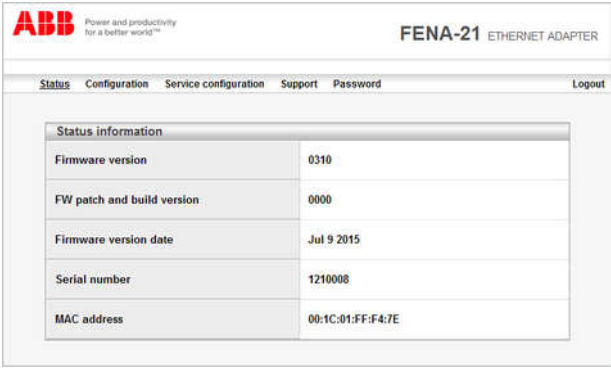

## Configuration page

On the Configuration page, you can modify parameter settings in the configuration parameter groups A (1), B (2) and C (3).

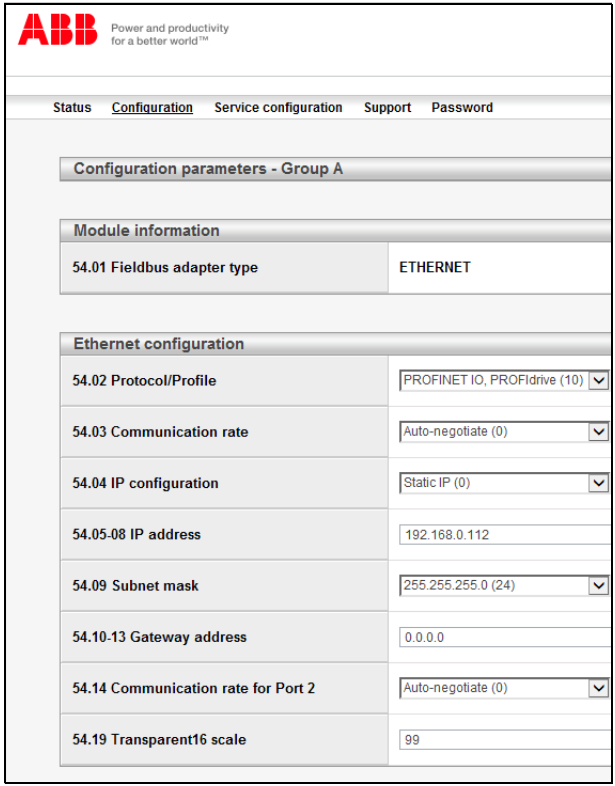

After you have changed any setting in any of the groups, you must click **Save and reboot** at the bottom of Group A to validate the settings.

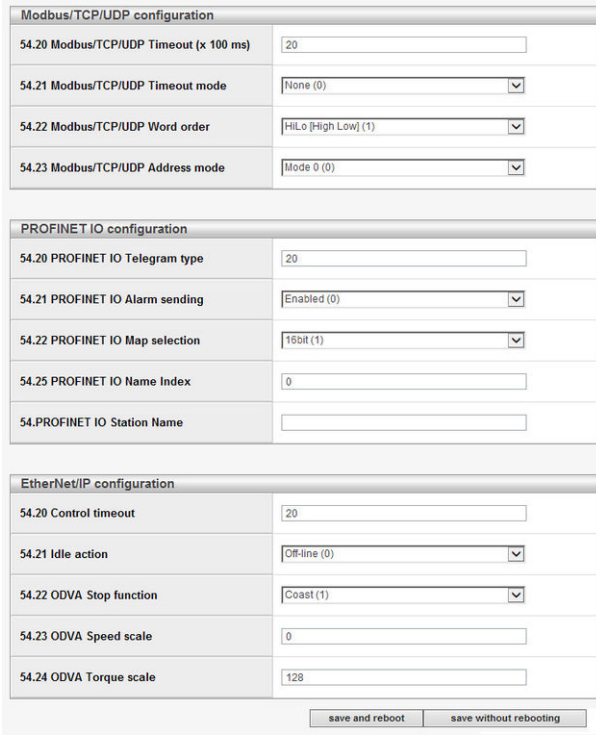

## Changing the PROFINET IO station name via web page

The PROFINET IO configuration web page is shown below with default values. The **PROFINET IO Station Name** field is blank by default.

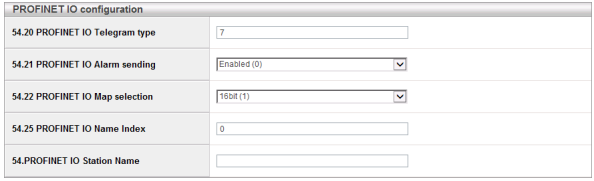


To set a new name, type the name in the **PROFINET IO Station Name** field. Click **Save without rebooting**, and then click **Save and reboot** to reboot FENA. See screen in *Configuration page*.

The new name is effective only after FENA reboot.

**Note**: The value in **PROFINET IO Name Index** field must be 0 to use the set station name. Otherwise the name generated by the PROFINET IO Name index overrides it.

For example, if **PROFINET IO Station Name** is set as *fena-21*. After you click **Save without rebooting**, and then click **Save and reboot**, the refreshed web page is as shown below.

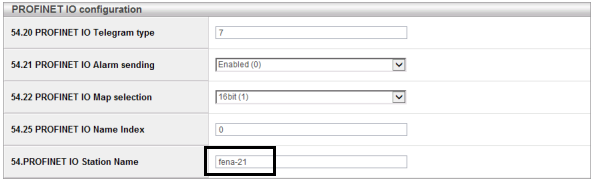

The web page validates the Station name format and displays any correction to the new name, as shown in this example screen.

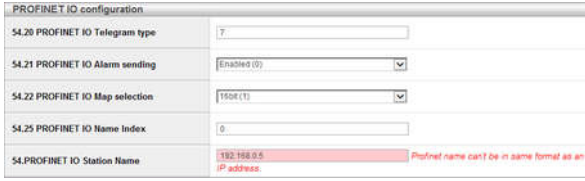


If **PROFINET IO Name Index** was set from web page or from parameters, the **PROFINET IO Station Name** field shows its generated name after reboot, as shown in this example screen.

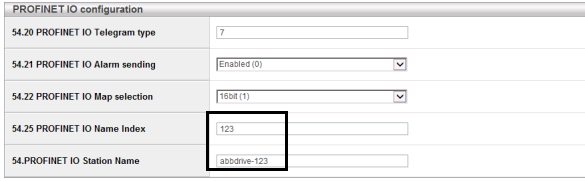

## Service configuration page

On the Service configuration page, you can enable or disable certain Ethernet services. All services except Simple Network Time Protocol (SNTP) are enabled by default. You can disable the following services on this page:

- access to FENA configuration web page
- allow to change IP settings remotely via ABB IP configuration tool
- remote access drive with Drive composer tool via Ethernet tool network
- Ping response
- configure SNTP
- Simple Network Management Protocol (SNMP)

The SNMP can be used to collect and organize information of the managed devices on IP networks.

The new settings take effect after reboot of the module. You can click **Save and reboot**, to validate the new settings immediately or click the **Save without rebooting** if you want to do other settings also and then reboot.

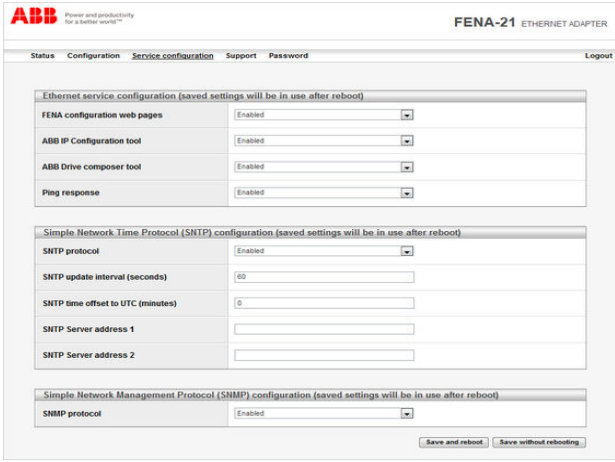


**Note**:

- These settings are available only through web pages. When you select to disable the web page, a warning appears to confirm before you can save the selection.
- If you want to access the disabled web page again,
  - the web page can be accessed only by PROFINET reset to factory settings command. See *Resetting PROFINET IO device to factory default via S7* on page *327*.

  Or

  - You can use the web page password. See *Enable web page access after it was disabled* on page *450*.
- It is recommended to disable all services that are not used after commissioning.

## Configuring SNTP

Simple Network Time Protocol (SNTP) can be used to synchronize drive time with a network time server. When SNTP is enabled FENA-01/-11/-21 will request the time from configured server at a given interval. To receive this time synchronizaton, you must configure the drive with parameter *96.20 time sync primary source*.

The table below shows the settings for SNTP:

| Settings | Description | Value |
|---|---|---|
| SNTP update interval | Interval to request time from server. | minimum: 30 seconds<br>default: 30 seconds |
| SNTP time offset to UTC | Time offset to the time received from SNTP. This value can also be set over Modbus register (4) 00084, PROFIdrive parameter 1001 and Ethernet/IP class object 0x91, Instance 1, Attribute 1.<br>**Note**: SNTP time offset change does not need a reboot. | -1440...1440 minutes |
| SNTP server address 1 | Primary server address for requesting time.<br>Format: IP address followed by optional port number.<br>E.g. 192.168.0.1:123<br>**Note**: If port number is missing, the default NTP port number “123” is used. | - |
| SNTP server address 2 | Secondary server address used if the request to server 1 fails. | - |

## Support page

On the Support page, you can access documentation related to the adapter module, and the EDS and GSDML files. The latest files corresponding to the drive firmware are available through the hyperlinks given below **WWW documentation and downloads**.

You can read more information about each parameter using the **Click here for more information about fieldbus parameters.**

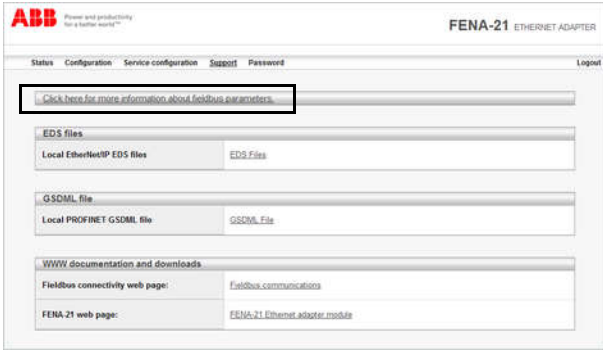

## Password page

On the Password page, you can change password.

FENA supports only one user access level.

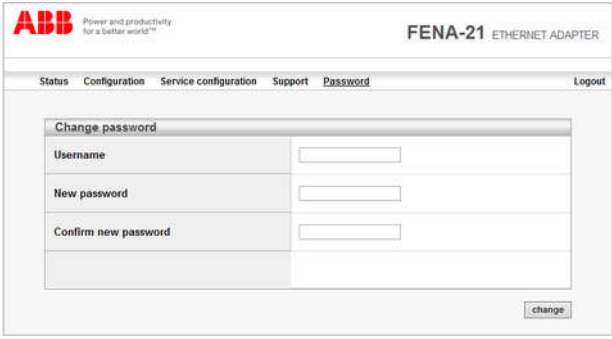

## Reset FENA web page password to default

You can reset the FENA web page password to factory default.

**Note**: The password can be reset only with local access to the drive.

1. Disconnect all cable connections to FENA-01/-11/-21.
   The NET led should switch off.
2. Write 0 (zero) to the parameter 26 under Group A (e.g. 51.26).
3. Refresh the settings by selecting **Refresh** in parameter 27 (e.g. 51.27).
4. Write **17989** to parameter 26 under Group A.
5. Refresh the settings by selecting **Refresh** in parameter 27.
6. Write **20033** to parameter 26 under Group A.
7. Refresh the settings by selecting **Refresh** in parameter 27.
8. Write **0** to parameter 26 under Group A.
   FENA password is now reset to the default password. For information of default password, see section *Logging in* on page *436*.

## Enable web page access after it was disabled

You can enable the access to web pages with drive parameters.

1. Disconnect all cable connections to FENA-01/-11/-21.
   The NET led should switch off.
2. Write 0 (zero) to the parameter 26 under Group A (e.g. 51.26).
3. Refresh the settings by selecting **Refresh** in parameter 27 (e.g. 51.27).
4. Write **87** to parameter 26 under Group A.
5. Refresh the settings by selecting **Refresh** in parameter 27.
6. Write **17730** to parameter 26 under Group A.
7. Refresh the settings by selecting **Refresh** in parameter 27.
8. Write **0** to parameter 26 under Group A.
   Access to web pages is now enabled.

24

# Appendix D – FENA configuration backup

## Contents of this chapter

This chapter presents the settings for FENA configuration backup.

## Compatibility

FENA-11/-21 settings are stored in the drive parameters and also in the configuration files. Starting from FENA V3.11 and ACS880 V2.60, FENA-11/-21 adapter module supports backup of all settings to the drive. These settings are now also included in any backups made of the drive using the Drive Composer PC tool or the control panel.

**Note**: FENA-11/-21 V3.10 and older versions support only backup of parameters.

## Settings for backup

Consider the following points:

- Backup depends on the adapter type and fieldbus channel. For example, backup of FENA-11 is not restored to FENA-21. Likewise, backup of FENA-21 in FBA A is not restored to FENA-21 in FBA B.
- Backup is not slot specific. For example, backup of FENA-21 in FBA A, slot 1 can be restored to FENA-21 in FBA A, slot 2.
- FENA-11/-21 configuration parameters are included in the backup when drive parameters are saved.

### Configuration backup for all protocols in FENA-11/-21

Backup includes the following configuration for all protocols in FENA-11/-21 (starting from V3.11):

| Configuration | Description |
|---|---|
| Ethernet service configuration | Enables different Ethernet services. See *Service configuration page* on page *444*.<br>When set, backup will automatically include this configuration. |
| Web page password | Login password for accessing FENA configuration web pages. See *Password page* on page *448*.<br>Backup will automatically include the set password.<br>**Note**: Backup will include the default password. |
| SNTP configuration | Enables SNTP, request interval, UTC offset, and server addresses. See *Service configuration page* on page *444*<br>When set, backup will automatically include this configuration. |

## Configuration backup for PROFINET IO

Backup includes the following configuration for PROFINET IO in FENA-11/-21 (starting from V3.11):

| Configuration | Description |
|---|---|
| Station name | Sets the station name using DCP or web pages. See *PROFINET network settings* on page *363*. When set, backup will automatically include this configuration. |
| I&M 1-3 | Writable strings for identification and maintenance. See *I&M records* on page *428*. When set, backup will automatically include this configuration. |
| PROFIdrive parameters 934-943 | PROFIdrive CW and SW user bit mapping. See *PROFIdrive parameters* on page *420*. **Note**: Backup will include this configuration only when it is stored with PROFIdrive parameter 971. |
| System location | Writable SNMP MIB-2 string. When set, backup will automatically include this configuration. |
| System name | |
| System contact | |

The settings are saved to the drive after 10 seconds. If the **Save** and **Reboot** command is given from web page or a **Refresh** command is given to FENA-11/-21 using parameter 51.27, the pending backup is transferred to drive immediately and FENA-11/-21 is rebooted after the transfer is completed.

**Note**: The new setting is not saved to drive if the drive was powered off or the adapter was disconnected from the drive within 10 seconds of changing a setting.

## Using the restored backup

The use cases in the below table show how FENA settings can be used after you restored a backup or after you powered up or enabled the fieldbus adapter. The matching status box colours indicate matching configurations.

<table>
<tr><th rowspan="2">No.</th><th colspan="2">Configuration status</th></tr>
<tr><th>Before restore</th><th>After restore</th></tr>
<tr><td>1</td><td colspan="2">Restoring a backup to drive with Drive composer or panel.<br>

<br>Drive and fieldbus adapter can have any configuration.<br>Configuration from backup is used in drive and in FENA-11/-21.</td></tr>
<tr><td>2</td><td colspan="2">Replacing a new fieldbus adapter of the same type.<br>

<br>Drive has a backup of FENA-11/-21 configuration and a new FENA-11/-21 with no configuration is installed.<br>Drive backup is used in FENA-11/-21.</td></tr>
<tr><td>3</td><td colspan="2">Replacing a fieldbus adapter with another adapter of the same type. But the new adapter was used with some other drive previously.<br>

<br>Drive has a backup of FENA-11/-21 configuration and a new FENA-11/-21 with existing configuration is attached.<br>Drive backup is used in FENA-11/-21.</td></tr>
</table>

<table>
<tr><th>No.</th><th colspan="2">Configuration status</th></tr>
<tr><th></th><th>Before restore</th><th>After restore</th></tr>
<tr><td>4</td><td colspan="2">A new drive and fieldbus adapter are used.<br>
</td></tr>
<tr><td></td><td>• Drive has no backup or a backup of some other type of fieldbus adapter other than FENA-11/-21 exists.<br>• FENA-11/-21 with no configuration is attached.</td><td>FENA-11/-21 generates a new backup with its default settings and copies it to drive.</td></tr>
<tr><td>5</td><td colspan="2">Replacing drive with a new drive and reusing the old Fieldbus adapter.<br>
</td></tr>
<tr><td></td><td>• Drive has no backup or a backup of some other type of fieldbus adapter other than FENA-11/-21 exists.<br>• FENA-11/-21 with an existing configuration is attached.</td><td>FENA-11/-21 copies its backup to drive.</td></tr>
<tr><td>6</td><td colspan="2">Clearing fieldbus configuration from drive and module to defaults.<br>
</td></tr>
<tr><td></td><td>Starting from ACS880 V2.60 there is a possibility to clear the fieldbus configuration from drive and module to defaults with parameter 96.06 Parameter restore using the selection Reset all fieldbus settings.</td><td>Clears the fieldbus parameters and backup files for FBA A and FBA B on the drive side. If a FENA-11/-21 adapter is connected, its configurations are reset to defaults.</td></tr>
</table>

# Further information

## Product and service inquiries

Address any inquiries about the product to your local ABB representative, quoting the type designation and serial number of the unit in question. A listing of ABB sales, support and service contacts can be found by navigating to abb.com/searchchannels.

## Product training

For information on ABB product training, navigate to new.abb.com/service/training.

## Providing feedback on ABB manuals

Your comments on our manuals are welcome. Navigate to new.abb.com/drives/manuals-feedback-form.

## Document library on the Internet

You can find manuals and other product documents in PDF format on the Internet at abb.com/drives/documents.

**abb.com/drives**
**abb.com/solar**
**abb.com/windconverters**
**abb.com/drivespartners**




© Copyright 2018 ABB. All rights reserved.
Specifications subject to change without notice.

3AUA0000093568 Rev E (EN) 2018-03-14